

# Building a Sustainable Community in Africa

Water Sustainability at the Mpala Research Centre and Conservancy

**A PROJECT SUBMITTED IN PARTIAL FULFILLMENT OF THE REQUIREMENTS FOR THE  
DEGREE OF MASTER OF SCIENCE (NATURAL RESOURCES AND ENVIRONMENT) AT THE  
UNIVERSITY OF MICHIGAN**

2011

Authored by: Melissa Antokal, Caitlin Boon, Nagapooja Seeba, and Ajay Varadharajan

Advised by: Professor Don Scavia, Professor Andrew Hoffman, Dr. Abigail R. Mechtenberg (Assistant Research Scientist, Applied Physics, University of Michigan), and Professor Steven Wright

# Building a Sustainable Community in Africa

## Water Sustainability at the Mpala Research Centre and Conservancy

### Table of Contents

LIST OF FIGURES.....	4
LIST OF TABLES .....	5
ABBREVIATIONS .....	6
CONVERSIONS.....	7
EXECUTIVE SUMMARY .....	8
WATER ANALYSIS .....	8
WATER-ENERGY NEXUS .....	10
ACKNOWLEDGEMENTS .....	11
INTRODUCTION.....	12
PURPOSE OF THIS REPORT .....	13
SUSTAINABILITY .....	14
SOCIAL SUSTAINABILITY .....	15
ECONOMIC SUSTAINABILITY .....	15
ENVIRONMENTAL SUSTAINABILITY .....	16
WATER AND MPALA.....	17
EXISTING CONDITIONS.....	18
RIVER WATER .....	18
BOREHOLE WATER .....	19
RAINWATER .....	20
TRENDS AND PERCEIVED FUTURE CHALLENGES.....	21
POPULATION GROWTH .....	21
CLIMATE CHANGE AND RAINFALL .....	22
METHODOLOGY .....	24
BEDNIGHT ESTIMATE .....	24
DAILY USAGE.....	24
FIXTURE USE .....	24
ESSENTIAL USE.....	24
BOREHOLE SUPPLY .....	25
ROOF AREA.....	25
ROOF AREA COLLECTION CALCULATIONS .....	25
RAINFALL CALCULATIONS.....	25
ACCUMULATION GRAPHS .....	25
WATER COLLECTION SCENARIOS .....	27
CALCULATIONS .....	28
SCENARIOS.....	29
HOT WATER SYSTEM SIZING.....	29
SOLAR PUMP SIZING .....	30

RESULTS AND OPTIONS FOR THE FUTURE .....	31
RAINWATER CATCHMENT SYSTEMS .....	31
CURRENT RAINFALL CATCHMENT SYSTEMS .....	32
POTENTIAL SOLUTIONS .....	33
FUTURE CONSIDERATIONS .....	36
FILTRATION SYSTEMS .....	36
CATCHMENT AREA.....	36
CONVEYANCE SYSTEM.....	38
ROOF WASHER AND FIRST FLUSH DEVICE.....	39
STORAGE CONTAINER.....	40
DISTRIBUTION .....	41
PURIFICATION .....	42
FILTRATION.....	42
DISINFECTION .....	43
FILTRATION SYSTEM RECOMMENDATIONS .....	44
COSTS .....	44
ABOVE GROUND TANK.....	44
UNDERGROUND TANK .....	45
WATER SAVING TECHNOLOGIES FOR BOREHOLE-SOURCED WATER .....	45
ALTERNATIVE AND ADDITIONAL WATER HARVESTING.....	49
FINANCIAL BENEFITS OF ALTERING THE CURRENT WATER SYSTEM .....	50
BEHAVIOR AND EDUCATION .....	51
RECOMMENDATIONS.....	53
WATER SUSTAINABILITY .....	53
TO FUTURE MASTERS PROJECTS .....	53
WATER-ENERGY NEXUS .....	53
SOLAR THERMAL WATER HEATER .....	54
SOLAR PUMPING .....	55
CONCLUSION.....	57
LITERATURE CITED.....	58
APPENDIX W-1: BOREHOLE METER READINGS AT MAIN (PRIMARY), RANCH & CENTRE BOREHOLE (SECONDARY) (AUGUST – DECEMBER 2010).....	61
APPENDIX W-2: CURRENT BUILDINGS – ROOF SIZE AND WATER STORAGE CAPABILITIES AT MRC .....	65
APPENDIX W-3: ACCUMULATION GRAPHS .....	66
APPENDIX W-3A. ACCUMULATED ROOF RUNOFF AND WATER DEMAND UNDER AVERAGE RAIN CONDITIONS.....	67
APPENDIX W-3B. ACCUMULATED ROOF RUNOFF AND WATER DEMAND UNDER LOW RAIN CONDITIONS..	73
APPENDIX W-3C. ACCUMULATED ROOF RUNOFF AND WATER DEMAND UNDER HIGH RAIN CONDITIONS ..	79
APPENDIX W-4: WATER COLLECTION SCENARIOS .....	85
APPENDIX W-4A. ALL MRC VILLAGE HOUSES, ONLY VILLAGERS DRINK .....	87
APPENDIX W-4B. ALL MRC ROOFS, ONLY VISITORS DRINK .....	88
APPENDIX W-4C. ALL MRC ROOFS, EVERYONE DRINKS .....	89
APPENDIX W-4D. ALL MRC ROOFS, EVERYONE DRINKS, ONE ADDITIONAL TANK.....	90
APPENDIX W-4E. ALL MRC ROOFS, ALL DRINK, 2 ADDITIONAL TANKS .....	91
APPENDIX W-4F. ALL MRC ROOFS, ALL DRINK, 3 ADD'L TANKS .....	92

APPENDIX W-4G. ALL MRC ROOFS, ALL DRINK, 4 EXTRA TANKS.....	93
APPENDIX W-4H. ONE VILLAGE HOUSE, ONLY THAT FAMILY DRINKS .....	94
APPENDIX W-4I. LIBRARY, EVERYONE DRINKS .....	95
APPENDIX W-4J. LIBRARY, PROJECTED POPULATION .....	96
APPENDIX W-4K. ADMIN BLOCK, CURRENT POPULATION.....	97
APPENDIX W-4L. ADMIN BLOCK, PROJECTED POPULATION .....	98
APPENDIX W-4M. MCCORMACK LAB, CURRENT POPULATION .....	99
APPENDIX W-4N. MCCORMACK LAB, PROJECTED POPULATION .....	100
APPENDIX W-4O. NSF LAB, CURRENT POPULATION .....	101
APPENDIX W-4P. NSF LAB, PROJECTED POPULATION .....	102
APPENDIX W-4Q. MESS HALL, CURRENT POPULATION.....	103
APPENDIX W-4R. MESS HALL, PROJECTED POPULATION.....	104
APPENDIX W-4S. SMALL KITCHEN, CURRENT POPULATION .....	105
APPENDIX W-4T. SMALL KITCHEN, PROJECTED POPULATION.....	106
APPENDIX W-4U. DIRECTOR'S HOUSE, CURRENT POPULATION .....	107
APPENDIX W-4V. DIRECTOR'S HOUSE, PROJECTED POPULATION .....	108
APPENDIX W-4W. GIS HOUSE, CURRENT POPULATION .....	109
APPENDIX W-4X. GIS HOUSE, PROJECTED POPULATION .....	110
APPENDIX W-4Y. KLEE HOUSE, CURRENT POPULATION .....	111
APPENDIX W-4Z. KLEE HOUSE, PROJECTED POPULATION .....	112
APPENDIX W-4AA. ADMIN HOUSE, CURRENT POPULATION .....	113
APPENDIX W-4BB. ADMIN HOUSE, PROJECTED POPULATION .....	114
APPENDIX W-4CC. JENGA HOUSE, CURRENT POPULATION.....	115
APPENDIX W-4DD. JENGA HOUSE, PROJECTED POPULATION .....	116
APPENDIX W-4EE. STORE 15, CURRENT POPULATION .....	117
APPENDIX W-4FF. STORE 15, PROJECTED POPULATION .....	118
APPENDIX W-5: HOT WATER NEEDS AND SOLAR THERMAL HOT WATER SIZING AND COSTS .....	119
APPENDIX W-6: RAINFALL DATA.....	120
W-6A. 2001 RAINFALL AT MRC .....	120
W-6B. 2009-2010 MRC RAINFALL VS. LONG-TERM AVERAGE .....	120
W-6C. TOTAL RAINFALL AT MRC BY YEAR .....	121
APPENDIX W-7: COSTS FOR BUILDING WATER TANKS (ABOVE AND BELOWGROUND).....	122

## List of figures

Figure 1: Components of a sustainable design (Daly, 2003) .....	15
Figure 2: Water supply at Mpala.....	17
Figure 3: Accumulated runoff (m3) from entire roof area and essential water required (m3) for current population .....	27
Figure 4: Accumulated runoff (m3) from current roof area converted to capture water and essential water required (m3) for projected future population .....	27
Figure 5: Comparison of current storage capacity and roof catchment serving current and projected total MRC population .....	31
Figure 6: Accumulated water runoff in a wet year (m3) from current converted roof area versus accumulated demand (m3) by current population.....	32
Figure 7: Accumulated water runoff in a drought year (m3) from current converted roof area versus accumulated demand (m3) by current population .....	33
Figure 8: Mess Hall roof, showing degradation as a result of animal activity. Photo by Ajay Varadharajan. ....	37
Figure 9: Birds' nests on NSF lab gutters. Photo by Melissa Antokal. ....	38
Figure 10: Administration building during a rainstorm, showing lost runoff due to insufficient conveyance. Photo by Ajay Varadharajan. ....	39
Figure 11: Mosquito larvae and other contaminants in small tank by kitchen. Photo by Melissa Antokal. ....	40
Figure 12: Plumbing set-up for small water tank by kitchen. Photo by Melissa Antokal. ....	41
Figure 13: Toilet lid sink. Source: Gaiam website. ....	49
Figure 14: Solar thermal water heating system. Image from UNDP GEF Small Grants Programme.....	54
Figure 15: Grundfos solar pump sizing chart. Source: grundfos.com. ....	56

## List of tables

Table 1: Summary of population estimates for Mpala Research Centre and Ranch .....	21
Table 2: Population predictions based on different initial populations, with modt likely scenario highlighted .....	22
Table 3: Water collection scenario considering all rooftops at MRC and current total population at Centre and Village (See Appendix W-4).....	34
Table 4: Volume of rainwater missed or not captured during a wet year due to current storage sizes available for catchment.....	34
Table 5: Washroom fixtures, standard and low-flow rates, costs and sources .....	46
Table 6: Calculated water use per person per bednight in washroom facilities using current and low-flow fixtures, broken down by fixture .....	47
Table 7: Calculated per person total washroom water use per bednight including both visitors and on-site employees using current versus low-flow fixtures.....	47
Table 8: Calculated annual washroom water use using current and reduced from low flow fixtures .....	48
Table 9: Borehole pumping reductions .....	50

## Abbreviations

BTU	British thermal unit
gpf	gallons per flush
gpm	gallons per minute
HDPE	High-density polyethylene
km	kilometers
Ksh	Kenyan Shilling
kW	kilowatt
kWh	kilowatt hours
kWh/m <sup>2</sup> /day	kilowatt hours per square meter per day
l	liters
lcd	liter per capita per day
m <sup>2</sup> or m2	Square Meters
m <sup>3</sup> or m3	Cubic Meters
m	meters
mm	millimeters
MRC	Mpala Research Centre
MRL	Mpala Ranch, Ltd.
ppm	parts per million
PV	Photovoltaic
PVC	Polyvinyl chloride
RO	Reverse osmosis
RWH	Rainwater harvesting [system]
\$USD	U.S. Dollar
UV	Ultraviolet, refers to wavelength of light

## Conversions

1 m<sup>3</sup> = 1000 liters

1 liter = .001 m<sup>3</sup>

1 mm rain \* 1 m<sup>2</sup> roof = 1 liter

1 bednight = one person staying for one night

1 kWh = 3412 BTU

1 \$US = 83.76 Ksh (Rate as of 5 April 2011)

1 Ksh = \$0.0119 US

1 micron = 1.0 \* 10<sup>-6</sup> meters

1 gallon = 3.785 liters

## Executive summary

### Water analysis

For this Masters Project, our team evaluated the water and energy supply and demand at the Mpala Wildlife Foundation and Conservancy (Mpala) in Laikipia, Kenya from a systems perspective. This report in particular covers the water systems at Mpala. Mpala operates and manages a 48,000 acre wildlife conservancy, working ranch (“the Ranch”), research center (“the Centre” or “MRC”), and a variety of community health and outreach programs in Laikipia, Kenya. Its objectives include preserving biodiversity of the region, supporting the natural migration of native species, providing research and learning opportunities for students, as well as sharing their findings regionally and internationally to contribute to the fields of science and sustainability.

The purpose of this study and the main focus of this report for Mpala is the further development of the water systems at the Research Centre site (there is also a Ranch location) to insure that they are economically and environmentally sound, and can be maintained and functional for long into the future. We evaluated the system’s current state and examined potential solutions to the inefficiencies and shortfalls. We also explored the option of expanding rainwater catchment as a way to insure adequate water supply and reduce the Centre’s and Centre Village’s reliance on the non-replenishing aquifer and the intermittent river on site. The water portion of this study proposes a method of capturing and storing a safety stock of water for human consumption during seasonal rains and wet years to provide water during seasonal dry periods and drought years. The Mpala Ranch headquarters (“the Ranch”) was recently equipped with a land weir to supply all of the drinking water to the people that reside at the Ranch employee residences (“the Ranch Village”). Therefore, our team examined a solution for all of those residing and visiting the Centre (“the Centre Village” and “the Centre”). We demonstrate that the current rainwater catchment system at the Centre requires only additions and improvements to provide the current population of the Centre and the Centre Village essential water needs. We also make recommendations for expansion in the future. Our group recommends improving the catchment and filtration systems on the building roofs currently equipped to catch rain water, and expanding the current storage capacity with either underground storage or above ground storage.

We began our study by evaluating current water systems. First we examined the borehole water system. We calculated that Mpala was drawing approximately 30-35 cubic meters of water from the borehole well each day. However, the measured draw at both the Centre and the Ranch added up, on average to a little over half that amount. Despite some expected measurement error on the part of the meters installed, we determined that it was likely the transport system of underground piping was experiencing leaks. The distance of transport (under miles of terrain) was a contributing factor of this inefficiency. At the Centre and the Ranch, the water was used for washrooms for the visitor’s quarters as well as for drinking. In order to drink the borehole water, it first had to be put through an expensive filtering system called Reverse Osmosis.

Next we looked at their use of river water, which is drawn from the Ewaso Ngiro (river). This river began to run dry in 2009, the first time in known history. It has since run dry for a period of months each year. This could be due to the more severe droughts the region has been experiencing, but likely, it is from increased abstraction from upstream agriculture. The presence of this agriculture is also a concern for the quality of river water, as unsafe levels of nitrates may be found as a product of run-off from the agricultural land. This water has not been tested.

The final source of water evaluated was the rainwater storage. The Centre has extensive storage tanks at many of the buildings at the Centre, and a few small tanks at the Centre Village. This is a great source of local water; however, the system is not being fully utilized. Our team witnessed water being poorly covered and invested with insects and debris. We also witnessed several birds on the rooftops, leaving dangerous waste that flowed into the tanks during a

rain. In addition to these system issues, we also witnessed water running off the roofs and not being captured. This is unmet potential.

After evaluating the sources of water, we looked into ways in which the Centre and the Ranch can reduce their water use levels. We recommended installing low flow fixtures in all of the washroom and shower facilities. This provided a water savings of 14% of the total consumption at the Centre. Since the visitors were the only people that used these facilities, and they made up only 25% of the total population at the Centre and Centre Village, the reduction in washroom consumption was reduced by half, but the overall impact was much smaller. The next system we looked at improving for water use reduction was grey water. Grey water is water that is recycled or reused from such uses as hand washing, bathing and cooking. Grey water can be used to irrigate landscape plants, flush toilets, and, if applicable at Mpala in the future, supply a biogas plant. This type of system, considering maximum capacity at the Centre, could provide these uses with 888 liters of water per day.

The final suggestion made for reducing water use is to educate. By communicating the value of water conservancy with a campaign of signage and training, as well as regular education of the employees, their families and the visitors, water use can be reduced through behavior change.

After recommending ways to reduce demand, our team looked at the best method of increasing supply. We identified rooftop rainwater collection as our focus for this study. We began by looking at historical rain data from 1999-2009. We identified levels of rain during the driest years, as well as levels of rain during those years with high rainfall. We also became familiar with the distinct seasonality of the rains at Mpala and the region.

The next step was to look at total cumulative demand, and potential cumulative supply based on different levels of rainfall and varying percentages of available rooftop. There is 4255m<sup>3</sup> of roof area when considering all of the built structures at both the Centre and the Centre Village. We assumed current population at the Centre Village, maximum occupancy at the Centre, and unlimited storage (we calculated cumulative run-off with the assumption we had no storage constraints and could capture all of the runoff). What we found was that in a wet year, there was enough water to provide essential water needs (eight liters/person/day) for all of the people at the Centre and Centre Village, and much to spare for a dry year. However, in a dry year, even when the maximum rooftops were used, there was not enough supply to meet demand or provide for a dry year. In addition, we were asked by Mpala management to consider future population growth. When modeling that variable, there simply would not be enough water to supply this area of Mpala.

Once we completed that evaluation, we determined that we would design a rainwater catchment system that could provide the current population and make recommended additions for the future expected growth. We looked at their current rainwater catchment system. Currently, they have 1973m<sup>2</sup> of rooftop area equipped with metal roofs, gutters systems and some form of water storage, sizes varying by building. We calculated, that in a wet year, characterized by heavy and above average rainfall, using only the rooftop area equipped to capture rain, the Centre was missing or not catching a volume as high as 444m<sup>3</sup> or 444,000 liters in a year. This takes into consideration daily draw of the essential water needs of the current population, just over 1000 liters per day. This volume missed was a function of insufficient storage for the current catchment systems. Therefore, we identified which buildings were missing the greatest amount of rainfall, sized the supplemental storage and determined where and how much additional storage needed to be built.

Once that was complete, we turned our attention to their current catchment systems. A rainwater harvesting (RWH) system is comprised of six general components: a catchment area or surface, such as a roof; gutters or pipes as a conveyance system from the catchment area to the storage tank; a roof washer, to filter major contaminants; a storage

container; a method for distributing the water from the tank; and a process of purification, if the water is intended for human consumption (Kinkade-Levario, 2007). We described each component of this RWH system and recommended specific products, providing costs as well.

Once the RWH system was recommended, we evaluated two types of storage – the above ground system of tanks, an expansion of what currently exists at Mpala, and an underground storage tank. Increasing storage capacity from the current 187,000 liters to over 600,000 liters will have a much larger footprint. The underground, centralized tanks will require less space, less capital investment (~\$20,000US) and more than adequate water for the Centre and Village; however, it is less secure, as contamination can destroy the entire supply. The belowground option also leaves potential above ground space for future additional above ground storage, as well as tie-in of new buildings. The above ground option can be phased in, making less of an upfront financial impact (which is estimated at a total of more than \$50,000US), and spreading the risk of contamination out, so that if one tank loses its supply from contamination, the remainder is still secure. We leave it to the Mpala management to make a choice that best suits their immediate priorities.

### Water-energy nexus

Our team briefly looked at two areas where renewable energy can be used to supply water for Mpala. We looked at a solar pump located at the borehole well and a solar thermal water heating system to provide hot showers for the visitors to the Centre. The solar pump needs to have specifications that allow it to pump 2.5 cubic meters per hour and at a great vertical height because the aquifer head is currently 70 meters below ground and declining. The reduced borehole water use, a result of a grey water system and low flow fixtures at the Centre, comes to about 25-28 m<sup>3</sup> per day. Therefore a pump with the above specifications is required. However, the upfront cost (anywhere from \$2,000 to \$6,000) (Alibaba.com, 2011) is likely to have a payback period of less than two years up to six years due to costs savings accomplished by eliminating the need for the diesel-powered pump, as \$1,200 per year is saved from diesel use reductions.

The solar thermal water heating system has an upfront capital investment of approximately \$15,000US. These systems, 220 liter tanks with 2.3m<sup>2</sup> solar arrays would be placed on the rooftops of the buildings that provide hot showers to both the visitors and the Centre Director's home. There is not money saved on diesel use reduction in this case, as the current system contains solar flat plate collectors (many in disrepair) and wood-burning stoves. What is saved is the health and environmental hazard of burning wood from the surrounding land to fuel the current heaters.

## Acknowledgements

This Master's Project owes its deep gratitude to a number of people and organizations. Our advisors – Don Scavia, Andy Hoffman, Abigail Mechtenberg, and Steven Wright – have helped us along every step of the way. From the development of our project proposal to the final calculations, their support, guidance, and recommendations have been invaluable to our group.

Travelling to Mpala for data collection would have been impossible without financial support from the Graham Environmental Sustainability Institute, the International Institute Experiential Learning Fund, and the SNRE Master's Project Research Grant.

The information that we received from personnel at Mpala, including Dr. Margaret Kinnaird, Mike Littlewood, Mburu Tuni, Joseph Leting, and George Aike, was vital to our analyses and the formation of our recommendations. The management at Mpala was very supportive of our study and very generous with their time during our stay and our subsequent research of their challenges. We are also indebted to the staff and visiting researchers at Mpala, all of whom provided helpful insight into the workings and challenges of water and energy systems at Mpala.

Additionally, there are some people not directly a part of this project that have helped us immensely. We would like to thank Professor Arun Agrawal for joining us during our field observations of the bomas and discussing with us the potential for biogas at Mpala. Walker DePuy, Colin Donihue, and Kayla Yurco took some time from their thesis research to provide us with information on Mpala prior to our summer trip. Chelsea Ransom helped with information gathering at Mpala during a winter 2010 trip to Mpala, as well as inspiring the team to investigate biogas and providing background research on the topic.

We are proud to have been able to play a role in establishing and strengthening the long-term relationship between the Mpala Research Centre and Conservancy and the University of Michigan.

## Introduction

Mpala Wildlife Foundation (“Mpala”) operates and manages a 48,000 acre wildlife conservancy, working ranch (“the Ranch”), research center (“the Centre”), and a variety of community health and outreach programs in Laikipia, Kenya. Its objectives include preserving biodiversity of the region, supporting the natural migration of native species, providing research and learning opportunities for students, as well as sharing their findings regionally and internationally to contribute to the fields of science and sustainability.

The conservancy has many facets. A majority of the land is open grazing land for cattle. To use the land’s resources without interfering with the migration patterns of native species, the rangeland has not been fenced in. The cattle are herded into portable, mobile, and secure areas at night, but roam the conservancy during the day. Another portion of the land is used for the Research Centre and visiting scholar residences for studying the local ecosystem and its biological components. One objective of the Centre is to research, understand, and contribute to the health and sustainability of the local ecosystem. Mpala is located in a semi-arid savanna, and many of the research efforts aim to understand and support the balance of human and nonhuman needs in such a region to serve as a model to other arid savanna regions, ensure the health and sustainability of the balance in this region, and "define key ecosystem components and processes that will be the target of explicit management plans and policies."

In addition to ecosystem services and study, Mpala is the headquarters to several outreach programs. These programs include a mobile medical clinic that sends two nurses out to local communities with limited access to medical care, an educational arm that supports educating young people by building schools and providing resources needed for education, a cottage industry that includes training single mothers how to make fiber mats for sale and how to keep bees for the production of honey, and community projects which supports local neighboring communities in their own conservation and preservation efforts for the region.

Our Masters Project Group at the University of Michigan was invited to contribute to the Centre’s mission by creating a plan that reduces impact on the local environment, benefits local communities, and creates more sustainable operations.

This project will support the Research Centre and Ranch headquarters in approaching two of their main objectives: support programs aimed at the ecological stabilization of natural resources in the area, and provide a model for similar centers elsewhere. With these in mind, this project will allow the Centre to be a model for other communities in similar regions. By reducing the impact of human presence on the local environment, and utilizing resources that are available to Mpala on-site, the benefits will be twofold. One is the aforementioned fulfillment of Mpala's objectives, and the other is the benefit of reducing costs, which is an aim of all businesses and non-profit organizations alike.

Our group visited Mpala in August of 2010 to collect data and learn about their current water systems. We were able to identify areas of great success and certain system improvements that could be made. We have taken a systems approach to analyzing their water challenges and made recommendations that we hope will help them self-sustain into the future.

## Purpose of this report

The motivation behind this study is threefold. The first is to create a sustainable community that will serve as an example to others in the region to follow. The second is to minimize hardship and potential health issues related to increasing energy prices and a reduced water supply for the Mpala Conservancy and its inhabitants. The third is to propose water systems that will provide the visitors and employees at the Mpala Ranch and Research Centre with the required water supply in a manner which is cost effective and self-sustaining, without having to rely heavily on resources outside of the property.

Mpala Wildlife Foundation is an operating foundation that funds and runs a world-class Research Centre, a 48,000 acre wildlife conservancy, and a variety of community health and outreach programs in Laikipia, Kenya (African Conservation Foundation, 2011). This report looks at the Research Centre and Ranch House properties on the conservancy.

The Mpala Conservancy serves as a model of community participation, conservation, research and livelihood in Africa. Mpala is an American-owned property in North Central Kenya. It is a member of the Laikipia Wildlife Forum, “a broad-based conservation organisation dedicated to preserving and managing wildlife populations and wilderness habitats in Kenya’s Laikipia region. The Forum is committed to improving the lives of people in the area through supporting and generating livelihoods, while securing dependable, sustained access to essential natural resources” (Laikipia Wildlife Forum, 2011). More specifically, those involved have agreed to keep their ranches and properties fence-free, to serve as an avenue for migration and conservancy for Africa’s native wildlife. Therefore, this consortium of land owners serves as an example to other regions of how to value the natural processes of the land and its inhabitants, while supporting the livelihoods of the people the land supports.

The Mpala Wildlife Foundation, in other words, values community and the environment, as they believe doing so will enable the sustainability of their presence and success on the land. It then comes as no surprise that they hope to operate in such a way that reflects these values. This report will explore a sustainable framework for collecting essential drinking water that will reflect the values of this community. Therefore, creating a rainwater collection system will minimize the conservancy’s reliance on river and borehole water, which will more directly affect their future water security, as well as that of their neighbors. A large part of the process of becoming a model of sustainability in Africa begins with providing necessary resources to Mpala in a lasting and least impactful way. This report explores methods to do so.

The second reason for the study is to prevent future hardships for Mpala. Just two years ago, the conservancy was so desperate for fresh drinking water, due to a long drought, that they had to request assistance from the local County Council to provide them with supplemental water for their employees and their families. Their situation had become so dire, that they lost several head of cattle (approximately 10% of their stock), and those using the river water were put at risk for bacterial infections and illnesses caused by the reduced flow and increased concentration of harmful biologicals in the water. Since there is no guarantee of future aide from the local government or any way of knowing the extent to which drought can return, and since Mpala hopes to grow in size and population in the near future, a healthy supply of drinking water must be a priority. In fact, sufficient drinking water and a sufficient safety stock of water will be needed to ensure the security and health of the Mpala Conservancy and its inhabitants.

The third reason for this study is to explore ways to help the Mpala Wildlife Foundation run the Ranch and Research Centre more economically. Diesel pumps, for example are used to bring water up from the borehole and the river. Therefore, relying mostly on locally collected rainwater throughout the site may be more ideal than spending the money to maintain the pipeline and pumps, as well as that spent on the fuel to run the system. In addition, exploring

options such as solar-powered pumps and more advanced solar water heaters can, in a reasonably short period after an initial expense, save the foundation a lot of money into the future.

It is clear that the Mpala Wildlife Foundation values the natural beauty, native fauna, and ecological balance of the land they occupy. They rely on this balance to maintain their future prosperity on the land. They also appear to be aware of the impact their presence has and can have on the natural environment. The research performed there is a testament to the contribution it has made to the global scientific community, but also to its neighboring communities. Therefore, this report hopes to play a part in the sustainability of this community for future prosperity, to ensure its success and to support its values in community.

## Sustainability

One of the greatest challenges facing our society is to determine how to balance burgeoning human activity with the processes and resources of the natural world in a way that will sustain the health and well being of our planet in the longer term. With surging populations and rapid economic development across the globe, we are beginning to see limits to the ability of the earth to handle the demands we place upon it.

Sustainable development, although a widely used phrase and idea, has many different meanings and therefore provokes many different responses. In broad terms, the concept of sustainable development is an attempt to address growing concerns about a range of environmental issues with socio-economic issues (Hopwood, Mellor, O'Brien, 2005). Sustainable development has the potential to address fundamental challenges for humanity, now and into the future. Some of the fundamental challenges of humanity today are:

- Climate change
- Energy security
- Water scarcity and quality
- Loss of biodiversity
- Population growth
- Local repairability

The most popular definition of sustainability as defined by the Brundtland Commission in 1987 is to meet the needs of the present without compromising the ability of future generations to meet their own needs.

Webster's definition for sustainability is:

- to support, hold, or bear up from below
- to supply with food, drink, and other necessities of life
- to provide for by furnishing means or funds
- to uphold as valid, just or correct

Oxford's definition for sustainability:

- to maintain at the proper level or standard
- to cause to continue in a certain state

Therefore, this essentially provides us with two important inferences:

1. Sustainability means use of resources at a rate lesser than that at which they regenerate themselves (or)
2. Sustainability is consumption at a rate that doesn't deplete the resource base for future generations' use.

The triple bottom line made up of "social, economic and environmental"; i.e. the "people, planet, profit" was coined by Shell for Sustainability. Sustainable design of technology systems is achieved when economically viable designs are

created that significantly reduce important environmental and societal concerns relative to other available options. Figure 1 summarizes this idea.



FIGURE 1: COMPONENTS OF A SUSTAINABLE DESIGN (DALY, 2003)

## Social sustainability

Social sustainability means maintaining social capital. Social capital is investments and services that create the basic framework for society. It lowers the cost of working together and facilitates cooperation: trust lowers transaction costs. Only systematic community participation and strong civil society, including government can achieve this. Cohesion of community for mutual benefit, connectedness among groups of people, reciprocity, tolerance, compassion, patience, forbearance, fellowship, love, commonly accepted standards of honesty, discipline and ethics. Commonly shared rules, laws, and information (libraries, film, and diskettes) promote social sustainability.

Shared values constitute the part of social capital least subject to rigorous measurement, but essential for social sustainability. Social capital is undercapitalized; hence the high levels of violence and mistrust.

Social (sometimes called moral) capital requires maintenance and replenishment by shared values and equal rights, and by community, religious and cultural interactions. Without such care it depreciates as surely as does physical capital. The creation and maintenance of social capital, as needed for social sustainability, is not yet adequately recognized. Western-style capitalism can weaken social capital to the extent it promotes competition and individualism over cooperation and community. Violence is a massive social cost incurred in some societies because of inadequate investment in social capital. Violence and social breakdown can be the most severe constraint to sustainability.

## Economic sustainability

Economic capital should be maintained. The widely accepted definition of economic sustainability is maintenance of capital, or keeping capital intact. Thus Hicks's definition of income—the amount one can consume during a period and still be as well off at the end of the period—can define economic sustainability, as it devolves on consuming value-added (interest), rather than capital. Economic and manufactured capital is substitutable. There is much overcapitalization of manufactured capital, such as too many fishing boats and sawmills chasing declining fish stocks and forests.

Historically, economics has rarely been concerned with natural capital (e.g., intact forests, healthy air). To the traditional economic criteria of allocation and efficiency must now be added a third, that of scale (Daly, Herman E.,

2003). The scale criterion would constrain throughput growth—the flow of material and energy (natural capital) from environmental sources to sinks.

Economics values things in monetary terms, and has major problems valuing natural capital, intangible, intergenerational, and especially common access resources, such as air. Because people and irreversibles are at stake, economic policy needs to use anticipation and the precautionary principle routinely, and should err on the side of caution in the face of uncertainty and risk.

## Environmental sustainability

Although environmental sustainability is needed by humans and originated because of social concerns, it seeks to improve human welfare by protecting natural capital. As contrasted with economic capital, natural capital consists of water, land, air, minerals and ecosystem services; hence much is converted to manufactured or economic capital. Environment includes the sources of raw materials used for human needs, and ensuring that sink capacities recycling human wastes are not exceeded, to prevent harm to humans.

Humanity must learn to live within the limitations of the biophysical environment. Environmental sustainability means natural capital must be maintained, both as a provider of inputs (sources), and as a sink for wastes. This means holding the scale of the human economic subsystem (the population and consumption, at any given level of technology) to within the biophysical limits of the overall ecosystem on which it depends. Environmental sustainability needs sustainable consumption by a stable population.

On the sink side, this translates into holding waste emissions within the assimilative capacity of the environment without impairing it. On the source side, harvest rates of renewables must be kept within regeneration rates. Technology can promote or demote environmental sustainability. Non-renewables cannot be made sustainable, but quasi-environmental sustainability can be approached for non-renewables by holding their depletion rates equal to the rate at which renewable substitutes are created. There are no substitutes for most environmental services, and there is much irreversibility if they are damaged (Goodland, 2002).

Healthy ecosystems provide vital goods and services to humans and other organisms. There are two major ways of reducing negative human impact and enhancing ecosystem services and the first of these is environmental management. This direct approach is based largely on information gained from earth science, environmental science and conservation biology. However, this is management at the end of a long series of indirect causal factors that are initiated by human consumption, so a second approach is through demand management of human resource use.

Management of human consumption of resources is an indirect approach based largely on information gained from economics. Herman Daly has suggested three broad criteria for ecological sustainability: renewable resources should provide a sustainable yield (the rate of harvest should not exceed the rate of regeneration); for non-renewable resources there should be equivalent development of renewable substitutes; waste generation should not exceed the assimilative capacity of the environment (Daly, 1990).

## Water and Mpala

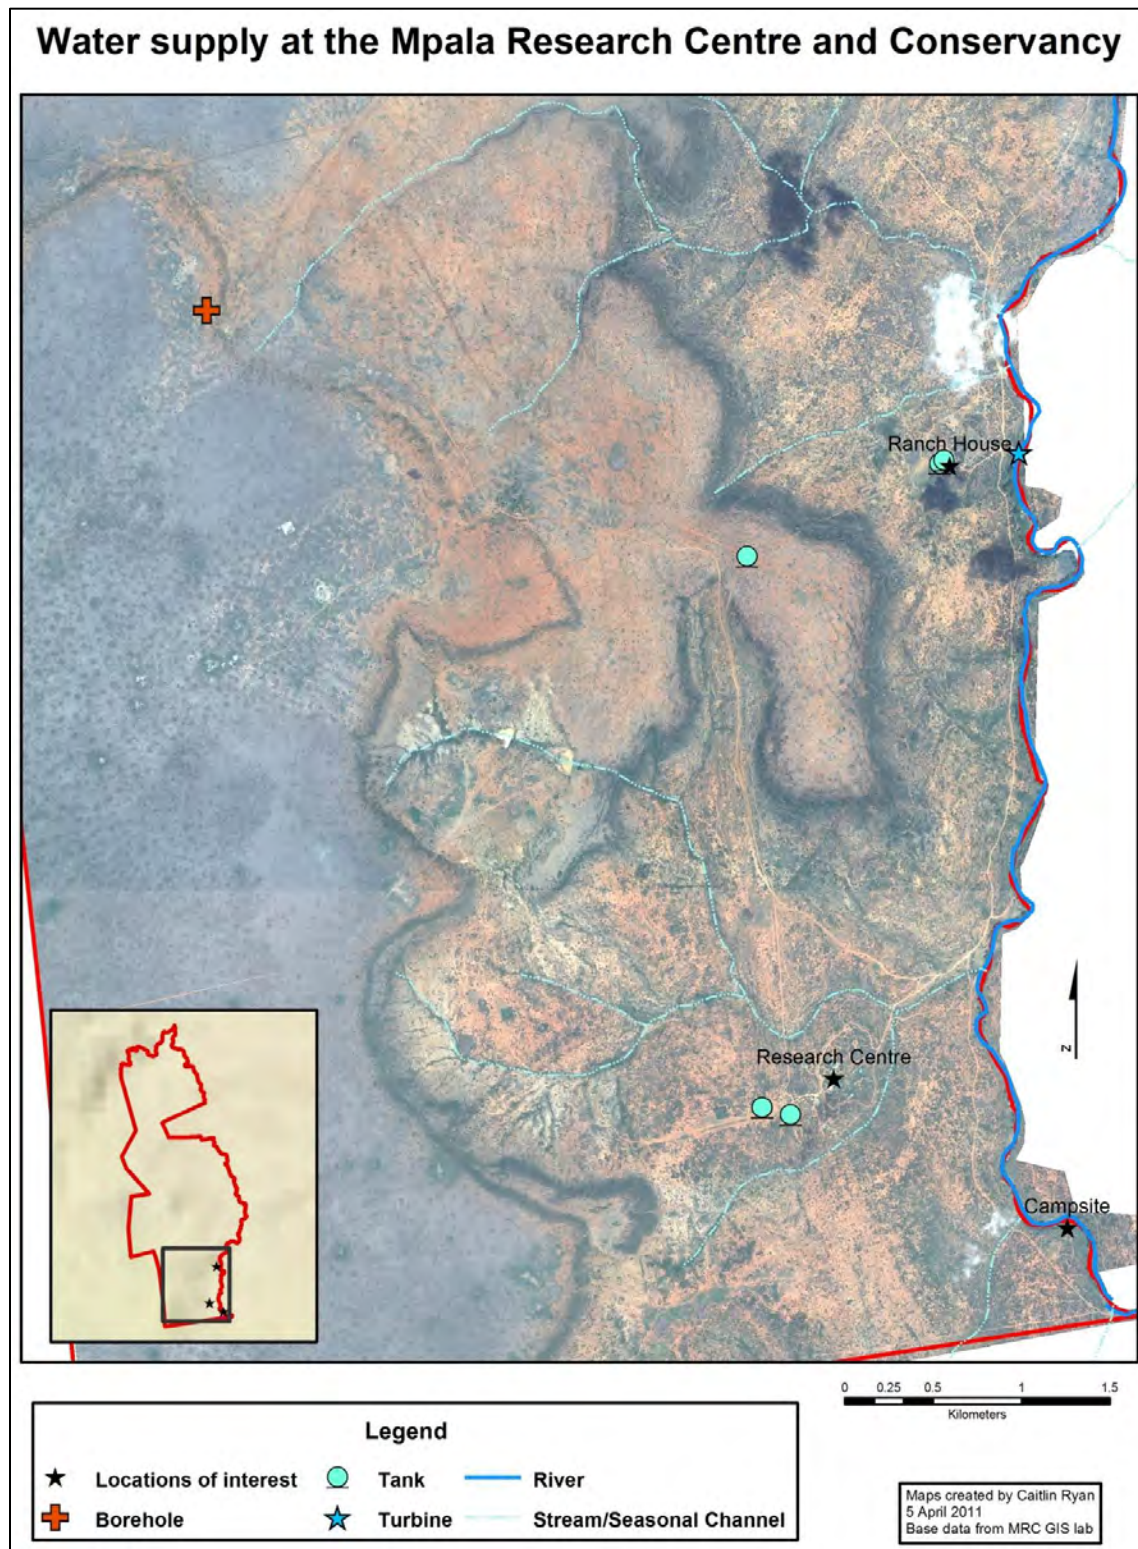


FIGURE 2: WATER SUPPLY AT MPALA

## Existing conditions

There are three main sources of water at Mpala – river, rainwater storage, and borehole (Figure 2). The first two are dependent upon current weather and rainfall. The latter is an ancient and finite supply, with its imperfections and challenges, but whose supply is not dependent upon the current weather conditions. The challenge that Mpala faces is to identify which source, or combination of sources, is ideal to supply water for their daily needs and to minimize water stress during times of drought.

Figure 2 (previous page) shows the locations of important aspects of Mpala's water supply, including the central borehole, the turbine location, which pumps water from the Ewaso Ngiro, and storage tanks at the Mpala Ranch and Mpala Research Centre complexes.

## River water

There is a river that runs along the east side and one along the west side of the Mpala property, the Ewaso Ngiro and the Ewaso Narok. Mpala uses its river water for consumption and hydro power from the Ewaso Ngiro. Currently, Mpala pumps water from the Ewaso Ngiro from two separate places. One location pumps water to the staff village at the Centre using a diesel-fueled pump. The other river water is pumped from the Ranch area to the Ranch staff Village at the Ranch and to tanks for the cattle throughout the property, using either the hydroelectric pump powered by the river, or a diesel-fueled pump. The river water is used for consumption by the staff and their families. The cattle use the river water when the reservoirs that have been dug for them throughout the property run dry. They are also used for the spray races, where the cattle are treated for ticks and other insect infestations. According to the pump manager, Masiyoi, the tank at the Centre Village holds 1000 liters and is filled approximately every three days.

The river water is a preferred source by the staff and their families. This is due to cultural and historical ties to the river, but also preferred qualities. They like the taste, and the pH of the water is adequate for creating good lather and clean rinsing in the washing of clothes and house cleaning. With the alternatives currently available, it is difficult to convince the local inhabitants to override this preference. There has been recent and increased use by the Village inhabitants of some borehole and rainwater.

## Challenges with river water

The challenges with the river water are supply, quality and energy use. The river, for the first time in living memory, ran dry for a number of months in 2009 and has periodically since that time. It also is seasonal, and therefore, even if it does not run dry, it can run low during the dry seasons (mainly January through March). It is for this reason that it is not a substantial or consistent source of water for consumption and other uses.

The quality is also a concern. The river water is partially contributed to by rain and run-off from the surrounding lands. With commercial horticulture increasing upstream, there is a concern of pesticides and fertilizers running off the land and into the rivers. This could greatly affect the safety of the water for humans and animals. This water has not yet been tested for these compounds, such as nitrates. In addition to anthropogenic contaminants, natural occurrences of bacteria are present in river water. When the river runs high, the bacteria concentration is less of a concern. But if Mpala is providing river water to the staff villages while the river is running low, the concentration of bacteria present in the water has in the past led to diarrhea and other digestive illnesses.

Another pressing concern about using the river water is the extraction and transportation methods. While it would be undesirable to ask the villagers to travel down to the river and carry their water home, maintaining the current method is expensive and polluting. Using diesel pumps is not economically preferable or sustainable. Therefore, if

pumping water across any distance is required for this property, a more sustainable, less polluting and renewable form of energy should be considered. Local water sourcing, where possible, is the most ideal scenario.

The Ewaso Ngiro running dry was a shock to the managers and local residents at Mpala. For many of them, this was the first time of their, in some cases, decades long residence at Mpala to see the river bed completely dry. The river has not only provided the cattle with 'back-up' water when the reservoirs throughout the site run dry, they are also a culturally and functionally significant aspect of the lives of the Kenyans that live in the region. The river is their preferred source of water, but as of recent years, increased upstream abstraction, as well as long durations without rainfall, has contributed to its decreased flow. The absence of such a staple may not only lead to hardship of the people at Mpala and the surrounding communities, it could also lead to political and social unrest, as a common essential resource is threatened. Therefore, the reliance on the river water has become a risk to Mpala. In addition to its consumptive needs, the river provides power to the Mpala Ranch and potentially to the Centre.

## **Borehole water**

The borehole, dug for Mpala in 2007, has become a steady and reliable source of water. It is located at a high elevation on the north portion of the property and is brought downhill using gravity and a diesel pump to provide water for both the Ranch and the Centre. It is first pumped at the borehole site into two main tanks. From there, it is sent to a secondary single supply tank. One line from there goes to the Ranch, the other goes down to the Centre. At the Centre, there is a storage tank from which water is transferred to large black plastic tanks on the back of a small truck and taken to the Centre, the Ranch Manager's house and the Campsite. There are also several taps that emerge from the ground throughout the Centre that provides this borehole water. The borehole water is used for washing, flushing toilets and drinking water for the researchers and visitors. Some staff and their families will use borehole water, but sparingly, as they don't like the way the mineral content affects their washing. They also don't like the taste of the borehole water. At the Ranch, it is used exclusively as drinking and cleaning water for the guest house and again sparingly for the Ranch Village. At both guest locations (Ranch and Centre), the borehole water is treated for consumption with a bone-char filter, which is used to remove fluoride, and with reverse osmosis, to sanitize the water.

## **Challenges with borehole water**

The challenges facing this source of water are as follows. The source itself is not replenish-able. It is an ancient aquifer (also referred to as a fossil aquifer), and is used at a rate much higher than it is supplied. Therefore, it has a limited life and cannot be relied upon in the long term. There is also known to be more than one property in the area drawing from this source. The foundation is keeping track of its level and its usage, so that it knows how quickly it is using the water. The question remains, however, how much is left. The level appears to be dropping aquifer head at a rate of ~7m per year, and the location of the bottom and borders of this source remain unknown (Lane, 2010).

The second challenge is the transport of this water. With literally kilometers of piping carrying the water from the source to its destinations, the chance of great loss due to leaks and cracks are great. As can be seen in Appendix W-1, the amount measured from the extraction site is far more than the daily amount drawn from each destination, and over a long enough time period that it is clear water is being lost.

The third concern is the mineral content. There is a high level of fluoride in the water. Fluoride is considered essential for promotion of dental health. At a level of 0.5 to 1.5 ppm, fluoride does just that. However, at levels over 10 ppm, you begin to see severe osteoflourosis, a condition that cause digestive problems, neurological dysfunctions and arthritic-like symptoms (Schmidt, 2006). The water at the borehole currently in use at Mpala has levels of fluoride at 24 ppm (Lane, 2010). The filtering of this water is very expensive. Reverse osmosis, used for the drinking

water of the guests, is a large expense, but the bone filters are also financial burden. This mineral content also makes for an unusual taste and a quality to the water that makes it difficult to wash with. As a result, the staff families complain of this quality and rarely use it.

Finally, the borehole is deep and currently requires a diesel pump to extract and deliver the water. This again, leads to cost, pollution and sustainability concerns. Solar and wind pumps can be looked into, but at the current depth, this borehole will require a substantial capital investment and a large solar array to provide adequate power (as explained later in this report).

## Rainwater

Rain is very intermittent at Mpala. There are distinct seasons – long rains, short rains, continental rains and dry season. This rain has supplied water for the cattle year round, human use and the small amount of irrigation needed. However, business as usual has become quite a challenge over the last several years. The dry season is drier and the rainy seasons have shorter, but more intense rain events. Three symptoms of this shift have been longer durations without rain, the local Ewaso Ngiro running dry for periods of time, and less frequent but more severe rain events causing an increase in damage to land and reservoirs throughout the site. These symptoms have brought painful consequences to Mpala. As mentioned, the droughts in the area have become more severe. The last drought, lasting four years and causing the Ewaso Ngiro to run dry for the first time in recent history, created an eye-opening experience for those at the Mpala Ranch and Research Centre. According to Michael Littleton (2010), Mpala Ranch Manager, 10% of their cattle were lost, and the Foundation had to campaign very hard to receive aid from the local county council. If possible, the Foundation would like to avoid being in this position in the future, where further aid is not guaranteed.

In periods without rain, the river, while varying in flow, has always been present, if not ideal as an additional source. However, since rain feeds the river, and the long periods without rain among other things have led the river to run dry, the reliance on the river as a backup is no longer a viable option. The severe rain events have led to the destruction of ‘dams’ or artificial reservoirs throughout the Mpala property that serve to provide drinking water for the cattle and local wildlife. The droughts have caused the dams to run dry, and the more recently severe rain events have caused increased silting and in some cases, as mentioned above destruction of these reservoirs. What has been considered by Mpala, and rightly so, is an expansion of rain catchment and storage for use and back up during the dry seasons. These catchment systems include a weir constructed to withstand severe events and have a capacity of up to 200,000 cubic meters of rainwater for the Ranch Village inhabitants, cattle and wildlife. The other type of system, which this report supports, is an expanded rooftop rain catchment system that collects and stores drinking water for all of the people at Mpala during each season of the year, and is sufficiently sized to store emergency supply during long periods of drought.

## Challenges to rainwater

Rain water as a source for consumption is the purest available at Mpala. However, the vehicle to catch the water (a metal roof top, for example) and the vessel it is stored in (an overland weir or constructed tank), add complications to the use of rain water for safe human consumption. For example, the metal roofs can experience rusting, waste droppings from local bird species, and air contaminants that settle on the roof and get washed into the tanks. The tank can also become contaminated by rodents or insects, or bacteria and fungi if not properly protected. Therefore, if the movement of rain from the sky to the glass can be properly constructed and monitored, then rain is an ideal source for drinking water at Mpala. Another challenge beyond sanitary collection and storage is the rate and amount of supply. As mentioned above, the rains in Kenya do not come in a consistent pattern. There are periods throughout the year that produce hard and fast events, dumping up to eight percent of the annual rainfall in one day, as it did on

November 13, 2001 (Mpala Weather Station). There have then been situations, such as the extended dry seasons in 2008 and 2009, where rainfall was sparse from late November through April and then again dry in June, July. With these types of drastic variances, designing an ideal storage capacity is quite a challenge. For weirs, considerations include evaporation; with the tanks, proper sizing; and with both, potential contamination. However, it seems as though the challenges for rainwater are surmountable and with proper engineering, a viable solution for the water supply at Mpala. See Appendix W-6 for historic rain patterns at Mpala Conservancy.

In an article by D. Mboyah published in the Africa Science News Service in 2008, a Maasai livestock farmer from Enkiroka in the Kajiado district, south of Nairobi, claimed that in the past, they would experience a drought every 10 years, but the frequency has increased to every year. “Climate change already caused massive losses to pastoralists in the northern parts of Kenya, as they are exposed to extreme drought that has led to soil erosion and drying of water pans.”

While 2010 brought above average rainfall, Dr. Joseph Mukabana, director of the Meteorology Department in Nairobi, predicts that Kenya will see more drought during the coming year. With another drought on the horizon, and more predicted from climate scientists, Mpala has an urgent need to store sufficient rain water when it comes and to manage the storms severity as best it can. That would require a stronger infrastructure to withstand the fierceness of the storm events. They would need to take advantage of the relief the land has to direct water most efficiently, and create storage that is large enough to serve Mpala humans and animals. A new infrastructure to deliver the water effectively would also be required, unless more local solutions are found.

## Trends and perceived future challenges

### Population growth

In addition to the challenges that Mpala faces now, providing its human and livestock populations with adequate water resources, it must consider the future needs. This includes an increase in population. Following is a short assessment of population estimates.

### Villages

Present surveys estimate the total population at the Centre and Ranch from 400 people up to almost 700 during the summer when children and family members return (Table 1). Estimates average a year-round population of around 550 people, but the Centre and Ranch should consider constructing a system capable of handling the water needs of the largest potential population to extend the period until additions are required.

TABLE 1: SUMMARY OF POPULATION ESTIMATES FOR MPALA RESEARCH CENTRE AND RANCH

Source	MRC	Ranch	Total
Aquasearch Ltd. Report (Lane, 2010)	149	367	516
2009 Census (Littlewood, 2010)	239	367	606
Director estimate (Kinnaird, 2010)	NA	NA	~600
Administrator estimate (Leting, n.d.)	NA	NA	~400-500; ~650 during summer
Operations Manager estimate	~225	NA	NA
Undated communication	191; 258 during summer	232; 441 during summer	423; 699 during summer

Assuming population growth in Mpala is consistent with Kenyan population growth rates (2.69%/year), village populations at the Centre and Ranch should reach 700 in eight years (United States Central Intelligence Agency, 2010). Establishing a more accurate population count at the Centre and Ranch Villages will be important step for any action on water resource management, because the differences will be compounded over time (Table 2). Additionally, considering the higher standard for villagers at Mpala over Kenya more generally, the population growth rate may be considerably lower.

TABLE 2: POPULATION PREDICTIONS BASED ON DIFFERENT INITIAL POPULATIONS, WITH MODT LIKELY SCENARIO HIGHLIGHTED

	Year	2010	2011	2012	2013	2014	2015	2016	2017	2018	2019	2020	2025	2030
Population														
400		411	422	433	445	457	469	482	495	508	522	536	612	699
500		513	527	541	556	571	586	602	618	635	652	670	765	873
550		565	580	596	612	628	645	662	680	698	717	737	841	961
600		616	633	650	667	685	704	723	742	762	782	804	918	1048
700		719	738	758	778	799	821	843	866	889	913	937	1071	1223

## Researchers

The population estimates for the MRC and Ranch are only for villagers and do not take into account visiting researchers housed at the Centre and the future expansion of facilities to accommodate more researchers. Although the number of researchers varies considerably throughout the year, there is currently a maximum capacity of more than 60 visitors, spread between the river Campsite, the dormitories, and the bandas (Mpala Research Centre and Wildlife Foundation, 2010).

## Livestock

The Ranch has a peak livestock population of 2500 cattle, 100 sheep, and a handful of camels and goats (Littleton, 2010). The Ministry of Water and Irrigation (formerly the Ministry of Water Development) estimates livestock water demand at 50 l/day per livestock unit, which it defines as three indigenous cattle or 15 sheep or goats (Kalders, 1986). The draft report by Aquasearch Ltd. estimates demand at 50 l/day per head of cattle at Mpala because of the higher demand for water by grade cattle (Lane, 2010). Total demand by cattle is approximately 125 m<sup>3</sup>/day; including sheep and camels raises this estimate by less than .5 m<sup>3</sup>/day. The peak livestock populations seem unlikely to rise significantly in the near future.

For the purpose of this report, the human population at the Centre, current and future, will be evaluated and accommodated. At the request of the Mpala management, the future population will be measured at 200% of the current average visitor population (as the Research Centre hopes to accommodate more research studies in the future) and 133% of the current Centre Village population, to account for the increase in staff that will be needed to serve to additional visitor population.

## Climate change and rainfall

In addition to the conditions on site at Mpala, anyone attempting to solve the water issue at Mpala must consider external drivers. For example, increased horticulture on land upstream may be contributing to the dry river bed during the dry season. Certain factors such as these could be further impacting the challenges they face. In addition to human impact, there is also a more global issue that could be contributing to the water issue, climate change.

Whether the change in the local climate is a result of global warming, or if there is simply a change in northeast Africa, changing conditions have been noted.

In Appendix W-6c it is apparent that over the last several decades, droughts have come and go (1999, 2000, and 2009). However, evidence shows that more recently, longer dry seasons and unseasonable drought has been observed. As a result of these patterns along with both an observed increased in wildlife migration through the region and the increased population of humans at Mpala, there is an urgent need to pay close attention to these patterns. With the possibility that this pattern is a permanent change to the conditions in the region, and there continues to be an increase in population and commercial horticulture throughout North Central Kenya, it is important to listen to the experts.

According to Mukabana (2010), climate change has increased the minimum and maximum temperatures in Kenya, led to recession and drastic declining trends of glaciers on Mt. Kenya, increased the frequency and intensity of rainfall extremes (droughts, floods), and shrinking and decline in lakes and river levels where some streams have now become seasonal. The extreme cases, with floods for example have led to infrastructure damages. Mpala has been witness to all of this. Mike Littleton, Ranch Manager at Mpala has had to deal with a broken spillway at a dam site. The reservoir, one of many created by Mpala and built for flood overflow, did not withstand the strength of the mid-year storms and the spillway broke away under the force of the storm water. Now this reservoir sits empty and is not a resource this season for the Mpala cattle or local wildlife. The minimum and maximum temperatures could potentially damage plant life in this climate. Plants and their root systems slow storm water – therefore, the temperature extremes exacerbate the damage done by the intense storms.

## Methodology

### Bednight estimate

A bednight is equal to one visitor staying overnight for one night. Therefore, one visitor staying for five nights is equal to five bednights, two people staying for five nights is equal to ten bednights, and so on. Daily bednight data for Research Centre and campsite visitors for August 2007-August 2010 was obtained from the MRC Director, Dr. Kinnaird. Monthly values for January 2006-December 2009 were also provided for both the Centre and the campsite. For each location, total monthly bednights were recorded. For missing data, attempts were made to overestimate, rather than underestimate, the number of potential visitors to ensure greater flexibility of the final outputs. For September-December of 2010, the bednight estimate was the maximum recorded for that month for all previous years.

We determined which month from the whole time period had the greatest number of bednights. For the Centre, this was June 2010 with 1112 bednights, and for the campsite it was March 2009, with 846 bednights. These values were divided by the number of days in each month to arrive at an estimated 27 people per day staying at the campsite and an average of 37 people per day staying at the Research Centre.

### Daily usage

#### Fixture use

Total water demand at the MRC was estimated at 189 liters per person per day (lcd) for visitors staying at the Research Centre, 20 lcd for Centre employees, 80 lcd for visitors at the Campsite, and 75 lcd at the Centre Village. Estimated usage for Centre visitors and employees was based on usage for fixtures and essential water demand (see 'Essential use,' below), while usage for villagers and campsite visitors was based on values in the Hydrogeological Assessment Study Report by I.M. Lane (2010).

For visitors at the Centre proper, average water use was broken into water from taps, toilets, and showers. Usage of taps was estimated at two and one half minutes per day, showers were estimated at ten minutes with one shower per day, and toilet use was estimated at five flushes per day. These estimates were multiplied by water usage per minute or flush from fixture specifications and summed to find total fixture water usage (Kohler Worldwide, n.d; EPA WaterSense, 2007; United States Green Building Council, 2009). An additional eight lcd was included for essential water usage.

Fixture use by employees was also included in total water demand to account for employees using bathrooms and sinks on site, but not including showers. Employee use was calculated by estimating 40 employees working five days per week for 50 weeks per year using fixture specifications listed above.

For rainwater harvesting calculations, we estimated a generous eight lcd for drinking, cooking, and some washing. Employees are included in the Village population, so their essential consumption was not included as a separate component.

#### Essential use

Per person daily needs of essential water includes drinking water, water for basic washing, cooking water and clothes washing water.

This breaks down to approximately two and one half liters for drinking (Mayo Clinic, 2007), two and one half liters for cooking, and three liters for laundry and basic washing. This totals eight liters per person per day. Essential water

is the same for all people present at all locations and includes Village inhabitants and Centre inhabitants (visitors and Director)

### Borehole supply

There are meters measuring the amount of water in cubic meters (m<sup>3</sup>, 1000 liters) drawn from the borehole on a daily basis. There are currently three meters in place. The first is located at the source of the borehole, before the water is stored in the two initial tanks at the borehole site, which measures total water drawn from the borehole. There is a second meter that tracks the amount of water drawn from the borehole storage tank located at the Mpala Research Centre. There is a third meter that measures the amount of water drawn into the storage tank at the Mpala Ranch from the intermediary tank. Measurements were taken beginning 10 August 2010 and ending 29 December 2010. Appendix W-1 shows the dates of measurements for different meters; not all meters were measured every day.

### Roof area

Roof areas of the Centre buildings were collected from several sources. The Centre building areas were provided by the Centre Director, Margaret Kinnaird. These measurements were cross-referenced with reports by Odhiambo et al. (n.d.) and Lane (2010), as well as floor plans provided by Joseph Leting for the Library, NSF lab, and library. Ajay Varadharajan and Chelsea Ransom manually measured the homes and buildings in the Centre Village and confirmed the number and materials of buildings with Dr. Kinnaird. The estimated total roof area calculated at the Centre location was 4255 m<sup>2</sup>. The estimated roof area currently equipped for catchment is 1973 m<sup>2</sup>.

At the Ranch headquarters, the roof areas were again collected from the Odhiambo and Lane reports, as well as a list of manually measured buildings provided by the Ranch Director, Michael Littleton. Director Littleton provided a detailed list of all of the Ranch buildings, including each individual Village home and school property buildings. A table of roof areas can be found in Appendix W-2.

### Roof area collection calculations

Rain water collection was calculated using the following formula:

Rainfall (mm) \* Roof Area (m<sup>2</sup>) \* (1m/1000mm) \* 85% = m<sup>3</sup> of water collected. 85% is a generally accepted coefficient of run-off for metal roofs.

### Rainfall calculations

Rainfall data came from the Mpala Weather Station, located at MRC, data supplied to us by Chris Odhiambo, who used to manage the operations surrounding the weather station. Daily, monthly and annual averages, minimums and maximums, and standard deviations were calculated. This rain data was used to populate our accumulation graphs and water collection scenarios, with monthly averages, minimums, and maximums used for accumulation graphs and actual daily precipitation used for the water collection scenarios.

### Accumulation graphs

The accumulations graphs illustrate the accumulated demand of water consumption for essential needs over the course of one year and the accumulated storage capabilities of different storage sizes over the course of one year.

The following assumptions apply to all accumulation graphs:

- The average person requires eight 'essential' liters of water per day for drinking, cooking, laundry and basic washing. Water is not needed in excess of this essential water.
- MRC visitors include visitors at both the campsite and the Centre.

- The current population of visitors consuming this water at the Research Centre a constant 64 (27 at Campsite, 37 at Centre) based on maximum monthly number of bednights over years 2007-2010 provided by Mpala Research Centre divided by the number of days in the maximum month (30 days).
- The current population consuming this water in the Centre Village is 239, from the 2009 census.
- The projected population for visitors is 128, 100% more than the current population, at the request of the Dr. Kinnaird.
- The projected population for the Village is 319, 33% more than the current population. It was assumed that as the visitor population grows, approximately 33 additional employees will be required per 100 additional visitors. This also assumes new employees will bring with them few to no additional family members. These are estimations.
- Total available roof area is 4255 m<sup>2</sup>. The actual current available metal roof area adequate for catchment is 1973 m<sup>2</sup> (46.4% of total available roof area).
- There are no storage constraints for these graphs. Accumulated storage simply equates to the total volume of run-off.

The methods used in these graphs were as following:

- Essential water needed is illustrated by a red line. Potential water capture for consumption is illustrated by a blue line.
- The variables for different scenarios included population size (current versus projected), percentage of roof area dedicated to collecting run-off (100%, 75%, 50%, and 46.4%), and monthly rainfall (average, high, and low).
- Rainfall data from the Mpala Weather Station for years 1999-2009 was used to find average, high, and low monthly rainfall values. Average rainfall was the average across this time period. High and low rainfall was the maximum and minimum rainfall for a month over this time period, respectively.
- The charts run from April through March of the following calendar year because the 'long rains' season begins in April.

On the following page, you will find two examples of the graphs provided, with the remainder found in Appendix W-3. The first, Figure 3 illustrates accumulated storage for the total roof area in an average rainfall year and accumulated current essential consumption demands. The second graph, Figure 4, illustrates accumulated storage for the current roof area available for collection in a low rainfall year and accumulated projected essential consumption demands.

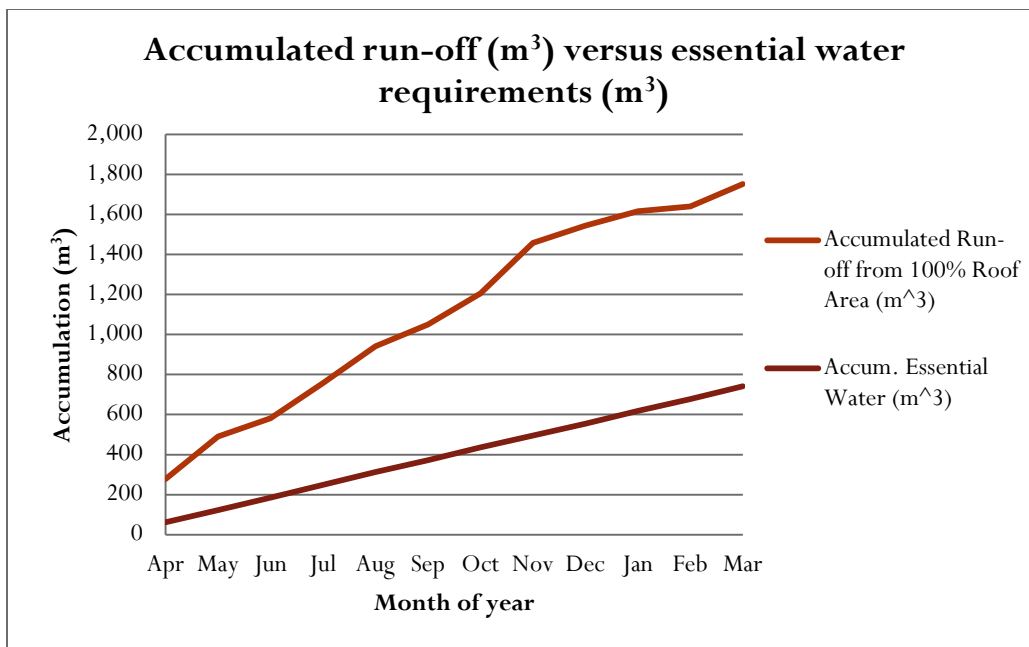


FIGURE 3: ACCUMULATED RUNOFF (M3) FROM ENTIRE ROOF AREA AND ESSENTIAL WATER REQUIRED (M3) FOR CURRENT POPULATION

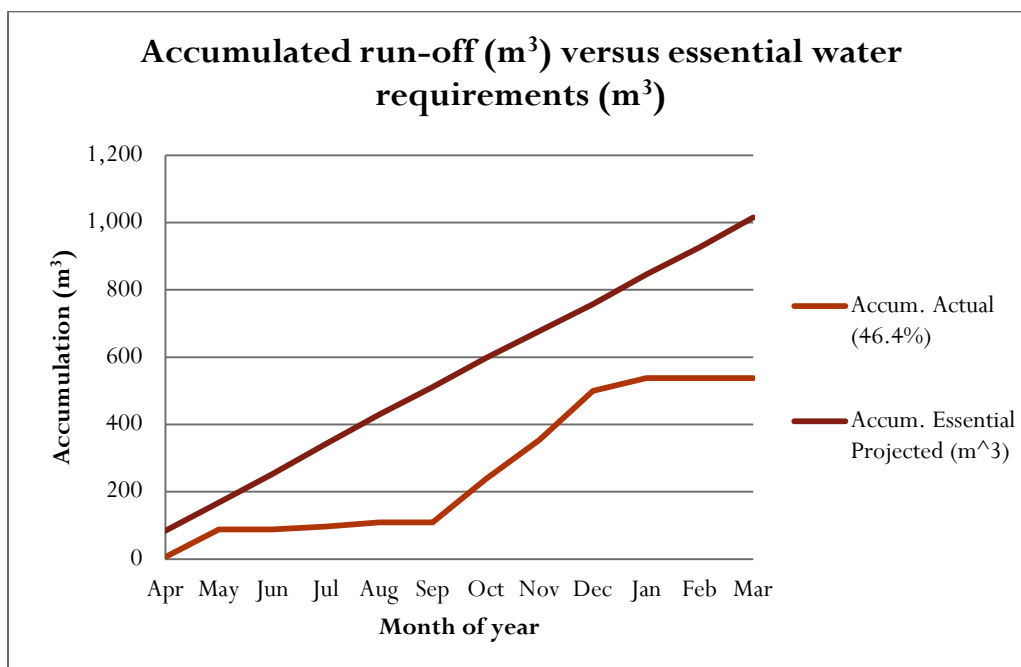


FIGURE 4: ACCUMULATED RUNOFF (M3) FROM CURRENT ROOF AREA CONVERTED TO CAPTURE WATER AND ESSENTIAL WATER REQUIRED (M3) FOR PROJECTED FUTURE POPULATION

### Water collection scenarios

Rooftop rainwater collection and storage estimates were calculated for over 60 scenarios to account for a wide range of factors. A comprehensive list of scenarios and their results are included in Appendix W-4.

Scenarios were broken into two categories, the first based on current storage capacity and the second based on the potential expansion of rainwater storage capacity, with each scenario run based on current population levels and projected population growth. Each scenario has its own assumptions, but there are several general assumptions that went into the calculations.

- Essential water required is eight lcd.
- Current and projected populations were calculated as explained above in ‘Accumulation graphs.’
- Roof areas were collected as explained above in ‘Roof areas.’ Total roof area for the MRC includes all major buildings, all Village houses, and the bandas, but does not include the Keller or Princeton dorms. Newer buildings, for which we did not have area values, were not included. Area measurements are in m<sup>2</sup>.
- Current tank sizes for Village houses were gathered from Mburu Tuni while visiting MRC. Tank sizes for MRC buildings were based on information from Odhiambo et al (no date) for the library, two lab buildings, administrative building, mess hall and kitchen, work shop, and Store 15, as well as the Director’s, Jenga, Administrator, Grevy (formerly GIS), and Klee houses.
- The run-off efficiency coefficient for metal roofs is 85%.
- Volume of water is measured in liters.

## Calculations

Daily rainfall (mm) for January 1, 1999 – December 31, 2009 was multiplied by the total roof area and the run-off efficiency coefficient to find the daily volume of run-off. The volume captured and missed, space remaining in the storage tank, and number of empty days relied on a series of logical arguments, the formulas for which are listed in Appendix W4.

- Run-off: This figure is simply the area of the roof in meters squared times the amount of rainfall in millimeters. The resulting figure is in liters.
- Day addition: If the run-off minus daily use is less than 0, then day addition is 0 liters; otherwise day addition is daily use minus run-off.
- Day shortfall: If the day addition is greater than 0 liters, then more rain was going into the tank than being drawn out, and the day shortfall is 0; otherwise, the day shortfall is the daily use minus run-off. This figure is independent of what is currently in the tank.
- Left over space: Leftover space shows the amount of room remaining in a tank, with a maximum value of the tank size and a minimum value of zero (i.e., the tank is completely full). If the current day addition is greater than 0 liters and if the left over space from the day before minus the current daily addition is less than 0, then the left over space is 0; otherwise, the left over space is the leftover space of the day before minus the current day addition. However, if the left over space of the day before plus the current day’s shortfall is bigger than the tank size, then the left over space equals the tank size; otherwise, it is the left over space of the day before plus the current day’s shortfall.
- Empty days: If the amount of space left in the tank was equal to the volume of the tank, then the tank was completely empty and the day was coded with a 1. If the remaining space was less than the volume of the tank, then there was some water remaining and the day was coded with a 0.
- Volume in tank: This figure shows how much water is currently in the tank and is equal to the tank size minus the left over space in the tank.

- Volume missed: If the left over space in the tank from the day before minus the current day's day addition is less than 0 liters, then some run-off could not fit in the tank, and the volume missed is the current day's addition minus the left over space from the day before; otherwise the volume missed is 0.
- Shortfall: This figure indicates whether or not there is enough volume in the tank to supply the daily use or draw. If the volume in tank is 0, then the shortfall is daily use. However, if the volume in tank minus daily use is greater than 0, then the tank can supply all of the day's demand and the shortfall is 0; otherwise, the shortfall is daily use minus the volume in tank.

The empty days over the 11-year period were summed to find the total number of empty days and divided by 11 for the average number of empty days per year. The year with the maximum number of empty days was used for the number of dry year empty days, while the year with the minimum number of empty days was used for the number of wet year empty days.

For volume missed in a wet year, the wet year was assumed to be the year with the greatest total rainfall missed. The dry year was assumed to be the year with the least total rainfall missed. The volume missed was the sum of daily volume missed over the course of that year.

## Scenarios

The following scenarios were evaluated based on current storage capacity:

- All Village houses, with only the villagers drinking the water, at current and predicted population. Roof area and tank size were based on the sum of the individual roofs and tanks in the Village.
- All MRC roofs, with only visitors drinking the water, at current and projected population. Roof area and tank sizes were based on the sum of individual roofs and tanks at the Centre and the Village that are currently equipped to catch and store rain, as explained previously. This was a total of 1973 m<sup>2</sup>.
- All MRC roofs, with villagers and visitors drinking the water, at current and predicted populations based on population growth as explained previously.
- One Village house, with only that family drinking the water, at 5 and 6.6 individuals in the house based on average family size provided by Dr. Kinnaird and projected growth.
- Each building at the Research Centre, with visitors and villagers drinking the water, at current and projected populations, with roof area and tank size as explained above.

The following scenarios were evaluated assuming expanded storage:

- All roofs, with villagers and visitors drinking the water, at current and projected populations, with one, two, three, and four additional 13,000 liter tanks. 13,000 liters was chosen because it is the mode of tank the tank volumes at the Centre.
- One Village house, with only that family drinking the water, at current and predicted population, with an additional 500 liters of storage (a 50% increase in storage).
- Each building at the Research Centre, with visitors and villagers drinking the water, at current and projected populations, with one additional tank at each building. The additional tank was assumed to be the same size as the current tank, or the largest tank connected to that building if it had different sized tanks.

## Hot water system sizing

Hot water needs were calculated for the Centre only, and the system was sized to accommodate showers in the visitors' and director's housing and gym. The assumptions are as follows:

- Hot water is needed for showers only.
- People showering at the Centre are visiting researchers, Dr. Kinnaird's family and her visitors.
- Each person will take one shower per day, at an average of eight minutes per shower.
- The ambient temperature of the unheated water is 60 degrees Fahrenheit.
- The desired water temperature is up to 115 degrees Fahrenheit.
- The shower heads will all be low-flow and generate 14 gallons of water/minute.

The calculations and conversions performed were:

- If the Centre is at full occupancy, there will be 69 daily showers, requiring 966 gallons (3,657 liters) of heated water.
- Solar insolation, or the amount of solar radiation reaching the Earth's surface, at Mpala is 6.44 kilowatt hours per meters squared per day (kWh/m<sup>2</sup>/day), found using the HOMER software.
- It takes 8.34 BTU to heat one gallon of water one degree Fahrenheit.
- There are 3412 BTU in 1 kWh.

Therefore, once determining the amount of water needed for showers per building per day at full occupancy, the estimated ambient tepid temperature of water, and the target heated temperature, the amount of energy in BTU needed to heat the water can be determined. Using the insolation estimate, the number of kWh required can be calculated. The quoted size of the panel available is 2.3 square meters (Modson, 2011). At 68% efficiency, and 6.44 kWh/m<sup>2</sup>/day insolation, the amount of energy produced each day from this panel is 10.9 kWh or 37,190.8 BTU per day (Wikipedia, n.d.). The size of the solar panels available and the amount of kWh that can be generated from each per day is used to determine the size and amount of panels needed. The total amount of hot water needed per day is also used to determine the appropriate tank sizes per building (which come in standard sizes). For this study, the 220 liter tank was determined as the ideal size. The data is displayed in Appendix W-5,

### Solar pump sizing

Our group was able to collect primary data for the depth of the water table on August 19, 2010. We have a personal video of the gentleman measuring the depth with an electric sounder (electric depth gauge). On August 19th, 2010, the water table was at 70.89 meters below ground level. This is consistent with previous measurements: Lane (2010) indicates that the water table depth was at 70.68 on June 26, 2010.

The size of the solar pump needed was determined by the graph provided by Grundfos Solar, a company out of Aarhus, Denmark (Grundfos, n.d.).

## Results and options for the future

### Rainwater catchment systems

Rainwater is the most local source of drinking water for Mpala. Before we make recommendations for any adjustments or additions to the current rainwater catchments systems, it best to take a careful accounting of what existed as of our last data collection in late 2010. This is an analysis of the MRC, where a lion's share of our data was collected, and can serve as an example to be followed for the Ranch and other offsite communities.

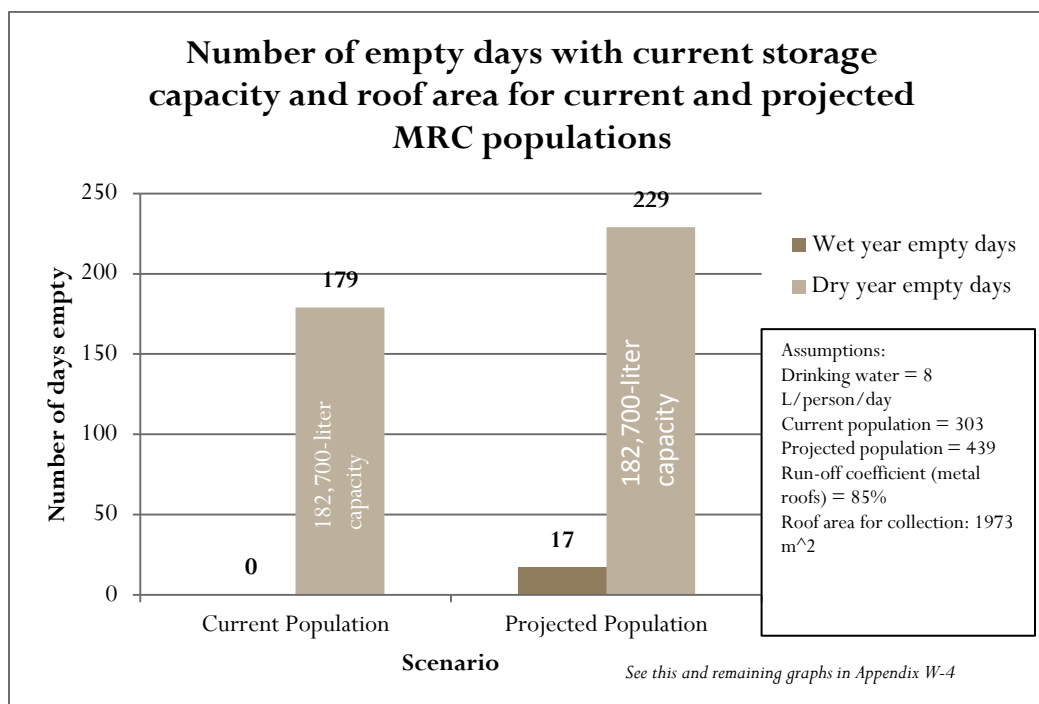


FIGURE 5: COMPARISON OF CURRENT STORAGE CAPACITY AND ROOF CATCHMENT SERVING CURRENT AND PROJECTED TOTAL MRC POPULATION

Figure 5 demonstrates how many days Mpala's current rainwater harvesting tanks will be empty under one scenario. Currently, with the tank capacity of 182,700 liters and 1973 m<sup>2</sup> of roof area equipped with rainwater catchment systems (Appendix W-2), there is sufficient storage in a wet year (above average rainfall) for the current population at the Centre to have eight liters of water per person per day. Essential water is assumed as three liters for drinking and for cooking and three liters for laundry, and two for some washing for one person each day. For the projected population of twice as many visitors and a third more Village inhabitants, for essential water use, in a wet year there are only 17 days in which there is not enough water for everyone. However, with the multitude of variables, the current system is not a sufficient one for Mpala. Such variables include the adherence to the eight liters per person per day allowance, human error in withdrawal, leaks in the system, rainfall, and the number people. In fact, ignoring all variables but rainfall, in a dry year (in this case, the modeled dry year is the rainfall amount from 1999), there would be an immense shortage as can be seen above.

With this in mind, our team looked at total potential run-off from the current roof area, the volume missed by the lack of sufficient storage to capture all of the run-off, and the potential for additional roof area and storage. The

realistic implementation and construction of storage is considered in this case, and a careful look at filtration and specific methods of safe capture and storage are examined

## Current rainfall catchment systems

In summary, to capture enough rainfall in a dry year to suffice the essential water needs of all of the people at the MRC, there would need to be approximately 1050 m<sup>2</sup> of additional roof space converted to rainwater catchments systems than what currently exists. This takes into account current storage as sufficient to catch what will run off the current roof area. That addition to the system (additional roofs and storage) would take a lot of capital investment and resources. As is laid out in the cost section of this report, to add roof catchment systems at each Village home (~45 at 22m<sup>2</sup> on average per home), the cost would be approximately \$68,000 (approximate prices provided by Mburu Tunj). Another ideal alternative is to optimize the current roof area for catchment in a wet year, and in doing so properly preparing for a dry year, by adding substantial storage. The following is a look at this possibility.

As you can see in Figure 6, the total accumulated run-off potential at Mpala during a wet year with the current roof catchment systems in place is over 1.4 million liters or 1400 cubic meters. Accumulated demand over a year for essential water is only around 800,000 liters or 800 cubic meters. That would provide an opportunity to store the excess 600 cubic meters for a dry year.

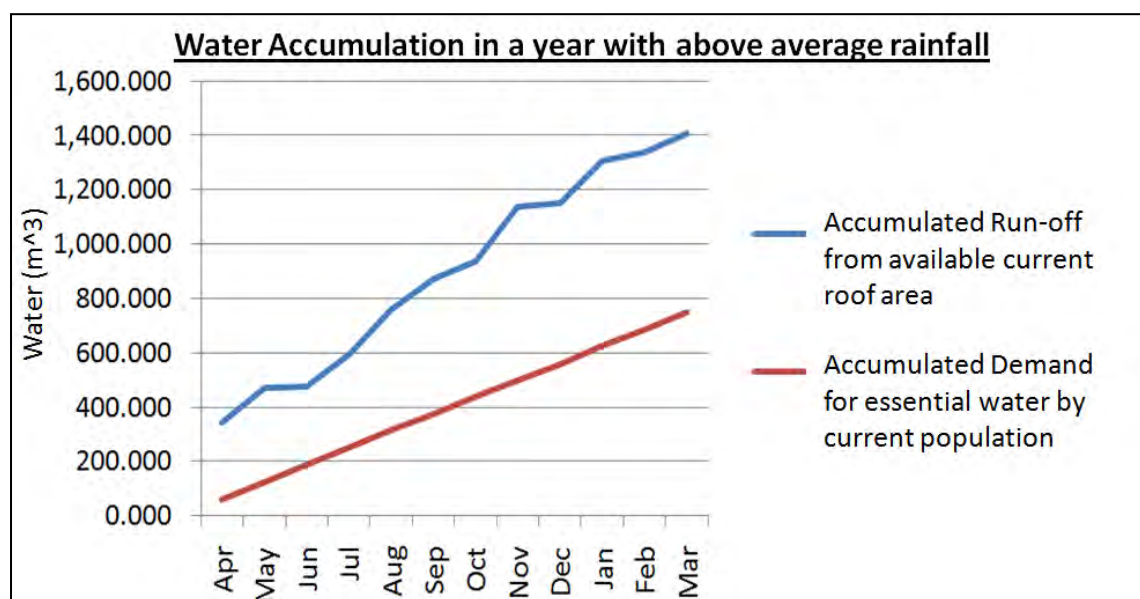


FIGURE 6: ACCUMULATED WATER RUNOFF IN A WET YEAR (M<sup>3</sup>) FROM CURRENT CONVERTED ROOF AREA VERSUS ACCUMULATED DEMAND (M<sup>3</sup>) BY CURRENT POPULATION

Figure 7 (below) is an example of what the gap between supply and demand may be during a typical dry year at Mpala.

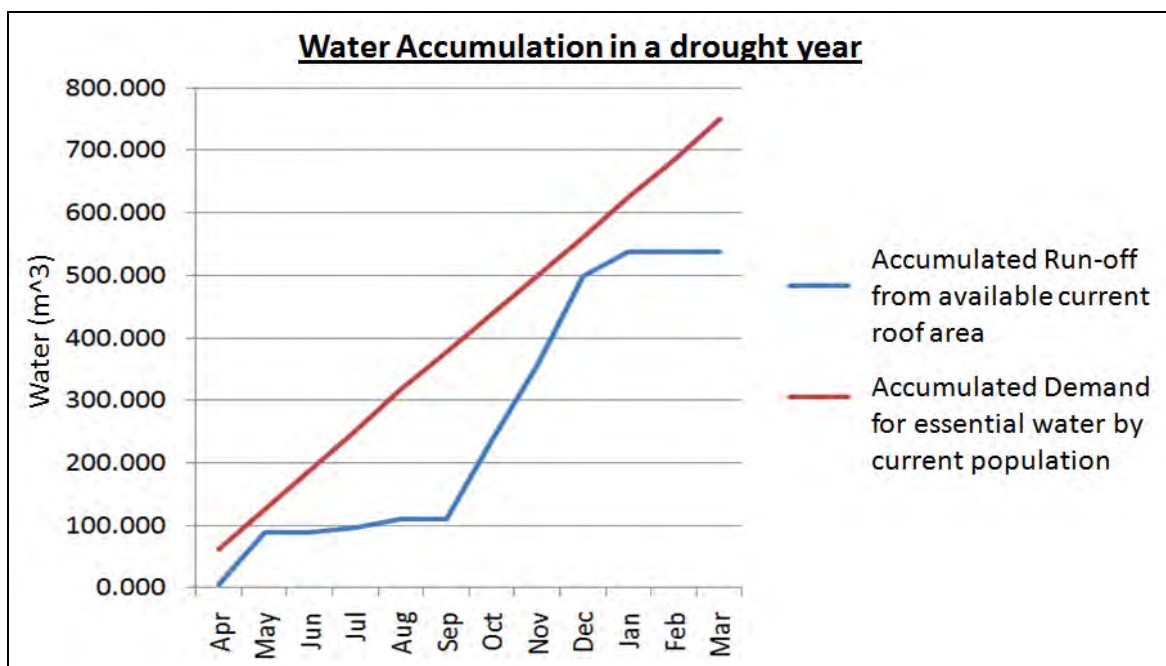


FIGURE 7: ACCUMULATED WATER RUNOFF IN A DROUGHT YEAR (M3) FROM CURRENT CONVERTED ROOF AREA VERSUS ACCUMULATED DEMAND (M3) BY CURRENT POPULATION

Two challenges are illustrated here – the 200,000 liter or 200 m3 discrepancy between what is demanded and what can be supplied and the variability of the supply throughout the year.

### Potential solutions

The solution we recommend, therefore, is to create enough storage so that during a wet year, back up or safety stock can be stored away for the shortage during one or two dry seasons because droughts can last years at a time, as the folks at Mpala know too well.

The analysis was based on several assumptions, outlined in the methodology section. Briefly reviewed here, it is assumed that the current population at the MRC is approximately 303 people. This is a generous estimate, as the visitor population is based upon the bednight count of a typically busy month. However, the visitors currently make up approximately 20% of the total, while Village inhabitants make up the remaining 80%. Another assumption is that with rainwater storage use rate of eight liters per day per person, there is another source of water to supplement the remaining needs, which can be minimized by low-flow fixtures and proper education on water conservation (as described later in this report).

The following table (Table 3) is a detailed look at what the current storage could have provided for the current population at Mpala had rain been exactly the rain measured from the years 1999 to 2009 at the Mpala Weather Station. This assumes storage starts empty at the start of 1999.

TABLE 3: WATER COLLECTION SCENARIO CONSIDERING ALL ROOFTOPS AT MRC AND CURRENT TOTAL POPULATION AT CENTRE AND VILLAGE (SEE APPENDIX W-4)

<b>Scenario 5: All MRC roofs current, all drink current population</b>		<b>Empty days</b>	<b>562</b>
Current tank capacity (liters)	182700	Average/year	51
Total roof area (m2)	1973	Dry year empty days	179
Average number visitors (MRC+Campsite)	64	Wet year empty days	0
Villagers	239	Volume missed (liters)	2,501,345
Personal daily use (liters)	8	Average/year	227,395
Daily use (liters)	2424	Wet year volume missed	552,362
Run-off coefficient (metal roof)	85%	Dry year volume missed	0
		Shortfall (Total liters over 11 years)	1,426,269
		Average/year	129,661
		Wet year shortfall	0
		Dry year shortfall	447,254

What this demonstrates is a shortfall of 447,254 liters in the driest of years. We recommend that Mpala prepare for the driest potential of years to insure sufficient essential water for the people of Mpala. When calculating these figures using the projected population of 446 people, the dry year shortfall over this same time frame is over 800,000 liters. (See Appendix W-4) Therefore, we will offer two storage solutions to this dilemma with both scenarios in mind.

The first step in finding the solution was to evaluate which building roof was missing the most volume (volume missed). What this means is that with the run-off from the roof as input and the regular output of daily draw for use (as a function of percentage of total storage), there is water overflowing from the current tanks and not being captured during the rainy seasons. The buildings identified as missing the most volume that could be stored in a wet year are identified in Table 4.

TABLE 4: VOLUME OF RAINWATER MISSED OR NOT CAPTURED DURING A WET YEAR DUE TO CURRENT STORAGE SIZES AVAILABLE FOR CATCHMENT

<b>Mess Hall</b>	<b>124,699 liters</b>
Jenga House	92,336 liters
Admin Block	68,181 liters
NSF Lab	63,919 liters
Director's House	59,857 liters
GIS House	49,695 liters
Klee House	49,695 liters
Library	23,749 liters
Small kitchen	37,733 liters
Admin House	31,875 liters
<b>TOTAL</b>	<b>601,739 liters</b>

It is important to keep in mind that this scenario prepares for the driest of years with the wettest of years. With climate change, these extremes may come more often, but on average historically, they come approximately every ten years.

The above scenario calls for an additional 600,000 liters of storage around Mpala. Currently there is approximately 182,700 liters of storage at the Centre plus a few thousand more observed but not documented at the Village homes. There are two solutions (or a hybrid of the two) that we have evaluated. One possibility is building above ground tanks that will add to some of the current roof catchment systems and add new catchment and storage systems throughout the Centre Village. The other is to direct the total volume missed from the current catchment systems to a common underground storage tank, locally positioned for efficient store and retrieval. There are benefits and limitations to both systems, including the cost aspect. This is outlined in the cost section of this paper.

Benefits to installing the above ground storage tanks are as follows. First, the installation can be phased. This allows the costs to be spread out over time. This also allows the employees of the Centre to learn how to properly manage the system without being overwhelmed with the total capacity that will be added eventually. Another benefit is maintenance. Above ground storage is easier to maintain in that problems can be easily identified by sight. In addition, if one tank requires maintenance, the remainder of the supply in other tanks is still available and usable. There are also several benefits to having new storage throughout the Centre Village. People will have control and responsibility for their own water source, which will provide them with a certain percentage of their total needs. There will also be a closer eye on the proper functioning of the systems because of the locality. Since a majority of the water needs come from the Village, expanding storage into their space is also appropriate.

The challenges to this system are that moving water around will be more challenging. Management of the water draw will be required from the different locations, it will be more tedious and take more time and resources.

The benefits of the large common storage are the simplicity of the system, the ease of adding new buildings to the system by adding piping instead of just building new storage (if the sizing of the common tank is large enough to handle more capacity), and of course, the single location for draw.

The challenges to this system are many. It will be difficult to identify a fracture or malfunctioning of the system since it is below ground and more difficult to monitor. Also, if the system is contaminated, the entire store may be contaminated, destroying the back-up supply. The final challenge is the pumping required. There will need to be a pump installed to draw the water up from the underground tank, which will require either energy or labor.

Mpala should also consider a belowground cistern for excess roof run-off or surface run-off. Underground cisterns are hostile to algae and microorganisms that require sunlight, and simple pre-entry filtration can prevent mosquito infestation (Conservation Technology, 2008). However, belowground tanks cost more than above ground tanks because they require excavation, and they require slightly more complicated upkeep because the system components are often hidden underground (Conservation Technology, 2008).

If belowground cisterns are planned, Mpala should continue to construct rectangular belowground storage from concrete; as the cistern is likely to be mostly empty periodically during dry periods, plastic storage containers might collapse under the weight of the ground (Conservation Technology, 2008). Cylindrical fiberglass tanks can be as large as 20,000 gallons (~75,700 liters) and are as sturdy as concrete cisterns (Conservation Technology, 2008). These would be appropriate for belowground tanks adjacent to buildings. A tank that is 12 x 12 x 2 meters could hold over 270,000 liters of water. If the water is intended for human consumption, it will require additional purification and filtration as described in the filtration section, below.

## Future considerations

The options described above, we believe, manage current demand. Dr. Kinnaird requested that the Mpala Masters project team consider twice the visitor population and with that an estimated 33% more employees will be required. Currently, if it is determined that current roof catchment capacity meets the roof-to-person ratio required for adequate essential water availability, approximately 1973m<sup>2</sup>/303 or 6.51m<sup>2</sup>, then an additional 150 or so people at Mpala would require approximately 1000 m<sup>2</sup> of new roof catchment area. Again, this is a generous number since the number of current visitors is the bednight count of the busiest month. However, this is only for essential drinking water supply, and therefore, human error, abuse of this water or the desire to utilize roof rain water catchment for additional water uses could change the figures in this study.

While it is likely new buildings will need to be constructed to cater to the new visitors, and the current roof area is not all constructed currently for catchment, it is possible to expand the catchment roof area to the necessary amount. The next challenge would then be to provide each building with adequate storage – the more challenging part of this issue.

## Filtration systems

A rainwater harvesting (RWH) system is comprised of six general components: a catchment area or surface, such as a roof; gutters or pipes as a conveyance system from the catchment area to the storage tank; a roof washer, to filter major contaminants; a storage container; a method for distributing the water from the tank; and a process of purification, if the water is intended for human consumption (Kinkade-Levario, 2007). For human consumption, filtration and purification measures should occur during each of these stages. In order to make recommendations to Mpala, it might be best to approach the RWH system comprehensively and systematically.

## Catchment area

The best way to improve the efficiency of rainwater harvesting (RWH) systems is to ensure that the components are properly operated and maintained (Texas Water Development Board, 2005). While RWH can help Mpala move away from its reliance on borehole water pumped by the diesel generator, MRC and MRL must be conscientious of the effort required to keep the system functioning correctly.

One of the cheapest and easiest ways for Mpala to increase the efficiency of their rooftop water harvesting system would be to drive birds and other animals away from the rooftops. These animals reduce the efficiency of the rooftops as a collection surface by scratching at and roughing up the surface of the roofing material (a smoother surface collects rain more efficiently), and their dropping also contain acids which degrade the roofing and diminish the lifetime of the roof. This is already apparent at Mpala on buildings like the Mess Hall, where the roof has been seriously degraded in parts (Figure 8, below). Additionally, their droppings can contaminate the water that enters the storage tanks with any number of bird-carried diseases, which restricts the amount of usable water collected at Mpala (Steed, 2008). The addition of bird and animal deterrents to the roofs would thus help to meet the objective of clean water collection system at Mpala.



FIGURE 8: MESS HALL ROOF, SHOWING DEGRADATION AS A RESULT OF ANIMAL ACTIVITY. PHOTO BY AJAY VARADHARAJAN.

Bird deterrents take a number of forms: audio deterrents, such as speakers which play noises of birds in distress or predators to scare birds away; visual deterrents, such as plastic owls; taste deterrents, such as foul-tasting sprays to deter animals from chewing on the building; and physical barriers, such as ‘bird spikes,’ which prevent birds from nesting in gutters or on small surfaces (Zemsky, 2010).

Mpala should likely only consider the first two of these types of deterrents on a large scale. Because the water in the storage tanks is intended for human consumption, adding a foul taste to the run-off is undesirable. Additionally, taste deterrents are designed to prevent animals like woodpeckers or squirrels from burrowing into wood surfaces, which is not the primary concern for Mpala. Physical barriers are designed for small areas, like on top of an air conditioning system or the ledge of a building, whereas the birds at Mpala congregate all along the rooftops. Covering the entire rooftop in bird spikes would likely be cost-prohibitive and aesthetically undesirable. For these reasons, we have only considered audio and visual deterrents in this report. However, Mpala should consider bird spikes on gutter areas where birds have been known to nest, such as on the NSF lab roof, as seen in Figure 9.



FIGURE 9: BIRDS' NESTS ON NSF LAB GUTTERS. PHOTO BY MELISSA ANTOKAL.

The roofing material also plays a role in the efficiency of collection. A general estimate is that roofs have approximately 70-90% efficiency (i.e., 10-30% of rain that falls on the roof is lost to evaporation, splashing, or other factors) (Libba, "How much water," no date). Metal roofs are among the most efficient at conveying water. Regularly cleaning the roof can increase the efficiency of water run-off, because water will cling to or splash off of debris on a dirty roof, rather than flowing into the gutters (Spratt, 2007).

### Conveyance system

Gutters and downspouts direct rain from the roof to cisterns or storage tanks (Kinkade-Levarios, 2007). Gutters are cheaper than new roofing, and Mpala should consider maximizing capture from each building by guttering those that are only partially guttered right now, such as the Administration Building and the Director's House (Figure 10 below).



FIGURE 10: ADMINISTRATION BUILDING DURING A RAINSTORM, SHOWING LOST RUNOFF DUE TO INSUFFICIENT CONVEYANCE. PHOTO BY AJAY VARADHARAJAN.

The gutters and downspouts should be regularly cleaned and inspected for clogs or damage (Meganck, Rast, & Rodgers, 1997). Additionally, having a screen over the gutter can help keep out large debris like leaves and twigs. Figure 10 [above] demonstrates how gutter screens could also help prevent animals from finding a place to live.

It should be noted that, like all parts of an effective RWH system, gutter screens must also be periodically cleaned to prevent clogging and to prevent the buildup of microorganisms in the dark, moist environment below blocked leaves (Pratt, 2005). However, gutter and spout screens are an inexpensive way to improve the quality of water entering the tanks, which reduces the degree of filtering required to make the water potable. As one author states, “Removing materials before they enter the system is far easier and less expensive than dealing with them afterwards” (Pushard, 2010).

### Roof washer and first flush device

Between rain events, dust, debris, and other contaminants can build up on a roof, and may then be washed into the storage tank when it rains. For the proper and successful operation of an RWH system, the Organization of American States (OAS) recommends that the first 10 minutes of rainfall after a dry spell be diverted away from the storage tank (Meganck, Rast, & Rodgers, 1997). This “first flush” (or “foul flush”) allows rain to wash away contaminants that have accumulated on the roof during the dry period so that the water entering the tank is relatively clean. A good guideline for the amount of water that should be flushed is .05 mm/m<sup>2</sup> of rooftop (Pratt, 2005).

Roof washers and first flush devices are designed to clean the roof and maintain the quality of the water in the tank (Pratt, 2005). A roof washing system should include a corrosion-resistant debris screen with a first flush device to divert the water away from the tank, and should be located so that maintenance and repair are easy (Pratt, 2005). Even for the largest building, this amounts to only about 14 L of water diverted per rain event, which was negligible and not included in our calculation assumptions. Because the first flush is intended to clean off debris that has accumulated during a dry period, flushing is only needed on the first day of a rainy period (Kavarana, no date).

### Storage container

As observed at Mpala, mosquito larva may seriously compromise the quality of the water stored in some of the tanks (Figure 11). Many mosquitoes can be filtered out using fine mesh screens before water enters the cistern (Libba, “Other safety,” no date). The tank should have a tight-fitting cover to prevent mosquito or other pest infestation (Meganck, Rast, & Rodgers, 1997). Water that sits stagnant for a long period of time is more likely to become contaminated with bacteria, insects, or parasites.



FIGURE 11: MOSQUITO LARVAE AND OTHER CONTAMINANTS IN SMALL TANK BY KITCHEN. PHOTO BY MELISSA ANTOKAL.

However, in the event that mosquito larvae do enter the storage tank, non-toxic larvicides can be used to kill the larvae present and prevent reproduction and further contamination (Clean Air Gardening, 2010). In-tank filtration should include some form of larvicide, such as Mosquito Dunks or Mosquito Bits. The dried B.t.i (*Bacillus thuringiensis israelensis*) bacteria in these larvicides kill mosquitoes, but are safe for other animals (Aquabarrel, 2011). The World

Health Organization (WHO) has evaluated the benefits and effects of B.t.i. and has approved it for use in drinking water “that will receive little or no further treatment” (WHO, 2009).

Giving the water in a tank time to settle following a rain allows sediments to sink to the bottom of the tank (Pushard, no date). The storage tanks should be emptied and the interior walls should be scrubbed with a chlorine solution at least annually (Meganck, Rast, & Rodgers, 1997; Pushard, no date). Between cleanings, a turbulence-calming attachment at the base of the inlet pipe can prevent remixing of sediments when additionally water flows into the tank (Kinkade-Levario, 2007). Inlet pipes should extend to near the base of the tank so that incoming rainwater can oxygenate the water in the tank; turbulence-calming devices are essentially U-shaped attachments at the end of the inlet pipe that directs water up into the middle of the tank instead of directly at the bottom (Wheeler, 2010; Conservation Technology, 2008).

## Distribution

Because fine sediments will settle at the bottom of the tank, spouts for retrieving water should be no less than six inches (15 cm) above the bottom of the tank (Kinkade-Levario, 2007). There should also be a spout near the bottom of the tank for flushing the system (Pushard, no date). Figure 12 shows that the spouts used for drawing water currently are located near the bottom of tanks.



FIGURE 12: PLUMBING SET-UP FOR SMALL WATER TANK BY KITCHEN. PHOTO BY MELISSA ANTOKAL.

Mpala should employ a floating filter to pump water from the rainwater tanks. Floating suction filters draw water from the middle of the tank, avoiding sediments on the bottom or anything that may have floated to the surface (Kavarana, no date). These filters float to just below the surface of the water and adjust as the water level rises or falls so that water is constantly drawn from the oxygen-rich middle zone (Wheeler, 2010). Floating suction filters can be purchased in sizes ranging from 1.2 mm to .3 mm (1,200 micron to 300 micron), and thus require some additional filtration prior to drinking (Crawford, 2010).

## Purification

Filtered water from rainwater harvesting systems is regarded as among the best tasting water for drinking (Skeen, 2011). Rainwater collected using the methods above is a fine source of water for irrigation or toilets, but a final step is required to ensure the water is potable: water must be filtered to remove fine sediments and disinfected to remove any remaining microorganisms. These measures should occur before the water enters the storage tank, while it is being held in the tank, and while or after it is drawn from the tank. Presently, rainwater is boiled and filtered for consumption. There are a number of additional options for filtering and sanitizing water that is intended for human consumption, ranging from ultra-fine grade mesh filters to distillation to ozone generators (Pushard, 2010; Wiman, 2009; Kinkade-Levario, 2007).

## Filtration

One of the simplest methods of filtering water is to use in-line filters (filters arranged in a series) of increasing fineness placed either on the pipe leading into the tank or the spigot from which water is drawn (Pushard, 2010). These filters are measured by the size of the openings in the mesh, in microns (1 micron is 1/1000th of a meter). A 50 micron filter can be used to eliminate sand and larger particles, followed by a 10 micron filter to eliminate smaller particles, and finally a .5-1 micron filter to remove large bacteria and microorganisms (Kinkade-Levario, 2007). Upkeep involves cleaning the coarsest filter quarterly and the finer filters annually (Pushard, 2010). Of course, the filters should be inspected regularly and cleaned earlier if necessary. In the US, these filters cost approximately \$20 each, with replacement filters costing ~\$4 each (Ersson, 2006).

An alternative to in-line filters is a sand filter. There are a number of varieties of sand filters, including 'slow sand' and 'biosand.' Sand filters utilize gravity to draw water through a series of layers of gravel and sand of different sizes (Kavarana, no date). A major drawback is that water filters through the sand layers slowly relative to other filtration methods. For a place like Mpala, where large volumes of rain fall in a short period, sand filters may not be able to accommodate all of the run-off from many of the buildings, causing excessive overflows (Kavarana, no date). For the smaller roofs, a sand filter like VARUN – an HDPE drum with sand and sponge layers to filter the water – would likely be able to handle the volume of rainfall (Kavarana, no date). The VARUN filter was designed by an Indian water harvesting expert and has proven to be a viable option for small-scale filtration in developing countries, and costs approximately \$50 USD.

An activated charcoal filter can remove particles that impact the taste and odor of water, such as chlorine, but generally do not remove harmful bacteria or cysts (Chiras, 2001). Charcoal filters are made of minute clusters of carbon atoms that are treated to strongly attract particles that pass through (Waite, 2010). Consequently, chemicals and bacteria can build up on the particle surfaces. The charcoal filter should be cleaned and replaced regularly, at least as often as recommended by the manufacturer (Kinkade-Levario, 2007). Because activated charcoal particles are primarily designed to improve the taste and odor of water by removing suspended minerals and chemicals, and because they are less effective at removing microorganisms from the water, they are not recommended for treating the rainwater which has few dissolved chemicals or minerals. Activated charcoal filters are generally located at the

point of use, i.e. the tap on the tank from which water is drawn or in a separate smaller tank or jug in the kitchen (Kinkade-Levario, 2007).

Reverse osmosis (RO) is a form of membrane filtration, which works by passing water from through a semi-permeable membrane (Kinkade-Levario, 2007). However, RO filters produce wastewater with a high concentration of contaminants which then has to be discarded or processed (Pushard, 2010). One suggestion is that if an RO filter is used, the wastewater be used as grey water for irrigation or toilets so that it is not wasted (Pushard, 2010). Like charcoal filters, RO filters are placed at the point of use. This system is very costly, however, and currently in use at Mpala. Because of the financial burden, RO is not recommended.

## Disinfection

Water disinfection prior to consumption can take a number of forms, from the very low-tech to highly sophisticated. Simple options include boiling or chlorinating the water, while more complicated technologies can include ozonation and exposing the water to UV radiation (Jagadeesh, 2006). Currently, rainwater at Mpala is boiled prior to use, but heating the water for one hour at 50-60°C (122-144°F) can effectively kill 99.9% of bacteria and microorganisms in the water (Jagadeesh, 2006).

The most common mode of chemically sanitizing water is chlorinization. To effectively sanitize rainwater, a ratio of 2.3 ounces of household bleach to 1000 gallons water, or approximately ~.02 milliliters per 1000 liters (Pushard, no date). However, chlorinization is not recommended because it can easily combine with organic matter to create noxious fumes (Pushard, no date). Additionally, water treated with chlorine usually requires additional filtration to remove unpleasant taste and odor.

Another method of sanitizing water is through ultraviolet (UV) light. UV light attacks the DNA of microorganisms so that they cannot function or reproduce (Wiman, 2009). UV sanitation can destroy 99.9% of harmful microorganisms without requiring added chemicals as in chlorinization. UV sanitation is best “where chlorine-free, de-ionized, and/or carbon filtered water are extensively employed. Unattended carbon filters and ion-exchange tanks act as incubators for bacteria accumulation” (Mone, 2001). Because UV purification doesn’t provide residual disinfectant properties (i.e., when the light is turned off, microorganisms can colonize the tank again), following proper management protocols is essential to the effectiveness of a UV system (Wiman, 2009).

In order for UV purification to be effective, particulates larger than 50 microns must first be filtered out (Pushard, no date). If the water is not filtered properly, shadows of microorganisms or suspended solids will prevent the UV light from destroying all of the microorganisms (Pushard, no date). Ideally, the purification system should be expandable, have a window for visual monitoring, and have a single lamp per chamber (Mone, 2001). The glass enclosing the UV bulb should be cleaned periodically, as cloudy glass will block UV rays, and the bulbs should be replaced annually (Pushard, no date). If Mpala chooses to employ UV on a broad scale, they should invest in inexpensive alarms that warn when the bulb needs replacing and bulbs that automatically clean themselves (Pushard, no date).

Adding an ozonation generator into the tank or cistern can disinfect water through the process of ozonation. An ozone generator produces O<sub>3</sub>, a highly unstable molecule that is strongly oxidizing (Wiman, 2009). This oxidation causes contaminants like iron, sulfur, and manganese to precipitate out, effectively eliminating these minerals from the rainwater (Wiman, 2009). Pure oxygen is created as a byproduct, which oxygenates the water and creates an aerobic environment that is hostile to most waterborne organisms, including viruses, algae, fungus, mold, and yeast (Wiman, 2009).

Boiling and distillation are two popular forms of sanitation, and boiling is what is employed by Mpala at present. Boiling is very effective at killing microorganisms, but requires energy inputs to heat the water and additional filtration afterwards. Distillation uses the sun's energy to heat water which then condenses on a glass plate and runs into a clean storage tank, which both sanitizes and filters water, but requires a large area and causes water losses of ~5-10% through evaporation (Pushard, no date).

## Filtration system recommendations

We recommend that Mpala maximize its ability to use for consumption the water presently captured before building additional storage or expanding rooftop areas. This could be accomplished very easily and with very little modification to the current system by adding an audio or visual deterrent to keep birds and other animals off of the roofs, adding gutter screens, putting B.t.i pellets into the storage tanks to kill mosquito larvae, and regularly flushing the tanks to remove sediments.

An ideal system, which Mpala should consider as they add additional systems and replace their present system, would include bird deterrents and gutters screens as mentioned above, but would also include a first-flush design to remove the dirtiest water prior to entering the tank. It should include in-line filters to remove particles greater than 50 microns and be sanitized with a UV water purifier. The inlet pipe should include a water-calming attachment to prevent remixing of sediments, and a pipe for overflow should extend from the bottom of the tank to remove the dirtiest water first. A tap at the bottom of the tank should be used to flush the system of sediments periodically, and the tap for drawing water should be supplied by a floating filter siphon.

This ideal system might sound complex, but the majority of the parts are quite inexpensive: gutter screens are about \$3.50 USD per meter. A combined first-flush device and downspout filter costs about \$90, and mosquito control dunks will cost ~\$2.50 per tank. Floating suction filters cost approximately \$150 USD. A UV purifier is a slightly greater investment at ~\$490 USD for a kitchen-stored device (i.e., set up similar to the current RO filter), but could purify approximately 60 liters/minute without requiring any additional treatment. All pipes, including the inlet, water-calming attachment, and overflow outlet, can be simple PVC. The cost of these additional products could be easily recouped by eliminating the amount of LPG presently used to boil water for drinking and cleaning. The rest of the system could be purchased at the current price by Mpala's supplier.

With any RWH system, the users must feel ownership and should organize and establish maintenance routines for the system (Meganck, Rast, & Rodgers, 1997). Because the villagers and staff understand the water scarcity that Mpala faces, incorporating them into the upkeep of the individual harvesting structures will not only raise their feelings of accountability for their water usage, it will also establish a wide knowledge base so the system can be maintained into the future.

## Costs

### Above ground tank

To modify existing rainwater tanks to maximize storage, MRC would require 18 Mosquito Dunks per month (one per tank). At \$105 for 100, this would cost just over \$200 per year for all of the Centre's tanks, or about \$13 per tank for a year. Gutter screens cost ~\$170 to cover 50 lineal meters, which would effectively gutter one 10 x 15 m building. Flash tape, a visual bird deterrent which is tied to areas where birds congregate and wave around in the wind, costs \$3 for a 50 m length.

New tanks will cost approximately \$356 in concrete and \$234 in labor each. Prices for mosquito dunks, gutter screens, and bird deterrents are the same as above. Based on a survey of prices from the internet, a reasonable price

for gutters is \$3/meter, so guttering the above 10 x 15 m building would cost \$150. A first-flush device and downspout filter would cost approximately \$40. Assuming each tank requires a generous eight meters of PVC piping (to transmit water from the gutter to the base of the tank, and wrapping from the base of the inside of the tank, over the top of the tank, and down to the ground as an overflow outlet), additional piping would cost ~\$30 per tank. A floating suction filter costs \$40.

The final cost per tank would be \$186 to retrofit each existing tank with bird deterrents, gutter screens, and mosquito larvicide. New tanks would cost an additional \$870 (for a total of \$1056) each, including concrete, labor, plumbing, and filtration. One UV water purifier could be used to clean water for the whole Centre and costs \$555, with additional bulbs costing \$85 annually. Obviously, these costs are not entirely comprehensive: things like spigots and pipe fittings are not included, nor are potentially larger investments like a secure metal lid for the tank. However, the prices given provide a reasonable baseline that can be scaled to fit the size of the project.

If the total volume missed is to be captured with new storage, the following recommendations are made. For the Centre buildings, there need to be the equivalent of (30) 13 m<sup>3</sup> tanks at existing buildings, plus an additional (2) tanks at each Village home. This would amount to new filtering systems on each of the existing roof systems (13) at \$186 plus the 30 tanks at \$870 for a total of \$28,518. The Village home systems were quoted at approximate \$500 each plus an additional 1000-liter tank at \$111 to equal \$1611 each or \$23,031. The total estimate for adding above ground storage only is \$51,549 or 4,295,750Ksh.

### Underground tank

The costs associated with the installation of two underground tanks are as follows. The scenario of underground storage requires (2) underground tanks of approximately 225 m<sup>3</sup> located in front of the Princeton Dorm and to the northeast of the Library. These are two low points where water from the surrounding rooftops will naturally flow. Each tank will require approximately (252) 50-kg bags of cement, and approximately four masons (at 600Ksh per day) and four laborers (at 300Ksh per day) approximately three months to complete, which must include digging, framing and pouring. The labor is estimated at \$4750 or 396,000 Ksh. Piping from the building tanks (as the underground will serve as overflow) is required. This must include the labor for the trenches the pipes are to be buried in, as well as the material. The labor is estimated at 2 laborer for 10 days or \$72 (6000 Ksh). The piping is the same as mentioned for the above ground tanks, at approximately \$3/meter. The amount is estimated at about 300 meters for the total lengths from all of the local tanks to the underground storage (based on approximate distances measured on a map). The cost then would be about \$900 or 100,416 Ksh. A floating suction filter should be installed in the tank for \$150 or 12,000Ksh. In addition to the underground tank, an above ground tank from which the underground water can be transferred and more economically filtered is necessary. As above, the cost will be about \$870 plus the necessary ozone filter with a solar kit for \$12, 000 or 100,000Ksh.

The total for each tank would be approximately \$10,000 or 857,000Ksh, for a total of \$20,000 or 1,714,000Ksh. There are several small details that have not been covered. A pump for instance, will be necessary to extract the water from the underground tank. Therefore, please consider using this just as a guide for determining costs.

A tabular breakdown of costs for water storage systems can be found in Appendix W-7.

### Water saving technologies for borehole-sourced water

As the visitor capacity and employee population at Mpala increases, methods of use will have to be considered when addressing water supply, along with collection capacity. There are ways to reuse or recycle water, as well as reduce the amount of water used in specific activities. One way to reduce water use is to install low-flow fixtures in the washrooms. An EPA study showed that a person in a developed country can reduce their water use by 1,700 gallons

per year if switching from standard fixtures to low-flow fixtures (United States Environmental Protection Agency, 2009). Therefore, our group has created a table of recommended products, shown in Table 5. Local sourcing is recommended if available.

TABLE 5: WASHROOM FIXTURES, STANDARD AND LOW-FLOW RATES, COSTS AND SOURCES

Fixture	Existing flow	Reduced flow	Cost (\$)	Source
Low flow faucet	2.2 gal/min	1.5 gal/min	68	EPA: Water sense, AquaSource N/A
Faucet aerator	2.2 gal/min	1 gal/min	5.95	EarthEasy.com
Low flow dual flush toilet	3.5 gal/flush	1.28 gal/flush	253	Kohler website
Low flow showerhead	2.5 gal/min	1.5 gal/min	17	MetaEfficient.com
Timed showers	10 minute shower (avg)	8 min (timed)	82	Shower Manager

The user will not easily notice the difference when using a standard fixture or a low-flow fixture, such as the faucet aerator. Therefore, the transition to these fixtures will be more or less seamless. The shower manager, however, will be quite noticeable and therefore will require an adjustment to behavior. If a user is used to more than eight minutes to take a shower, they will have to speed up their wash habits in order to complete their bathing. Some people have noted a difference in toilet performance with a dual or low-flow product, but it will likely perform as needed.

The water used in the bathroom facilities currently come from the borehole. With the supply available unknown from this source, it is wise to reduce use from the borehole where possible. In addition, while it is ideal to source drinking water from rainwater, as a backup source, borehole water will be used. Therefore, for both of these reasons, waste of this source is a concern at Mpala, and addressing this issue with low-flow bathroom fixtures will certainly impact the use of the visitor population.

After close observation, it has been determined that the total reduction of water use that can be attributed to low-flow bathroom fixtures is approximately 14% of total use at the Mpala Research Centre location. This is working with the assumption that most fixtures at Mpala are NOT currently functioning as low-flow (specifications provided by Table 5 and Table 6). This is small percent reduction in water use from low-flow fixtures is due to the percentage of people at the Centre that utilize restrooms with such water fixtures – the Centre Manager and the visitors. The visitor population is only on average about 21% (64 out of 303) of the Centre Population, even less overall if the Ranch population is included, where the Village population is approximately 330, while the average bednight count for visitors is less than 1. In addition, only the visitors that stay at the Centre and Ranch House, and not the visitors that stay at the campsite (27 out of 303 total Centre population on average) utilize this type of facility.

Nevertheless, westerners tend to use more water on average than Africans. Therefore, it is not wasteful to spend resources on reducing their use where possible. For example, an average person will consume approximately eight liters of water per day for drinking, some bathing, cooking and clothes washing. However, when utilizing indoor taps and toilets, this number jumps to approximately 190 liters per day! That considers the addition of a long shower (approximately ten minutes) with a standard shower head, five visits to the toilet and several hand-washings/day. We

will assume here that Kenyans in rural to semi-urban settings typically use more than the standard eight liters of essential water, but far less than 190. Without requiring any behavior change other than a shower that is two minutes shorter, when installing low-flow fixtures, water use can be reduced by 90 liters per day. That is almost half of the water use. Table 7 and Table 8 show these reductions. (This is assuming the standard flows, times used and reduced flows indicated in Table 5,above).

TABLE 6: CALCULATED WATER USE PER PERSON PER BEDNIGHT IN WASHROOM FACILITIES USING CURRENT AND LOW-FLOW FIXTURES, BROKEN DOWN BY FIXTURE

<b>TAPS</b>	<b>GPM</b>	<b>Avg use in minutes/day</b>	<b>Avg Usage (gallons/bednight)</b>
Current Flow	2.2	2.5	5.5
Reduced Flow	1.5	2.5	3.75
Reduced Flow (2)*	1	2.5	2.5

<b>TOILETS</b>	<b>GPF</b>	<b>Average flushes/bednight</b>	<b>Avg Usage (gallons/bednight)</b>
Current Flow	3.5	5	17.5
Reduced Flow	1.28	5	6.4

<b>Showers</b>	<b>GPM</b>	<b>Avg shower time (minutes/day)</b>	<b>Avg Usage (gallons/bednight)</b>
Current Flow	2.5	10	25
Reduced Flow	1.75	8 (timer included)	14

TABLE 7: CALCULATED PER PERSON TOTAL WASHROOM WATER USE PER BEDNIGHT INCLUDING BOTH VISITORS AND ON-SITE EMPLOYEES USING CURRENT VERSUS LOW-FLOW FIXTURES

	<b>Per Person per Day (ex. 1)</b>	
		<b>(ex. 2)*</b>
Total Current Use from Fixtures	48.00	48.00
Total Reduced Use from Fixtures	24.15	22.9
	<b>Total/ Year (1)</b>	<b>(2)*</b>
Projected Total Bednights/ Year - Centre	18,356.00	18,356.00
Projected Total Employees days/Year- Centre**	10,000.00	10,000.00

TABLE 8: CALCULATED ANNUAL WASHROOM WATER USE USING CURRENT AND REDUCED FROM LOW FLOW FIXTURES

ANNUAL	1	2*
Visitor Current Use	881,088.00	881,088.00
Visitor Reduced Use	443,297.40	420,352.40
Annual FTE*** Current Use	54,761.90	54,761.90
Annual FTE Reduced Use	24,166.67	21,190.48
Current Use -Total (Gallons)	935,849.90	935,849.90
Reduced Use Total (Gallons)	467,464.07	441,542.88
Total Water Savings (Gallons)	468,385.84	494,307.03
Percent Savings	50%	53%

Reduced Total (liters)	1,771,689
Total Savings (liters)	1,775,182

- \* Scenario 1 replaces standard faucets with low-flow faucets, Scenario 2 replaces them with aerators resulting in larger reduction of gallons per minute flow  
 \*\* Approximately 40 employees, 5 days per week, approximately 50 weeks per year  
 \*\*\* Full Time Equivalent = 1 Bednight (168hrs/week)  
 Full Time Employees = Employees spending 40 hrs/wk at Mpala (=40hrs/168\*(FTE Usage- Showers))

The management at Mpala has indicated that they hope to receive twice as many visitors to the Centre in the future. Therefore, the installation and use of the reduced flow fixtures are even more urgent and necessary to control the amount of water used. Examples of the types of fixtures that can reduce the flow, and therefore the amount of water used, are faucets, showerheads, and dual-flush toilets. A shower time managing product may also be installed. The best faucet product is an aerator, which is low cost and reduces flow to about 1 gallon per minute. It saves 55% more water than a standard 2.2 GPM aerator, which is up to 13,140 gallons of water annually (EarthEasy.com, 2011). A faucet aerator is also very easy to install and replace. For the shower heads, there are several products available at a wide range of prices from ~\$5.00US to \$57.00US. Low-flow showerheads can reduce flows to 1.5 gallons or 5.7 liters per minute from as much as 2.5 gallons or 9.5 liters per minute or more. The average American takes approximately ten minutes to bathe. With that figure, in addition to the time it takes for the water to become hot in the showers (approximately one minute), that is as much as 62.7 liters down that drain. However, if a shower manager is installed, which can automatically shut off the shower after five or eight minutes as programmed, as much as 17 liters of water per shower can be saved. Shower managers are far pricier than the low-flow fixtures (products at \$82.00 were found), however, and may not be cost effective.

A system of reducing water use that could be explored further is the use of grey water. Grey water is wastewater generated from domestic activities such as laundry, dishwashing, and bathing which can be recycled on-site for uses (Cross, n.d.). At the MRC, this on-site use is most likely limited to toilet water. Therefore, water used for hand washing can be reused in toilet flushing. For toilet flushing, after the dual flush option is in place, up to 24 liters per person per day can be saved from the borehole. When the Centre is at capacity, 888 liters of water per day can be saved. There are two options for implementing this type of grey water system, one of which would include a new plumbing system. The other would be a product such as the toilet lid sink by Gaiaam (2011). This product, with retail prices starting at ~\$90.00 each, has a hand washing sink above the toilet tank. This allows the toilet to be refilled

with the water used to wash the hands of the previous visitor (see product below). A future group or the managers at Mpala may want to consider this option in the future.



FIGURE 13: TOILET LID SINK. SOURCE: GAIAM WEBSITE.

Other uses indicated as safe would be for irrigation of plants that are not to be used for human consumption or for a biogas plant. The guest house located at the Ranch was landscaped with a beautiful garden containing non-native species. These plants require more water than those typically found in this savanna. Therefore, additional water is needed for irrigation. Since water availability is a substantial concern at Mpala, the best options for this garden would be to either remove all non-native, water-hungry plants or to utilize the grey water that would otherwise be disposed of. Therefore, if sink and cooking water were to be saved in a local and centralized vessel, it would be possible to use this grey water at the Ranch for irrigation of the garden.

As mentioned above, grey water can be used to produce biogas. A large amount of water is needed to produce this fuel from waste, and in a location where water is at times scarce, a grey water system would be ideal. If, say for cooking (approximately 1-2 liters per person per day) is saved, and 3 liters per person per day for laundry is saved, at the current population of 343 people that would amount to 1715 liters per day of grey water to be used for such purposes as biogas production. Please note that this does not include the estimated 2.5 gallons per hand wash that would be used for the toilet flushing if toilet sinks are installed. So there seems to be plenty of grey water to go around. The challenge remains to be the proper collection and transport of the grey water from the kitchen and laundry to the desired destinations. It is, however, possible.

### Alternative and additional water harvesting

Additional water resources are obtained by pumping from the river and through collecting surface run-off into dams. Each has unique benefits and challenges.

As for river water, M.W.B. Airy recommends that river water be pumped to a settling tank so that the majority of suspended sediments can precipitate out of the murky water (Airy, no date). Additionally, he recommends that Mpala experiments with a sedimentation tank to determine its efficacy in improving the water quality before looking into filtration and sterilization systems for the river water (Airy, no date). Current river water storage is estimated at 21,700 liters, and could potentially be sterilized with solar stills rather than boiling and filtration with ceramic candles (Airy, no date).

Tom Traexler of Rural Focus, Ltd. (the company that planned locations and designs for new dams) stated that new dams will be located north of the Mpala Ranch and will store approximately 200,000 m<sup>3</sup> of run-off for consumption at the Ranch. Although this would theoretically be more than enough to supply all water needs, estimates ignore a few important factors: evaporation, which will significantly reduce water levels in the dams during the dry months, and water quality decline as a result of sedimentation buildup and animal use of the dam, which may require additional, expensive filtering mechanisms.

One method of filtration to consider for water from the dam or storm water is the “French drain” design, which is essentially a sloping ditch lined with sand and filled with gravel (Pratt, 2005). The large pore spaces between grains of gravel allow water to flow quickly through while still keeping out large contaminants, such as twigs or small animals. The sand then acts as a fine-mesh screen, filtering out many additional contaminants. By placing a perforated pipe below the French drain, this surface water run-off could be diverted to a large storage tank. The natural sand filter would greatly increase the quality of the water being captured, while keeping the water in an underground tank would reduce evaporation and contamination by animals. Natural sand filtration has been effectively used elsewhere in Africa to clean water run-off for harvesting (O’Neill, 2010).

## Financial benefits of altering the current water system

Reducing water demand and increasing rainwater utilization can ultimately save Mpala money in two ways: first, by reducing the amount of fuel used for pumping water from the borehole, and second, by reducing the amount of LPG required by filtering water in other ways.

In 2010, diesel prices charged to Mpala averaged 86 Ksh per liter. Over the time period for which we have borehole meter readings, an average of 37,600 liters were pumped per day, for a total of 13,724,000 liters per year.

Using low-flow fixtures can reduce water consumption by 1,775,182 liters per year, or an average of 4863.5 liters per day, reducing current borehole use by 12.9%.

Making adjustments to the current storage tanks to switch to from borehole water to rainwater just for drinking water represents a reduction in borehole pumping of 276488 liters per year – 2% of current pumping.

Additional above ground storage of 390,000 liters could reduce pumping by at least that much, which represents 2.8% of current pumping. Alternatively, installing two underground tanks to provide 450,000 liters total would reduce pumping by 3.3%. Total reduction in borehole use is summarized in Table 9.

TABLE 9: BOREHOLE PUMPING REDUCTIONS

Modification	Savings – liters	Savings - %
Low-flow fixtures	1,775,182	12.9
Maximize current RWH	276,488	2
Add'l belowground storage	450,000	3.3
Total	2,501,670	18.2

Diesel consumption for a Grundfos water pump is estimated at 120 liters per month, or 1440 liters per year (Bernt Lorentz, 2008). This equates to 123,840 Ksh. Reducing borehole pumping by 18.2%, then, could save 22,539 Ksh annually (\$267 USD).

Switching to a different method of purifying water, even if just for one tank from which all water would be drawn, would have additional benefits. Presently, the MRC disinfects and purifies its water by first boiling it in the kitchen, and then using ceramic candles. The kitchen uses LPG for cooking and boiling water. Using the calculations for sizing a hot water system (see the Methodology section), and the heating value of LPG (see the biogas sections), we were able to find the amount of LPG that could be reduced if water no longer needed to be boiled. Because of the sheer amount of water that must be boiled to become potable, alternative sanitation and filtration mechanisms could reduce usage by 163 LPG cylinders per year. At 2,121 Ksh for a 13 kg cylinder of LPG, that equates to 344,829 Ksh (\$4083 US) per year (Mugwe, 2010). The most expensive sanitation and filtration systems that we looked at (a solar-powered ozone generator) was ~\$1400. Even if not all of this LPG reduction would occur (as some would still be used for cooking or cleaning, etc), Mpala could easily recoup its investment in a high-quality filtration and sanitation system in a year.

## Behavior and education

As mentioned, water is an essential and limited resource at the Mpala Conservancy. The current and anticipated situation makes this fact all the more challenging. Therefore, in addition to finding ways to increase the collection and availability of water, this report also recommends changing the use behavior of the people at Mpala. First of all, in the long term, a more thorough evaluation of the behaviors of both the Village population and the visiting population should be conducted to understand the habits and motivations of those using the water. Below is a short summary of some potential actionable options in the meantime.

On a grand scale, Mpala Wildlife Foundation may choose to make water conservation an official policy of the Centre. By doing so, the management is making clear that careful use and monitoring of water consumption is a top priority. This will send a message to all who inhabit the Centre that wasteful behaviors are not welcome there. Very often, when an institution implements a rule, it can become a norm and eventually a value within the boundaries of that institution. In Eugene Bardach's, "A Practical Guide to Policy Analysis" (2009), there is a type of government policy that serves as an "Education and Consultation Policy." Some examples of action under these policies are to warnings of hazards and dangers, the raising of consciousness through exhortation or inspiration, providing technical assistance, upgrading skills and competencies, or changing values. This type of policy can insure participation by increasing awareness and teaching participants how to comply, even if there are those that would rather not. There are also methods of reinforcement, or reward, when those who exceed the activities required by the policy are publicly recognized and rewarded for doing so.

To remain consistent with policy, it would then be prudent to acknowledge the distinctive water requirements in the research projects that are conducted at Mpala. For example, having projects indicate the approximate level of water needed, and accordingly administering charges in proportion to that need further reinforces the policy. Therefore, tracking water use of the researchers could be a policy implemented at Mpala. The amount of the surcharge associated with water use should not necessarily be significant. Rather the presence and acknowledgment of such a policy would further communicate the values of the Centre.

In addition to implementing policy, education is key to compliance of conservation practices at Mpala. Two methods that can be used are by signage around the property and by formal education of the children in schools, the adults and the visitors.

Signage around the Centre, which currently doesn't exist, has a twofold effect. They educate those utilizing the water about the best ways to minimize their use while further reinforcing the value of conservation. The signs educate, but they also serve to constantly remind users to be aware of their water consumption. There are different types of signage. One is simply to inform. For example, signs that explain that the tap in the washroom is equipped with an aerator to reduce flow per minute are simply informative. Letting the user know that by using this fixture rather than a standard tap, they are saving 7.5 liters of water per minute, they are being educated, reminded and rewarded with praise with one sign.

The second type of signage is instructive. For example, by asking those using the taps at the storage tanks to make certain the tap is completely turned off, Mpala will save water. In addition to reminding people to behave in a certain way, it again is reinforcing the value of conservation. The signage can also educate the user by telling them how much water can be saved each hour/day/week/year if they are careful to follow the instructions correctly. This is another opportunity for intrinsic reward.

In addition to signage, a more personal and formal education can be provided. For visiting researchers, as part of the welcome and orientation to the Centre, an employee can be assigned to a short lecture or tour of the water facilities at the Centre. This allows Mpala to inform the visitors of the policy right at their arrival, drive home Mpala's value of conservation, and teach the visitors how to treat this precious resource during their visit. Most of the visitors to Mpala come from the developed world where seldom do they have to restrict their use of water. It would be responsible to educate them on the distinctions between living at home and inhabiting the sort of facility that is not connected to a centralized system to allow them unlimited resources.

While educating visitors at the Centre is an effective action, it is the Village inhabitants that live at the Centre year round and make up a large majority of the consumers at Mpala. Therefore, a similar type of education, as it pertains to their own water use would be even more impactful. For both the adults and the children, there is a wonderful resource in the World Wise Schools of the Peace Corps. The World Wise School has developed a program called 'Water in Africa,' where people are educated in the dangers of unclean water, but also in the best and most efficient use of scarce resources (Peace Corps Coverdell World Wise Schools, n.d.). This program is tailored for specific countries in Africa, including Kenya, so that it addresses local cultural issues connected with water, as well as educates people how to better use and conserve water. Narratives and photos are provided. It is a highly recommended resource. Utilizing programs such as these is an economical and impactful way of educating those at the Centre.

While policy and educating can be highly affective, providing the proper tools will further compliance. For example, one of the challenges of converting the Village inhabitants to borehole water was the properties of the water that prevented a good lathering for washing. Therefore, the people prefer and use river water to wash their clothes. There is a product called Self-Foaming Soap that requires very little water to produce a good lather that would enable this group to use the borehole water to wash or to use less river water than they currently do for each washing. In the past, the Foundation has provided roof materials and catchment systems, including a tank, to catch rain water at individual homes within the Village. Providing these type of tools enables people to comply with the policy, but also sends the message that they will be supported and in some cases rewarded for embracing these values.

Further research into the culture, the motivations and the habits of the people that live at and visit the Centre is recommended for future research groups at Mpala. These types of studies will allow Mpala to find the most effective ways to encourage the conservation of water in the daily lives of those at Mpala. The brief overview provided above are simply suggestions for resources and methods to consider, but should be properly vetted before implementation.

## Recommendations

### Water sustainability

The first step in water management is to reduce the amount of water used and wasted where possible. This is why our group recommends installing low-flow fixtures in all of the washrooms at the Centre. However, the visitors at the Centre make up a quarter or less of the people residing at the Centre throughout the year. The visitors use the washrooms, and therefore, while the water reduction could be as high as 4,000 liters per day, this is only a small fraction of total use (14%).

Therefore, a second step we recommend is the use of a grey water system. By 'system', that can mean it could involve a centralized collection tank connected to the plumbing throughout the entire Centre and Village sites. It could also mean something as simple as two employees collecting grey water from several smaller collection tanks throughout the site. This water can be used to reduce the strain caused by landscape irrigation at the Ranch, water used in the toilets and water that could be required for a biogas plant, if that is in the future plans for Mpala. This could reduce overall consumption at Mpala by an additional 24 liters per person per day at the Centre and at least 5.5 liters per person per day at the Village. The use per person could be moderately reduced, but the greatest impact would be on other draws from the supply, as mentioned above.

The third method of reduction recommended is through behavior change. A campaign to educate and implement policies at Mpala in the responsible use of water is the most challenging, but could be the most effective tool in conserving water.

The next step recommended is expanding the current roof rain water catchment system. The underground, centralized tanks will require less space, less capital investment and more than adequate water for the Centre and Village; however, it is less secure, as contamination can destroy the entire supply. The belowground option also leaves potential above ground space for future additional above ground storage, as well as tie-in of new buildings. The above ground option can be phased in, making less of an upfront financial impact, and spreading the risk of contamination out, so that if one tank loses its supply from contamination, the remainder is still secure. We leave it to the Mpala management to make a choice that best suits their immediate priorities.

### To future Masters Projects

There are two areas that our team has identified as wonderful candidates for further study. The first is a study of the local watershed. By understanding the size of the watershed, the composition of the land cover and soils, and the land uses, there can be an understanding of the circumstances with the supply to the Ewaso Ngiro. In addition to supply, the quality of this water could be tested to determine if the water is safe for human, cattle and wildlife consumption. The river is culturally significant to the people, but also critical to the life that it supports. This study would not only benefit those at Mpala, but also all of the other communities within the watershed.

Another project that would be of use to Mpala is a study of the water use behavior of both the visitors and full-time residents at Mpala. To understand how water is used and how it can be better conserved, the limited water supply can be stretched further and used longer.

### Water-energy nexus

At Mpala, there are several opportunities to conserve resources within the water-energy nexus. What that means in this case is solar thermal water heating and solar water pumping. This section focuses on the possibilities of these

systems at Mpala. It was not an in-depth study, but we felt this could be an additional explored area for future masters project teams.

### Solar thermal water heater

A solar thermal water system at Mpala is best accomplished as rooftop systems. This will minimize the disturbance of the land around the buildings and allow more ground surface for rainwater collection systems. With the minimized occurrence of elephant traffic due to the new fence around the Centre, the ground can also be an option for these systems.

The panels that are available come in standard sizes, according to Mpala's local supplier. The most ideal size for the panels are 2.3m<sup>2</sup> (smallest available). The tanks are at 220 liters, for adequate roof installation. The Centre will only need approximately 11 tanks at full capacity, approximately one per building, with more for the buildings that hold more guests.



FIGURE 14: SOLAR THERMAL WATER HEATING SYSTEM. IMAGE FROM UNDP GEF SMALL GRANTS PROGRAMME.

### How solar thermal will work

Solar heating is the most efficient way to heat water. Mpala is located at an ideal location for optimal insolation. Therefore, in order to save the Centre on energy costs and minimize the harmful and wasteful burning of wood, these photovoltaic systems are a fit alternative. The system is sized based upon the amount of water needed and the estimated heating amount per liter of water. The former will allow for proper tank size and the latter will allow for proper photovoltaic panel size. If each person is to take one shower each day, using a low-flow shower head for a period of eight minutes, they will use 14 gallons of water. So a building with four beds should have a tank large enough to hold 56 gallons or 212 liters of water per day. For the panel sizing, an estimation of 60 degrees Fahrenheit as an initial temperature, and a target temperature of 115 degrees Fahrenheit was found to be ideal to calculate the amount of energy needed to heat that amount of water to the desired temperature. The United States Government's Department of Housing and Urban Development has a manual for mechanical systems that recommend domestic water not exceed 120 degrees Fahrenheit (U.S. Department of Housing and Urban Development, 1985). Please see the calculations and exact system recommendations in Appendix W-5.

### Why use the system

Currently, there are two systems in place at Mpala to heat water. The first is solar flat plates, positioned on the ground, and backed-up by what is coined 'kuni boosters' or wood burning stoves. The flat plates were being destroyed on occasion by elephants that had open access to the Centre and were attracted by the salty water from the borehole that feed the washrooms at Mpala Research Centre. As a result, the kuni boosters were being used frequently. Wood for fuel is dangerous for human lungs and not ideal for the natural ecological cycles of the local environment. Therefore, burning wood is not an ideal solution. As mentioned above, the elephant interaction has been controlled by new fencing, and this result is less of a concern. Nevertheless, a new system is recommended.

### **Limitations to this system**

The challenge with solar heating, of course, is that the sun must make contact with the photovoltaic panels for a length of time each day before bringing the supply of water to its target temperature. Currently, at the Princeton dorm, a building with a solar hot water system in place, the hot water is not available for showers until approximately three o'clock in the afternoon. In this instance, behavior modification or a tolerance for cold showers is necessary for this system to be acceptable to guests.

### **Costs**


The system described in Appendix W-5 will cost approximately 1,243,000 Kenyan Shillings or \$15,289 USD. If properly installed and maintained, a PV system can last up to 20 years, however the strength of the sun close to the equator, where Mpala is located, could degrade the system at a higher rate.

### **Solar pumping**

Solar pumping is a potential solution for pumping water out of the borehole, where on average 37 cubic meters or 37,000 liters are extracted every day at Mpala. Unfortunately, the surface of the water is approximately 70 meters (or 230 feet) below the surface. Therefore, quite an extensive photovoltaic system would be required to pump up the water.

### **How photovoltaic will work**

A photovoltaic pump can be purchased in Kenya by a company headquartered in Denmark, Grundfos. This has several sizes of pumps that are designed to pump a certain amount of water per day over a maximum vertical distance. The largest pump available is a 1700 Watt system, which can pump up to 17.5 cubic meters of water 70 meters in one day. Unfortunately, that does not meet the current specifications needed to pump the current demand at Mpala. However, if Mpala replaces its drinking water with rainwater, and installs low-flow fixtures within the recommended parameters outlined in this report, the 1700 Watt system would be more than enough needed for Mpala's borehole water demand.

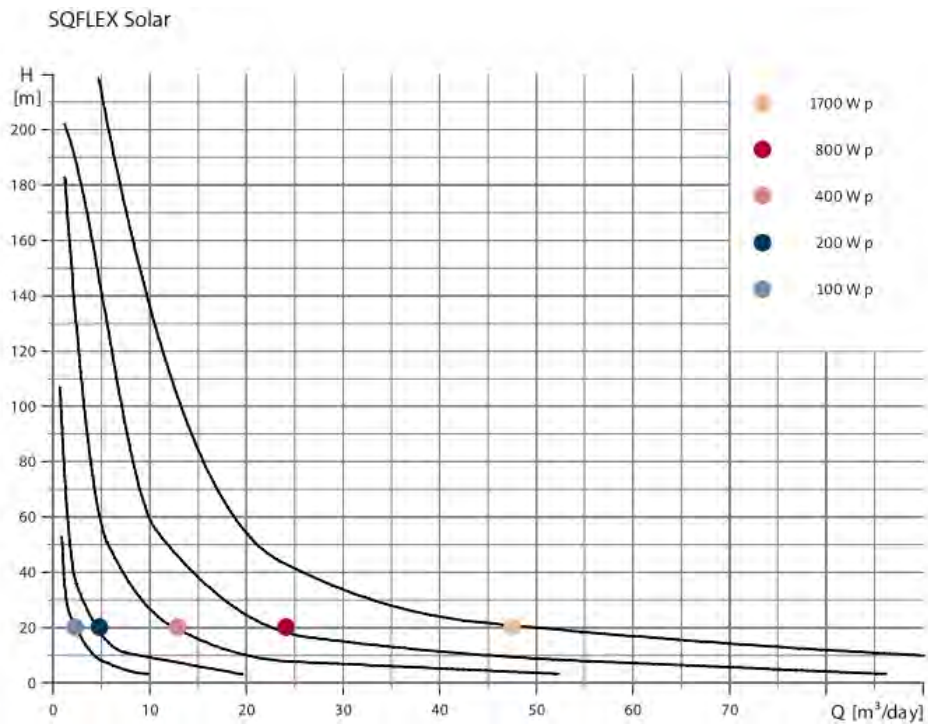

The SQFlex Solar performance curves

are based on:

- Irradiation on a tilted surface
- $H_t = 6 \text{ kWh/m}^2$  per day
- $20^\circ$  tilt angle
- Ambient temperature at  $30^\circ\text{C}$
- $20^\circ$  northern latitude
- 120V DC

FIGURE 15: GRUNDFOS SOLAR PUMP SIZING CHART. SOURCE: GRUNDFOS.COM.

### Why use the system

The current system runs purely on diesel. The pump runs for several hours per day. Therefore, fuel will be saved and pollution reduced. \$1,467US per year is spent on diesel to run the pump at the borehole. Even if the reduced consumption is considered, that is still an expenditure of \$1,200 per year. A solar pump, equipment only (not including specialized labor) can be found for a range of prices. The payback period for this type of project could range from two to six years.

## Conclusion

It is the opinion of this team, through the study of the Mpala site and the options and resources available to the Mpala Foundation, that using locally collected rainwater is one of the best sources of drinking water for those at the Centre and Centre Village. This will increase security, and reduce dependence on outside sources during a drought, as well as reduce the overall use of borehole water. In addition, replacing the current diesel pump at the borehole with a solar pump is a good choice economically as well as environmentally, furthering the goals of Mpala. These recommendations will have little to no impact on the air quality (unlike diesel that is being used now) or the water available to the surrounding watershed (the roofs of the Centre, from which rainwater will be collected, make up less than .01% of the entire land surface area of the Mpala property).

Building underground tanks to hold the rainwater that is collected from the Mpala Research Centre rooftops is the recommended method if costs are acceptable. If the project is to be phased in over time, aboveground tanks may be the best choice, however, overall more expensive.

The Mpala Foundation has expressed a desire to operate efficiently, provide as many resources to its permanent residents and guests from the land they occupy as possible, and provide an example of environmental consciousness and sustainability to the region. The Masters Project Team from the University of Michigan 2010-2011 hopes that this study of the water resource systems at Mpala will provide an added value to these efforts.

## Literature Cited

- African Conservation Foundation. (2011). *African Conservation Foundation - Kenya - Mpala Wildlife Foundation*. Accessed 03/01/2011. Retrieved from <http://www.Africanconservation.org/explorer/Kenya/471-Mpala-wildlife-foundation/view-details.html>
- Airy, M.W.B. (No date). *Report on water supplies for Mpala Research Centre and Mpala Farm*. Mbagathi, Kenya.
- Alibaba (2011). Solar Water Pumps. Retrieved from [http://www.alibaba.com/trade/search?SearchText=solar+water+pumps&Country=&IndexArea=product\\_en&fsb=y](http://www.alibaba.com/trade/search?SearchText=solar+water+pumps&Country=&IndexArea=product_en&fsb=y)
- Aquabarrel. (2011). *Mosquito control bits*. Retrieved from [http://www.aquabarrel.com/product\\_mosquito\\_control\\_bits.php](http://www.aquabarrel.com/product_mosquito_control_bits.php)
- Bardach, E. (2009). *A practical guide for policy analysis: the eightfold path to more effective problem solving* (3rd edition). Washington, DC: CQ Press.
- Bernt Lorentz GmbH & Co., KG. (2008, August). *Solar water pumps in namibia: a comparison between solar and diesel*. Retrieved from [http://www.innovativesolar.com/images/File/lorentz\\_brochure\\_namibia\\_usd\\_en%20Solar%20VS%20Diesel.pdf](http://www.innovativesolar.com/images/File/lorentz_brochure_namibia_usd_en%20Solar%20VS%20Diesel.pdf)
- Chiras, D.D. (2001). *The natural house: a complete guide to healthy, energy-efficient, environmental homes*. White River Junction, VT: Chelsea Green Publishing Company.
- Clean Air Gardening. (2010). *Summit mosquito control dunks*. Retrieved from <http://www.cleanairgardening.com/mosquito1.html>
- Conservation Technology. (2008). *Rainwater storage*. Retrieved from [http://www.conservationtechnology.com/rainwater\\_storage.html](http://www.conservationtechnology.com/rainwater_storage.html)
- Crawford, D. (2010). *Products*. Retrieved from <http://www.rainwatermanagement.com/products.php>
- Cross, M. (n.d.). *Water reuse & indoor water use*. Accessed 03/17/2011. Retrieved from [http://cas.illinoisstate.edu/sites/gmklass/?page\\_id=139](http://cas.illinoisstate.edu/sites/gmklass/?page_id=139)
- Daly, H.E. (1990). Toward some operational principles of sustainable development. *Ecological Economics*, (2), 1-6.
- Daly, Herman E. & Kenneth Townsend. (2003). *Valuing the earth: economics, ecology, ethics*. Cambridge: MIT Press.
- EarthEasy.com. (2011). *Low flow faucet aerator (2-pack) - 1.0 gpm*. Accessed 02/15/2011. Retrieved from <http://eartheasy.com/green-home/green-washroom/low-flow-faucet-aerator-2-pack-1-0-gpm>
- EPA WaterSense. (2007, September). *Faq: WaterSense labeled high-efficiency lavatory*. Accessed: 01/07/2011. Retrieved from [http://www.epa.gov/WaterSense/docs/ws\\_faq\\_faucet508.pdf](http://www.epa.gov/WaterSense/docs/ws_faq_faucet508.pdf)
- Ersson, Ole. (2006, November 14). *Rainwater harvesting and purification system*. Retrieved from <http://www.rwh.in/>
- Gaiam. (2011). *Toilet lid sink*. Accessed 02/15/2011. Retrieved from <http://www.gaiam.com/product/toilet+lid+sink.do>
- Global Ministerial Environmental Forum Initials (2004). *Rainwater harvesting: a viable option in Kenya. Proceedings of the 8th Special Session of the Governing Council/ Global ministerial Environment forum*, www.unep.org/gc/gcss-viii/Kenya%20-%20Sanitation.doc
- Goodland, R. (2002). Sustainability: human, social, economic and environmental. Beau-Boekhout (Ed.), *Encyclopedia of Global Environmental Change* (pp. 1-3). Washington, DC, World Bank: John Wiley & Sons, Ltd.
- Hopwood, B., M. Mellor, and G. O'Brien, (2005). Sustainable development: mapping different approaches. *Wiley InterScience*, (13), Retrieved from <http://www.interscience.wiley.com> doi: 10.1002/sd.244
- Jagadeesh, A. (2006). *Safe drinking for all through solar disinfection*. Retrieved from [http://www.harvesth2o.com/adobe\\_files/WaterForAllJagadeesh.pdf](http://www.harvesth2o.com/adobe_files/WaterForAllJagadeesh.pdf)
- Kalders, J. Kenya Ministry of Water Development, (1986). *Design manual for water supply in Kenya*. Nairobi: Ministry of Water Development.
- Kavarana, G. (No date). *Components of a rainwater harvesting system*. Retrieved from <http://www.rainwaterharvesting.org/urban/Components.htm>
- Kinkade-Levario, H. (2007). *Design for water: rainwater harvesting, stormwater catchment, and alternate water reuse*. BC, Canada: New Society Publishers.
- Kinnaird, M. (2010, August 14). Personal interview.

- Kohler Worldwide, (n.d.). *Cimarron® comfort height® elongated 1.28 gpf toilet with class six® technology - k-3609*. Accessed: 01/07/2011. Retrieved from [http://www.us.kohler.com/onlinecatalog/detail.jsp?from=thumb&frm=&module=Toilets&item=13362502&prod\\_num=3609&ion=2&category=13](http://www.us.kohler.com/onlinecatalog/detail.jsp?from=thumb&frm=&module=Toilets&item=13362502&prod_num=3609&ion=2&category=13)
- Laikipia Wildlife Forum. (2011). *Laikipia wildlife forum*. Accessed on 03/01/2011. Retrieved from <http://www.Laikipia.org/>
- Lane, I.M. (2010). Draft hydrogeological assessment study report; groundwater conditions in the southern part of Mpala Ranch, Laikipia North District . Lang'ata, Laikipia, Kenya: Aquasearch Limited.
- Lea, M. (2008). Biological sand filters: low-cost bioremediation technique for production of clean drinking water. *Current Protocols in Microbiology*, 9, 1G1-28.
- Leting, J. (2010). Personal interview.
- Libba, G.C. (No date). *How much water can you collect in rain barrels during a rainfall*. Retrieved from <http://www.rainbarrelguide.com/how-much-water-can-you-collect-in-rain-barrels-during-a-rainfall/>
- Libba, G.C. (No date). *Other safety and maintenance concerns*. Retrieved from <http://www.rainbarrelguide.com/safety-maintenance/>
- Littleton, M. (2010, August 17). Personal interview.
- Mayo Clinic. (2007, August 13). How Much Water Should You Drink? It Depends. *ScienceDaily*. Retrieved April 3, 2011, from <http://www.sciencedaily.com/releases/2007/08/070811225126.htm>
- Mboyah, D. (2008). Climate change wreaks havoc to pastoralist communities in Kenya. *Africa Science News Service*, Accessed: 01/21/2011. Retrieved from [http://Africasciencenews.org/asns/index.php?option=com\\_content&task=view&id=567&Itemid=2](http://Africasciencenews.org/asns/index.php?option=com_content&task=view&id=567&Itemid=2)
- Meganck, R., Rast, W., & Rodgers, K.P. Organization of American States, Unit of Sustainable Development and Environment. (1997). *Source book of technologies for freshwater augmentation in Latin America and the Caribbean* Osaka/Shiga, Japan: UNEP International Environmental Technology Centre. Retrieved from <http://www.oas.org/dsd/publications/unit/oea59e/ch10.htm>
- Modson, Dipi. (2011, February 2011). Personal communication.
- Mone, J.G. (2001, August 9). *Ultraviolet water purification*. Retrieved from <http://www.cpesystems.com/data/WebSite/Processing%20Equipment%5CUV%20Sterilization%5CArticle1.pdf>
- Mpala Research Centre and Wildlife Foundation. (2010). *Facilities*. Retrieved from <http://Mpala.org/Facilities.php>
- Mpala Wildlife Foundation. (2009, November 25). *Mpala Research Centre objectives*. Accessed March 25, 2010. Retrieved from <http://mpala.org/researchctr/objectives.html>
- Mukabana, J. (2010). Climate change, disaster management and environmental governance in Kenya: policy options and implementations by different institutions. *Proceedings of the 6th yadsti annual conference & exhibition* <http://www.yadsti.org/gallery&downloads.php>.
- O'Neill, J. (2010, September 15). *Villages awash in clean water thanks to group*. Retrieved from <http://www.redding.com/news/2010/sep/15/villages-awash-in-clean-water-thanks-to-group/>
- Peace Corps Coverdell World Wise Schools. (n.d.). *Water in Africa*. Accessed 03/17/2011. Retrieved from <http://www.peacecorps.gov/wws/educators/enrichment/Africa/about/index.html>
- Pratt, A. (2005, July 8). *First flush: what is first flush?*. Retrieved from <http://www.rain-barrel.net/first-flush.html>
- Pushard, D. (2010, March 28). *First flush devices - a review*. Retrieved from [http://www.harvesth2o.com/first\\_flush.shtml](http://www.harvesth2o.com/first_flush.shtml)
- Pushard, D. (No date). *Potable rainwater: filtration and purification*. Retrieved from [http://www.harvesth2o.com/filtration\\_purification.shtml](http://www.harvesth2o.com/filtration_purification.shtml)
- Schmidt, T.C. (2006). Fluoride's effect on bone and related factors. *Illuminae*, Accessed 03/15/2011. Retrieved from <http://www.a-zholisticdentistry.com/illuminae/fluoride.htm>;
- Skeen, M. (2011, March 3). Rainwater Management Solutions recognized in international drinking water competition [Web log message]. Retrieved from <http://blogs.roanoke.com/ticker/2011/03/04/rainwater-management-solutions-recognized-in-international-drinking-water-competition/>
- Spratt, S. (2007, January). *Making rain gutters work!*. Retrieved from <http://www.harvesth2o.com/raingutters.shtml>

- Steed, S. (2008, June 30). *Rid the roof of birds*. Retrieved from <http://ezinearticles.com/?Rid-the-Roof-of-Birds&id=1281605>
- Tarsi, D. (2007, August 13). *Building a small slow sand water filter for individual use*. Retrieved from [http://www.shared-source-initiative.com/biosand\\_filter/biosand.html](http://www.shared-source-initiative.com/biosand_filter/biosand.html)
- Texas Water Development Board, (2005). *The Texas manual on rainwater harvesting*. Austin, TX: Texas Water Development Board.
- Traexler, Tom. Personal Interview. 12 Aug 2010.
- Tuni, M. (2010, August 7). Personal interview.
- United States Central Intelligence Agency, (2010). *Kenya CIA - The World Factbook*. Retrieved from <https://www.cia.gov/library/publications/the-world-factbook/geos/ke.html>
- United States Environmental Protection Agency, (2009). *WaterSense water savings calculator* Retrieved from [http://www.epa.gov/WaterSense/calculate\\_your\\_water\\_savings.html](http://www.epa.gov/WaterSense/calculate_your_water_savings.html).
- U.S. Department of Housing and Urban Development. (1985). *Public and Indian housing handbook, Chapter 6: mechanical systems*. Retrieved from <http://www.hud.gov/offices/adm/hudclips/handbooks/pihh/74852/74852c6PIHH.pdf>
- United States Green Building Council, . (2009). *Leed reference guide for green building design and construction*. Retrieved from [http://assets.ecorussia.info/assets/paragraph\\_attaches/5564/paragraph\\_media\\_5564\\_original.pdf?1269257430](http://assets.ecorussia.info/assets/paragraph_attaches/5564/paragraph_media_5564_original.pdf?1269257430)
- Wikipedia. (n.d.). *Solar water heating*. Accessed: 1/15/2011. Retrieved from [http://en.wikipedia.org/wiki/Solar\\_water\\_heating](http://en.wikipedia.org/wiki/Solar_water_heating)
- Waite, M. (2010). *Sustainable water resources in the built environment*. London, UK: IWA Publishing.
- Wheeler, J. (2010). *Four steps to high quality harvested rainwater: a non-mechanical process*. Retrieved from <http://www.rainfilters.com/index.html>
- Wiman, S. (2009, April 21). Water purification technology: what is "green" & what is not. *Sustainable Santa Fe Guide*, Retrieved from <http://www.sustainablesantafeguide.com/2009/117.html>
- World Health Organization, (2009). *Bacillus thuringiensis israelensis (Bti) in drinking water* Geneva, Switzerland: WHO Document Production Services. Retrieved from [http://www.who.int/water\\_sanitation\\_health/gdwqrevision/RevisedFourthEditionBacillusthuringiensis\\_Bti\\_July272009\\_2.pdf](http://www.who.int/water_sanitation_health/gdwqrevision/RevisedFourthEditionBacillusthuringiensis_Bti_July272009_2.pdf)
- Yurco, Kayla. Personal communication. 23 March 2011.
- Zemsky, M. (2010, June 14). *Deterring birds: protecting your garden and home from messy birds*. Retrieved from [http://gardening.about.com/od/gardenproblems/a/Deterring\\_Birds.htm](http://gardening.about.com/od/gardenproblems/a/Deterring_Birds.htm)

## Appendix W-1: Borehole meter Readings at Main (primary), Ranch & Centre borehole (secondary) (August – December 2010)

	Ranch House (m <sup>3</sup> )	Ranch difference	MRC (m <sup>3</sup> )	MRC difference	Borehole (m <sup>3</sup> )	Borehole difference
10.08.2006			6031			
11.08.2007						
12.08.2007						
13.08.2008			6083			
14.08.2008	52		6107	23.75	25	
15.08.2009	55	3			44	19.38
16.08.2009						
17.08.2010			6196			
18.08.2010					217	
19.08.2010	110		6221		254	37
20.08.2010			6247	26	270	16
21.08.2010	113		6279	32	287	17
22.08.2010					341	54
23.08.2010					380	39
24.08.2010					401	21
25.08.2010					417	16
26.08.2010					447	30
27.08.2010					469	22
28.08.2010					487	18
29.08.2010					536	49
30.08.2010					593	57
31.08.2010					630	37
01.09.2010	177		6457		680	50
02.09.2010					695	15
03.09.2010					751	56
04.09.2010					786	35
05.09.2010					876	90
06.09.2010					912	36
07.09.2010					927	15
08.09.2010					1006	79
09.09.2010					1051	45
10.09.2010					1094	43
11.09.2010					1145	51
12.09.2010					1170	25
13.09.2010					1190	20
14.09.2010					1217	27

15.09.2010					1232	15
16.09.2010					1286	54
17.09.2010					1340	54
18.09.2010					1372	32
19.09.2010					1396	24
20.09.2010					1423	27
21.09.2010					1456	33
22.09.2010					1462	6
23.09.2010					1480	18
24.09.2010					1515	35
25.09.2010					1545	30
26.09.2010					1581	36
27.09.2010					1624	43
19.10.2010	345		7431		2259	635
20.10.2010	345	0	7452	21	2285	26
21.10.2010	345	0	7469	17	2316	31
22.10.2010	345	0			2342	26
23.10.2010	346	1	7508		2374	32
24.10.2010	369	23	7524	16		
25.10.2010	369	0	7542	18	2396	
26.10.2010	369	0	7565	23	2441	45
27.10.2010	369	0	7572	7	2503	107
28.10.2010	369	0	19		2550	47
29.10.2010	369	0	35	16	2567	64
30.10.2010	370	1	52	17		
31.10.2010						
1.11.2010	370		93	41	2650	
2.11.2010	370	0	112	19	2677	27
3.11.2010	370	0	129	17	2703	26
4.11.2010	382	12	145	16	2750	47
5.11.2010	382	0	160	15	2786	36
6.11.2010	421	39	188	28	2835	49
7.11.2010	424	3	210	22	2867	32
8.11.2010	430	6	210	0	2884	17
9.11.2010	430	0	240	30	2910	26
10.11.2010	430	0	259	19	2931	21
11.11.2010	460	30	261	2	2952	21
12.11.2010	460	0	268	7	2968	16
13.11.2010	479	19	297	29	3014	46
14.11.2010	479	0	319	22	3041	27
15.11.2010	479	0	337	18	3058	17

16.11.2010	479	0	337	0	3080	22
17.11.2010	481	2	369	32	3108	28
18.11.2010	481	0	390	21	3145	37
19.11.2010	481	0	417	27	3186	41
20.11.2010	481	0	435	18	3214	28
21.11.2010	481	0	456	21	3251	37
22.11.2010	481	0	468	12	3262	11
23.11.2010	481	0	480	12	3284	22
24.11.2010	481	0	511	31	3305	21
25.11.2010	481	0	530	19	3326	21
26.11.2010	481	0	531	1	3344	18
27.11.2010	481	0	562	31	3376	32
28.11.2010	481	0	585	23	3390	14
29.11.2010	481	0	602	17	3406	16
30.11.2010	481	0	602	0	3425	19
1.12.2010	481	0	635	33	3452	27
2.12.2010	481	0	658	23	3478	26
3.12.2010	481	0	678	20	3524	46
4.12.2010	565	84	697	19	3555	31
5.12.2010	565	0	697	0	3561	6
6.12.2010	565	0	714	17	3587	26
7.12.2010	565	0	747	33	3618	31
8.12.2010	565	0	770	23	3639	21
9.12.2010	565	0	789	19	3650	11
10.12.2010	663	98	800	11	3661	11
11.12.2010	663	0	807	7	3683	22
12.12.2010	663	0	880	73	3725	42
13.12.2010	663	0	880	0	3754	29
14.12.2010	663	0	825	-55	3797	43
15.12.2010	663	0	841	16	3834	37
16.12.2010	663	0	881	40	3870	36
17.12.2010	663	0	914	33	3901	31
18.12.2010	663	0	948	34	3940	39
19.12.2010	663	0	971	23	3967	27
20.12.2010	708	45	990	19	3998	31
21.12.2010	708	0	1010	20	4034	36
22.12.2010	708	0	1028	18	4051	17
23.12.2010	708	0	1044	16	4073	22
24.12.2010	726	18	1056	12	4095	22
25.12.2010	726	0	1089	33	4123	28
26.12.2010	726	0	1110	21	4160	37

27.12.2010	726	0	1126	16	4193	33
28.12.2010	726	0			4241	48
29.12.2010	772	46				
AVERAGE DAILY		6.14		18.98		37.67
PERCENT OF TOTAL		24%		76%		

SHARE OF TOTAL BOREHOLE IF NO LOSSES	9.21	28.46
---	------	-------

MISSING/ DISCREPANCY	3.07	9.48
-------------------------	------	------

## Appendix W-2: Current buildings – roof size and water storage capabilities at MRC

Building	Roof Area (m <sup>2</sup> )	Quantity	Equipped to Catch	Current Storage Volume (liters)
Director's House	130	1	Yes	7000
Princeton Dorm	200	1	No	
Keller's Dorm		1	No	
Small Kitchen	66	1	Yes	2000
Mess Hall	286	1	Yes	16900
Store 15	65	1	Yes	14000
Admin Block	112	1	Yes	12000
McCormack Lab	175	1	Yes	39000
Library	199	1	Yes	26000
NSF Lab	175	1	Yes	13000
Jenga House	175	1	Yes	6900
GIS (Grevy) House	155	1	Yes	13000
Chris (Klee) House	155	1	Yes	13000
Admin (Wild Dog) House	90	1	Yes	6900
Heathrow House	226	1	No	
Workshop	145	1	No	
Gym	80	1	Yes	13000
Petrol Bunk	41	1	No	
Bandas (1-11)	39	11	No	
Julius's House	35	1	No	
Village House (Triplex1)	12	1	No	
Village House (Triplex2)	12	1	No	
Village House (1 Br)	19	35	No	
Village House (2 Br)	26	3	No	
Village House (1 Br plus)	30	12	No	
Storage for each house	5	52	No	

### Appendix W-3: Accumulation graphs

The following graphs were used to illustrate the discrepancy between the volume of rain run-off from different percentages of Mpala Research Centre building roof areas and current and projected human use. The purpose of accumulating the figure month after month is to show the variable run-off accumulation rate vs. the constant rate of use accumulation. It is also to show, after one calendar year, the amount of shortfall experienced due to the different roof collection area sizes and the two populations (current vs. projected). Below is the data and the process is explained in the Methodology section of this report.

### Appendix W-3a. Accumulated roof runoff and water demand under average rain conditions


Month	Average Monthly Rain (mm)	Average Monthly Rain (m)	Roof area 100% (m <sup>2</sup> )	Roof area 75% (m <sup>2</sup> )	Roof area 50% (m <sup>2</sup> )	Current Roof Area (46.4% of total)
Apr	76.709	0.077	4,255	3,191	2,128	1,973
May	58.732	0.059	4,255	3,191	2,128	1,973
Jun	25.440	0.025	4,255	3,191	2,128	1,973
Jul	48.340	0.048	4,255	3,191	2,128	1,973
Aug	50.954	0.051	4,255	3,191	2,128	1,973
Sep	30.110	0.030	4,255	3,191	2,128	1,973
Oct	42.886	0.043	4,255	3,191	2,128	1,973
Nov	69.711	0.070	4,255	3,191	2,128	1,973
Dec	23.896	0.024	4,255	3,191	2,128	1,973
Jan	19.812	0.020	4,255	3,191	2,128	1,973
Feb	6.955	0.007	4,255	3,191	2,128	1,973
Mar	30.694	0.031	4,255	3,191	2,128	1,973

Month	Volume Run-off from 100% Roof Area (m <sup>3</sup> )	Accumulated Run-off from 100% Roof Area (m <sup>3</sup> )	Volume Run-off from 75% Roof Area (m <sup>3</sup> )	Accumulated Run-off from 75% Roof Area (m <sup>3</sup> )	Volume Run-off from 50% Roof Area (m <sup>3</sup> )	Accumulated Run-off from 50% Roof Area (m <sup>3</sup> )
Apr	277.4	277.4	208.078	208.078	138.719	138.719
May	212.4	489.9	159.314	367.392	106.209	244.928
Jun	92.0	581.9	69.009	436.401	46.006	290.934
Jul	174.8	756.7	131.124	567.525	87.416	378.350
Aug	184.3	941.0	138.217	705.742	92.144	470.495
Sep	108.9	1,049.9	81.674	787.416	54.449	524.944
Oct	155.1	1,205.0	116.331	903.747	77.554	602.498
Nov	252.1	1,457.1	189.096	1,092.842	126.064	728.562
Dec	86.4	1,543.5	64.819	1,157.661	43.213	771.774
Jan	71.7	1,615.2	53.741	1,211.403	35.828	807.602
Feb	25.2	1,640.4	18.867	1,230.270	12.578	820.180
Mar	111.0	1,751.4	83.260	1,313.530	55.507	875.687


Month	Run-off Actual (46.4%)	Accum. Actual (46.4%)	Visitor Bednights (Average Monthly)	Villager Bednights (per Month)	Essential water required (l)	Essential water required (m <sup>3</sup> )
Apr	128.645	128.645	520	7170	61522.7	61.5
May	98.496	227.141	311	7409	61757.3	61.8
Jun	42.665	269.806	493	7170	61304.0	61.3
Jul	81.068	350.874	648	7409	64456.0	64.5
Aug	85.453	436.327	541	7409	63597.3	63.6
Sep	50.495	486.822	332	7170	60013.3	60.0
Oct	71.922	558.744	497	7409	63250.7	63.3
Nov	116.909	675.653	220	7170	59122.7	59.1
Dec	40.075	715.728	88	7409	59978.7	60.0
Jan	33.226	748.953	584	7409	63946.7	63.9
Feb	11.665	760.618	433	6931	58909.3	58.9
Mar	51.476	812.094	608	7409	64138.7	64.1

Month	Accum. Essential Water (m <sup>3</sup> )	Monthly Average Visitor Bednight x2	Villager Monthly Bednight x1.33	Essential water required Projected (m <sup>3</sup> )	Accum. Essential Projected (m <sup>3</sup> )
Apr	61.5	1040.667	9536.1	84.6	84.6
May	123.3	621.3333	9853.97	83.8	168.4
Jun	184.6	986	9536.1	84.2	252.6
Jul	249.0	1296	9853.97	89.2	341.8
Aug	312.6	1081.333	9853.97	87.5	429.3
Sep	372.7	663.3333	9536.1	81.6	510.9
Oct	435.9	994.6667	9853.97	86.8	597.7
Nov	495.0	440.6667	9536.1	79.8	677.5
Dec	555.0	176.6667	9853.97	80.2	757.7
Jan	618.9	1168.667	9853.97	88.2	845.9
Feb	677.9	865.3333	9218.23	80.7	926.6
Mar	742.0	1216.667	9853.97	88.6	1,015.1


**Graph 1: Accumulated run-off ( $\text{m}^3$ ) and essential water required ( $\text{m}^3$ ) for 100% roof area and current population in an average rainfall year**

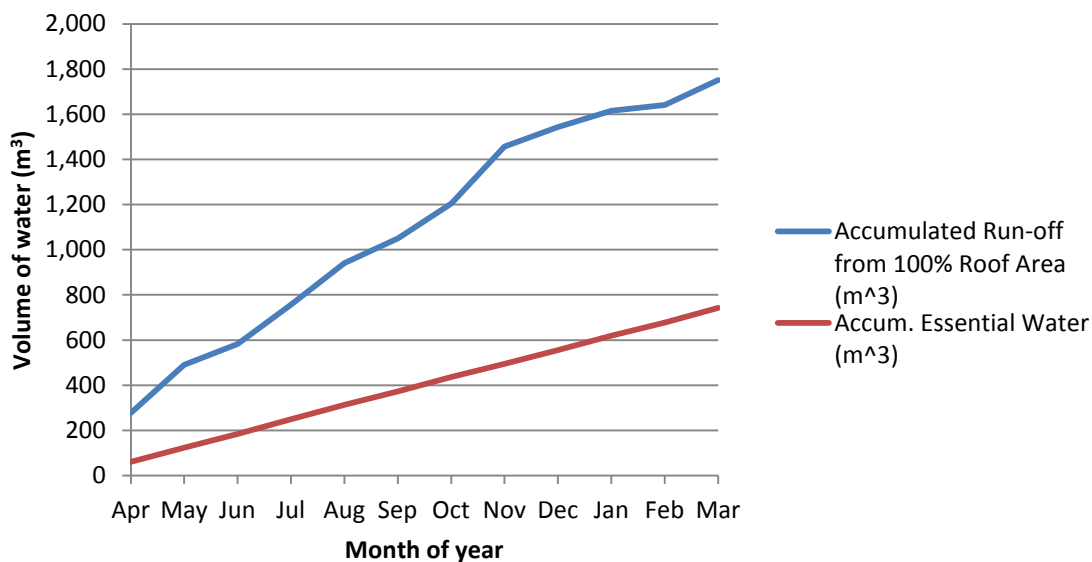


**Graph 2: Accumulated run-off ( $\text{m}^3$ ) and essential water required ( $\text{m}^3$ ) for 100% roof area and projected population in an average rainfall year**

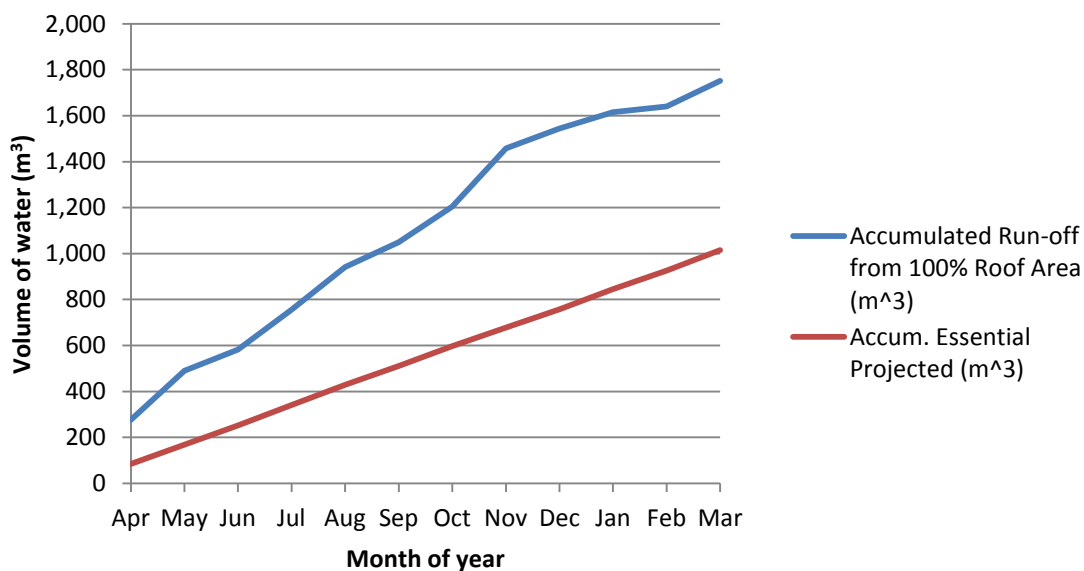


**Graph 3: Accumulated run-off ( $\text{m}^3$ ) and essential water required ( $\text{m}^3$ ) for 75% roof area and current population in an average rainfall year**

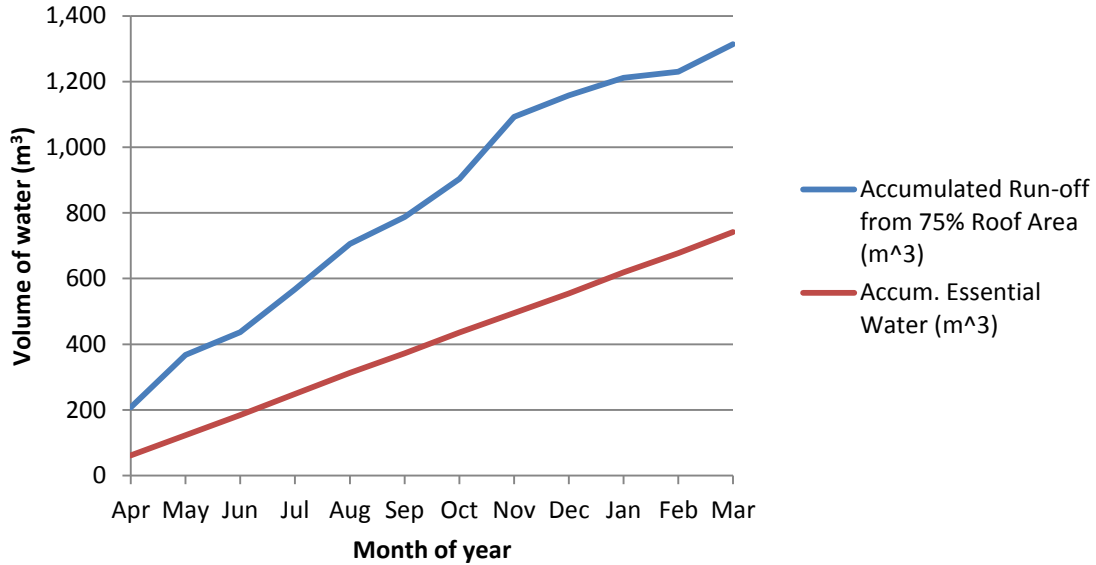


**Graph 4: Accumulated run-off ( $\text{m}^3$ ) and essential water required ( $\text{m}^3$ ) for 75% roof area and projected population in an average rainfall year**

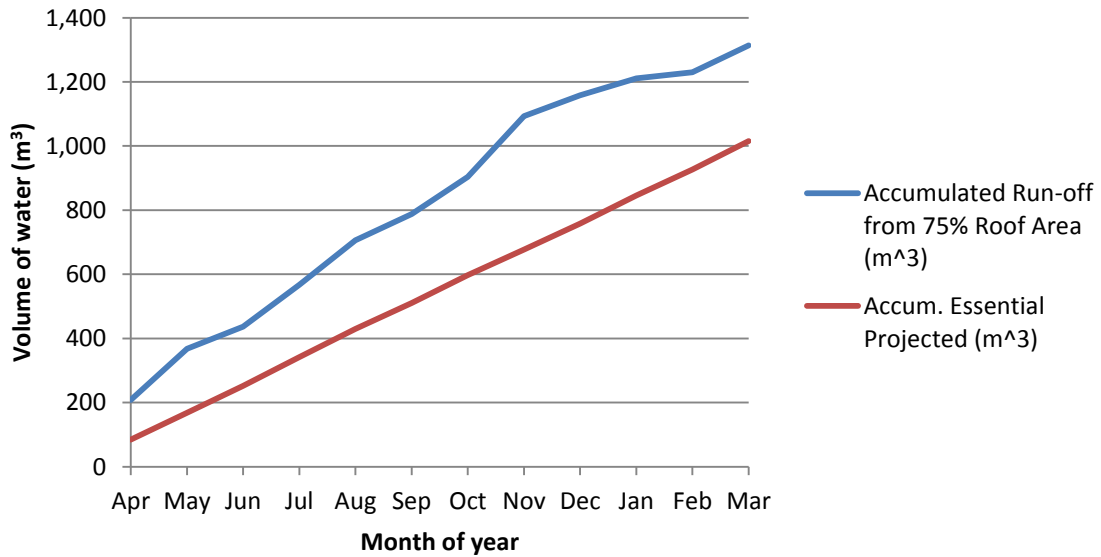


**Graph 5: Accumulated run-off ( $m^3$ ) and essential water required ( $m^3$ ) for 50% roof area and current population in an average rainfall year**

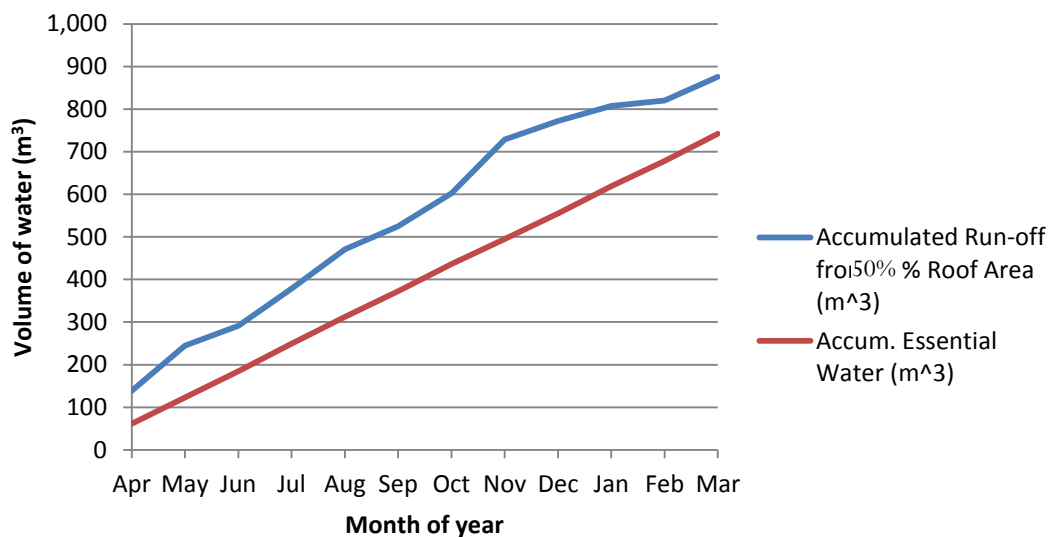


**Graph 6: Accumulated run-off ( $m^3$ ) and essential water required ( $m^3$ ) for 50% roof area and projected population in an average rainfall year**

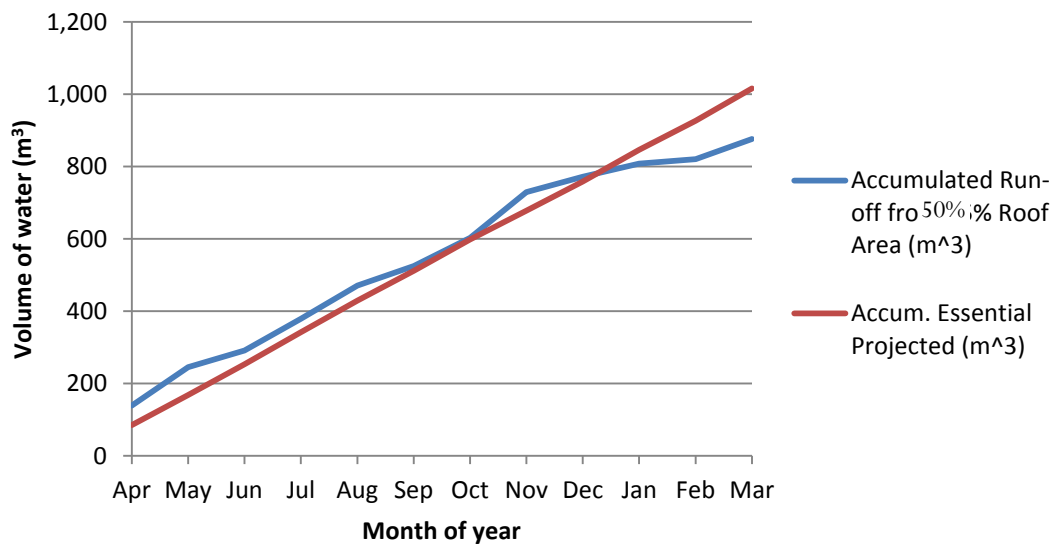

**Graph 7: Accumulated run-off ( $\text{m}^3$ ) and essential water required ( $\text{m}^3$ ) for current converted roof area (46.4%) and current population in an average rainfall year**

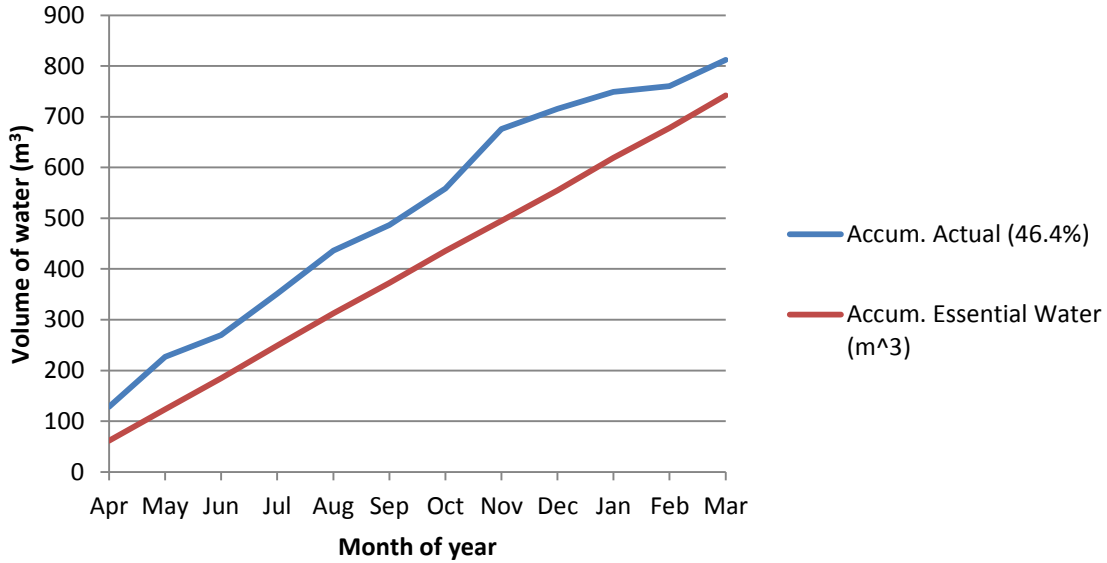

**Graph 8: Accumulated run-off ( $\text{m}^3$ ) and essential water required ( $\text{m}^3$ ) for current converted roof area (46.4%) and projected population in an average rainfall year**

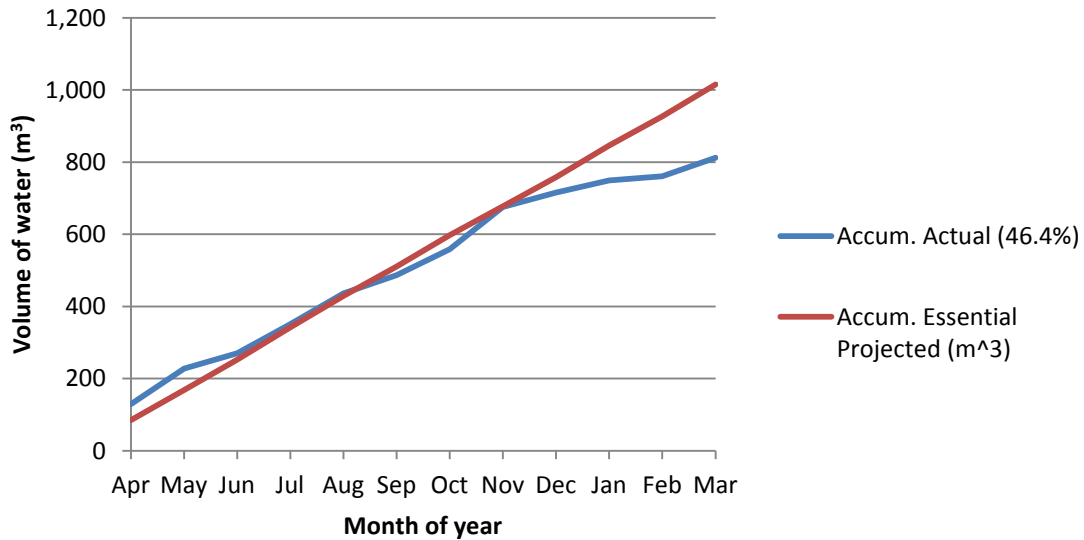

### Appendix W-3b. Accumulated roof runoff and water demand under low rain conditions


Month	Average Monthly Rain (mm)	Average Monthly Rain (m)	Roof area 100% (m <sup>2</sup> )	Roof area 75% (m <sup>2</sup> )	Roof area 50% (m <sup>2</sup> )	Current Roof Area (46.4%)
Apr	3.600	0.004	4,255	3,191	2,128	1,973
May	48.700	0.049	4,255	3,191	2,128	1,973
Jun	0.000	0.000	4,255	3,191	2,128	1,973
Jul	5.400	0.005	4,255	3,191	2,128	1,973
Aug	7.300	0.007	4,255	3,191	2,128	1,973
Sep	0.000	0.000	4,255	3,191	2,128	1,973
Oct	76.980	0.077	4,255	3,191	2,128	1,973
Nov	69.600	0.070	4,255	3,191	2,128	1,973
Dec	86.300	0.086	4,255	3,191	2,128	1,973
Jan	23.000	0.023	4,255	3,191	2,128	1,973
Feb	0.000	0.000	4,255	3,191	2,128	1,973
Mar	0.000	0.000	4,255	3,191	2,128	1,973

Month	Volume Run-off from 100% Roof Area(m <sup>3</sup> )	Accumulated Run-off from 100% Roof Area (m <sup>3</sup> )	Volume Run-off from 75% Roof Area (m <sup>3</sup> )	Accumulated Run-off from 75% Roof Area (m <sup>3</sup> )	Volume Run-off from 50% Roof Area (m <sup>3</sup> )	Accumulated Run-off from 75% Roof Area (m <sup>3</sup> )
Apr	13.020	13.020	9.765	9.765	6.510	6.510
May	176.136	189.156	132.102	141.867	88.068	94.578
Jun	0.000	189.156	0.000	141.867	0.000	94.578
Jul	19.530	208.686	14.648	156.515	9.765	104.343
Aug	26.402	235.089	19.802	176.317	13.201	117.544
Sep	0.000	235.089	0.000	176.317	0.000	117.544
Oct	278.417	513.506	208.813	385.130	139.209	256.753
Nov	251.726	765.232	188.794	573.924	125.863	382.616
Dec	312.126	1,077.357	234.094	808.018	156.063	538.679
Jan	83.185	1,160.543	62.389	870.407	41.593	580.271
Feb	0.000	1,160.543	0.000	870.407	0.000	580.271
Mar	0.000	1,160.543	0.000	870.407	0.000	580.271


Month	Run-off Actual (46.4%)	Accum. Actual (46.4%)	Visitor Bednights (Average Monthly)	Villager Bednights (per Month)	Essential water required (l)	Essential water required (m <sup>3</sup> )
Apr	6.036	6.036	520	7170	61522.66667	61.52266667
May	81.657	87.693	311	7409	61757.33333	61.75733333
Jun	0.000	87.693	493	7170	61304	61.304
Jul	9.054	96.747	648	7409	64456	64.456
Aug	12.240	108.987	541	7409	63597.33333	63.59733333
Sep	0.000	108.987	332	7170	60013.33333	60.01333333
Oct	129.074	238.061	497	7409	63250.66667	63.25066667
Nov	116.700	354.762	220	7170	59122.66667	59.12266667
Dec	144.701	499.463	88	7409	59978.66667	59.97866667
Jan	38.565	538.028	584	7409	63946.66667	63.94666667
Feb	0.000	538.028	433	6931	58909.33333	58.90933333
Mar	0.000	538.028	608	7409	64138.66667	64.13866667

Month	Accum. Essential Water (m <sup>3</sup> )	Monthly Average Visitor Bednight x2	Villager Monthly Bednight x1.33	Essential water required Projected (m <sup>3</sup> )	Accum. Essential Projected (m <sup>3</sup> )
Apr	61.523	1040.667	9536.1	84.61413	84.614
May	123.280	621.3333	9853.97	83.80243	168.417
Jun	184.584	986	9536.1	84.1768	252.593
Jul	249.040	1296	9853.97	89.19976	341.793
Aug	312.637	1081.333	9853.97	87.48243	429.276
Sep	372.651	663.3333	9536.1	81.59547	510.871
Oct	435.901	994.6667	9853.97	86.78909	597.660
Nov	495.024	440.6667	9536.1	79.81413	677.474
Dec	555.003	176.6667	9853.97	80.24509	757.719
Jan	618.949	1168.667	9853.97	88.18109	845.900
Feb	677.859	865.3333	9218.23	80.66851	926.569
Mar	741.997	1216.667	9853.97	88.56509	1,015.134


**Graph 9: Accumulated run-off ( $m^3$ ) and essential water required ( $m^3$ ) for 100% roof area and current population in a low rainfall year**

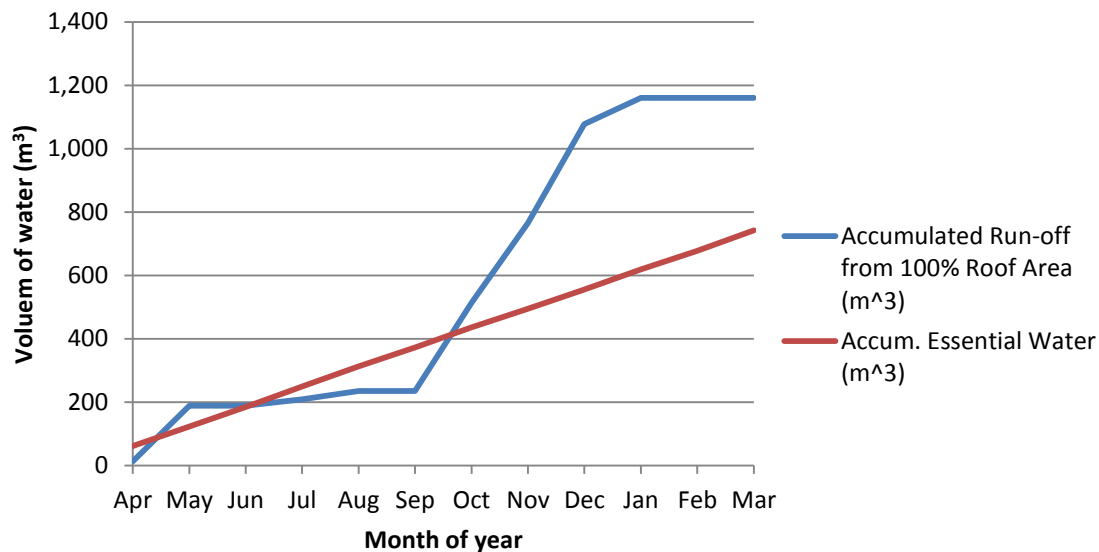


**Graph 10: Accumulated run-off ( $m^3$ ) and essential water required ( $m^3$ ) for 100% roof area and projected population in a low rainfall year**

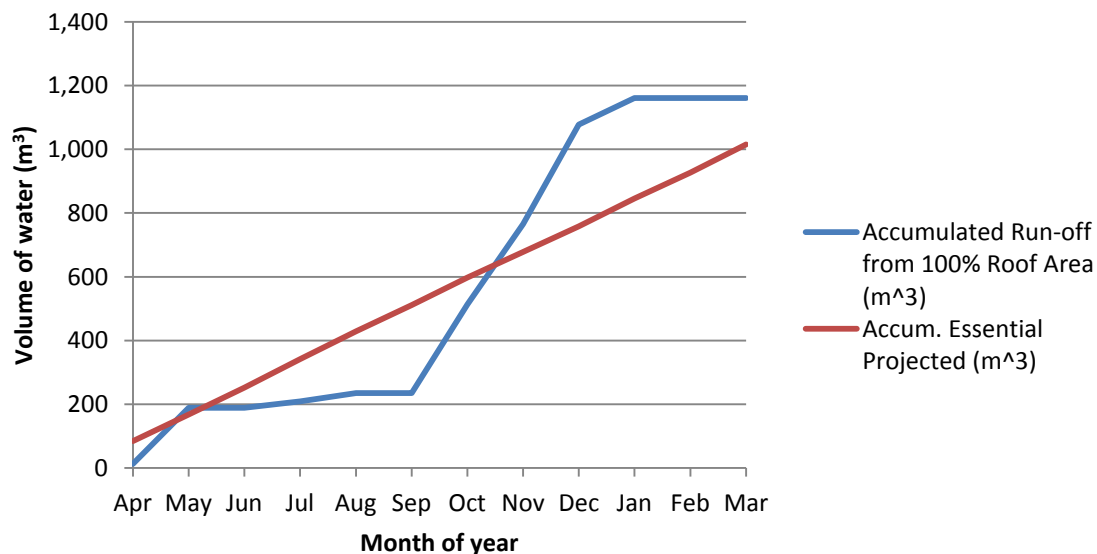


**Graph 11: Accumulated run-off ( $\text{m}^3$ ) and essential water required ( $\text{m}^3$ ) for 75% roof area and current population in a low rainfall year**

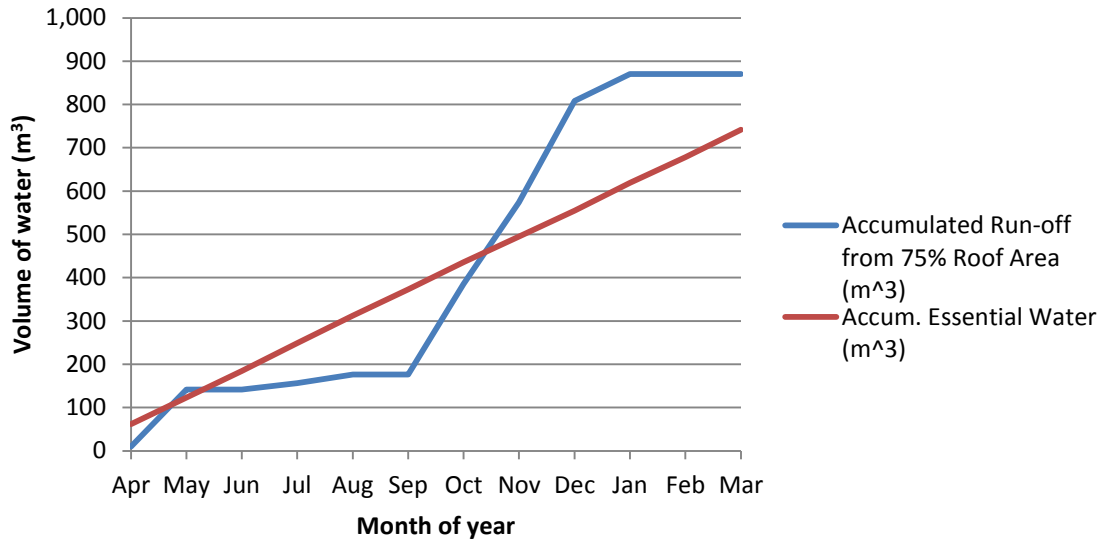


**Graph 12: Accumulated run-off ( $\text{m}^3$ ) and essential water required ( $\text{m}^3$ ) for 75% roof area and projected population in a low rainfall year**

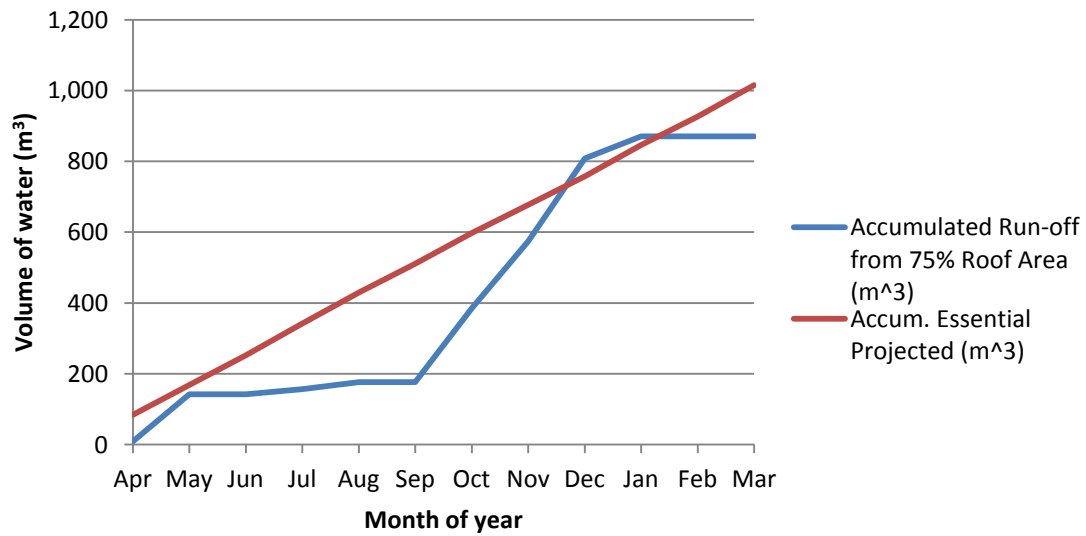


**Graph 13: Accumulated run-off ( $m^3$ ) and essential water required ( $m^3$ ) for 50% roof area and current population in a low rainfall year**

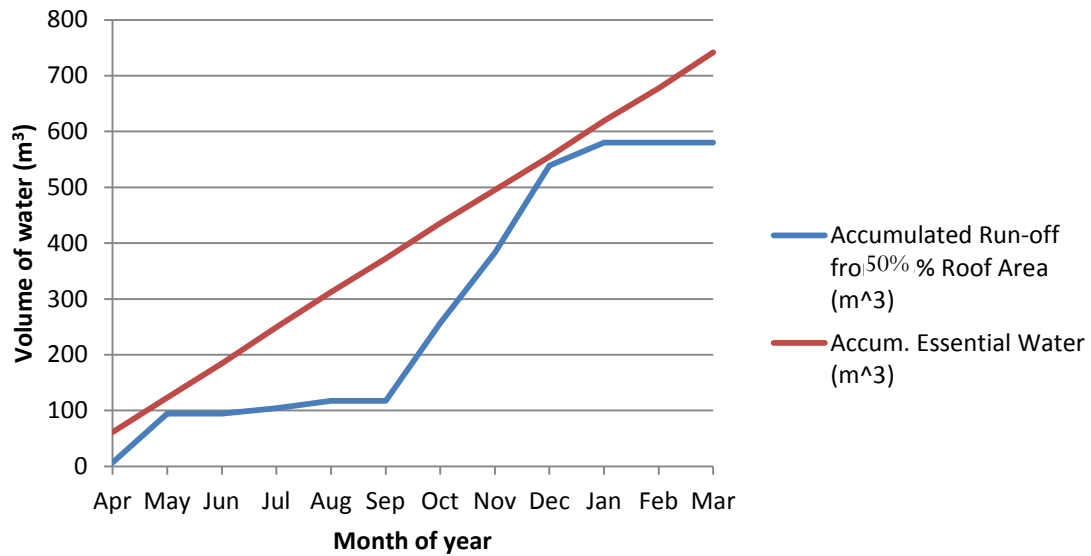


**Graph 14: Accumulated run-off ( $m^3$ ) and essential water required ( $m^3$ ) for 50% roof area and projected population in a low rainfall year**

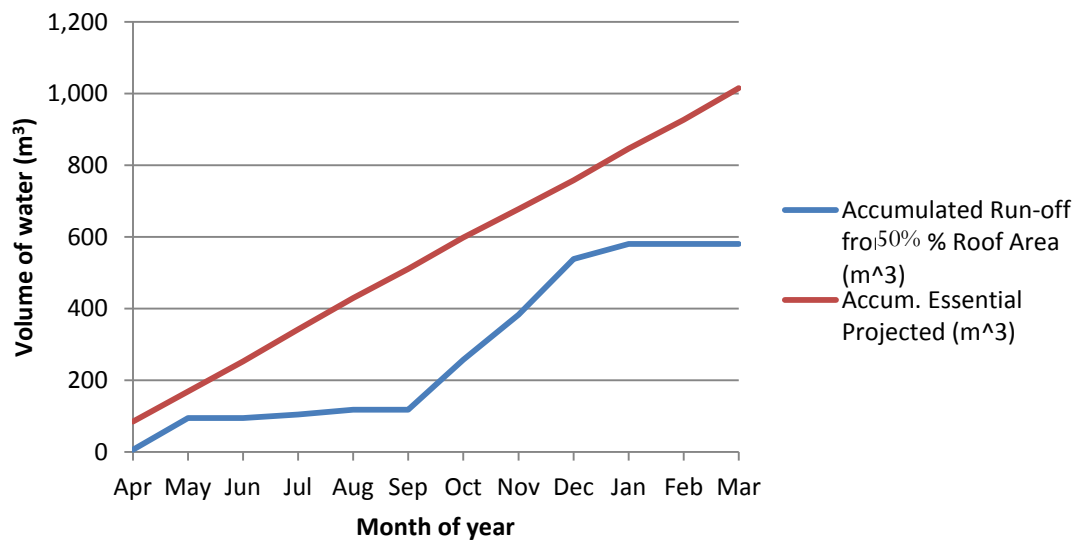

**Graph 15: Accumulated run-off ( $\text{m}^3$ ) and essential water required ( $\text{m}^3$ ) for current converted roof area (46.4%) and current population in a low rainfall year**

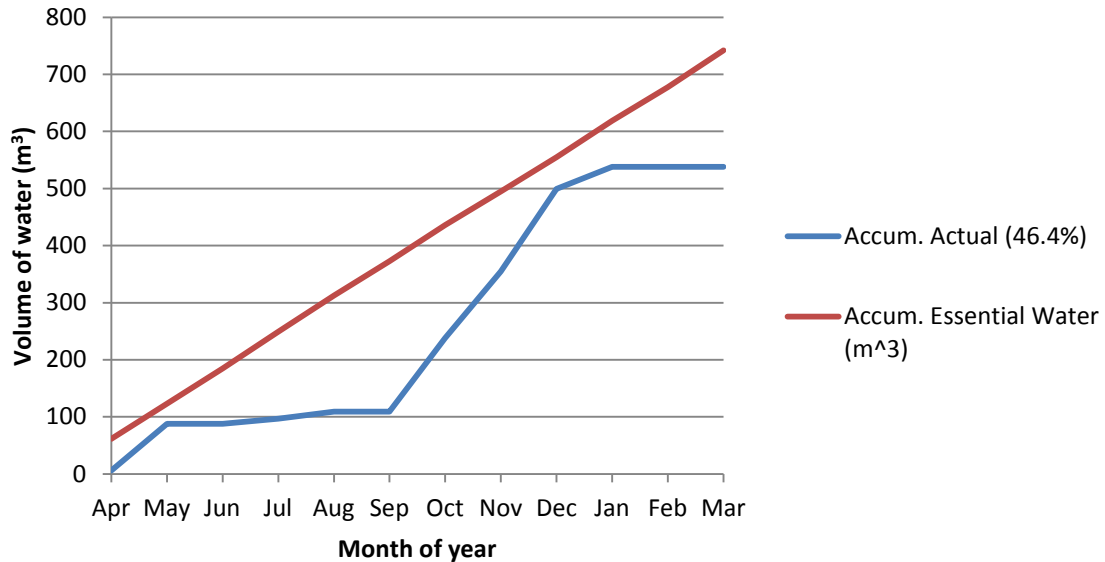

**Graph 16: Accumulated run-off ( $\text{m}^3$ ) and essential water required ( $\text{m}^3$ ) for current converted roof area (46.4%) and projected population in a low rainfall year**

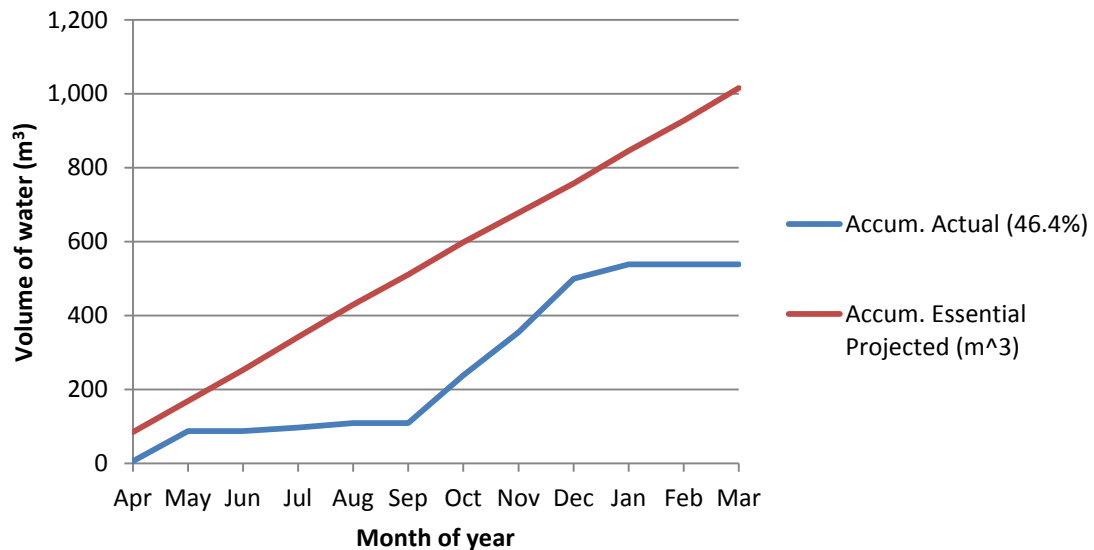

### Appendix W-3c. Accumulated roof runoff and water demand under high rain conditions


Month	Average Monthly Rain (mm)	Average Monthly Rain (m)	Roof area 100% (m <sup>2</sup> )	Roof area 75% (m <sup>2</sup> )	Roof area 50% (m <sup>2</sup> )	Current Roof Area (46.4%)
Apr	205.3	0.205	4,255	3,191	2,128	1,617
May	75.5	0.076	4,255	3,191	2,128	1,617
Jun	2.4	0.002	4,255	3,191	2,128	1,617
Jul	71.2	0.071	4,255	3,191	2,128	1,617
Aug	98.48	0.098	4,255	3,191	2,128	1,617
Sep	68.5	0.069	4,255	3,191	2,128	1,617
Oct	37	0.037	4,255	3,191	2,128	1,617
Nov	118.5	0.119	4,255	3,191	2,128	1,617
Dec	8.8	0.009	4,255	3,191	2,128	1,617
Jan	92.5	0.093	4,255	3,191	2,128	1,617
Feb	19.4	0.019	4,255	3,191	2,128	1,617
Mar	41.6	0.042	4,255	3,191	2,128	1,617

Month	Volume Run-off from 100% Roof Area (m <sup>3</sup> )	Accumulated Run-off from 100% Roof Area (m <sup>3</sup> )	Volume Run-off from 75% Roof Area (m <sup>3</sup> )	Accumulated Run-off from 75% Roof Area (m <sup>3</sup> )	Volume Run-off from 50% Roof Area (m <sup>3</sup> )	Accumulated Run-off from 75% Roof Area (m <sup>3</sup> )
Apr	742.519	742.519	556.889	556.889	371.3	371.3
May	273.065	1,015.583	204.798	761.688	136.5	507.8
Jun	8.680	1,024.264	6.510	768.198	4.3	512.1
Jul	257.513	1,281.776	193.134	961.332	128.8	640.9
Aug	356.178	1,637.954	267.133	1,228.465	178.1	819.0
Sep	247.747	1,885.701	185.811	1,414.276	123.9	942.9
Oct	133.820	2,019.521	100.365	1,514.641	66.9	1,009.8
Nov	428.585	2,448.106	321.439	1,836.079	214.3	1,224.1
Dec	31.827	2,479.933	23.871	1,859.950	15.9	1,240.0
Jan	334.549	2,814.483	250.912	2,110.862	167.3	1,407.2
Feb	70.165	2,884.647	52.624	2,163.486	35.1	1,442.3
Mar	150.457	3,035.104	112.843	2,276.328	75.2	1,517.6


Month	Run-off Actual (46.4%)	Accum. Actual (46.4%)	Visitor Bednights (Average Monthly)	Villager Bednights (per Month)	Essential water required (l)	Essential water required (m <sup>3</sup> )
Apr	282.2	282.2	520	7170	61522.7	61.5
May	103.8	385.9	311	7409	61757.3	61.8
Jun	3.3	389.2	493	7170	61304.0	61.3
Jul	97.9	487.1	648	7409	64456.0	64.5
Aug	135.3	622.4	541	7409	63597.3	63.6
Sep	94.1	716.6	332	7170	60013.3	60.0
Oct	50.9	767.4	497	7409	63250.7	63.3
Nov	162.9	930.3	220	7170	59122.7	59.1
Dec	12.1	942.4	88	7409	59978.7	60.0
Jan	127.1	1,069.5	584	7409	63946.7	63.9
Feb	26.7	1,096.2	433	6931	58909.3	58.9
Mar	57.2	1,153.3	608	7409	64138.7	64.1

Month	Accum. Essential Water (m <sup>3</sup> )	Monthly Average Visitor Bednight x2	Villager Monthly Bednight x1.33	Essential water required Projected (m <sup>3</sup> )	Accum. Essential Projected (m <sup>3</sup> )
Apr	61.5	1,040.7	9,536.1	84.6	84.6
May	123.3	621.3	9,854.0	83.8	168.4
Jun	184.6	986.0	9,536.1	84.2	252.6
Jul	249.0	1,296.0	9,854.0	89.2	341.8
Aug	312.6	1,081.3	9,854.0	87.5	429.3
Sep	372.7	663.3	9,536.1	81.6	510.9
Oct	435.9	994.7	9,854.0	86.8	597.7
Nov	495.0	440.7	9,536.1	79.8	677.5
Dec	555.0	176.7	9,854.0	80.2	757.7
Jan	618.9	1,168.7	9,854.0	88.2	845.9
Feb	677.9	865.3	9,218.2	80.7	926.6
Mar	742.0	1,216.7	9,854.0	88.6	1,015.1


**Graph 17: Accumulated run-off ( $m^3$ ) and essential water required ( $m^3$ ) for 100% roof area and current population in a high rainfall year**

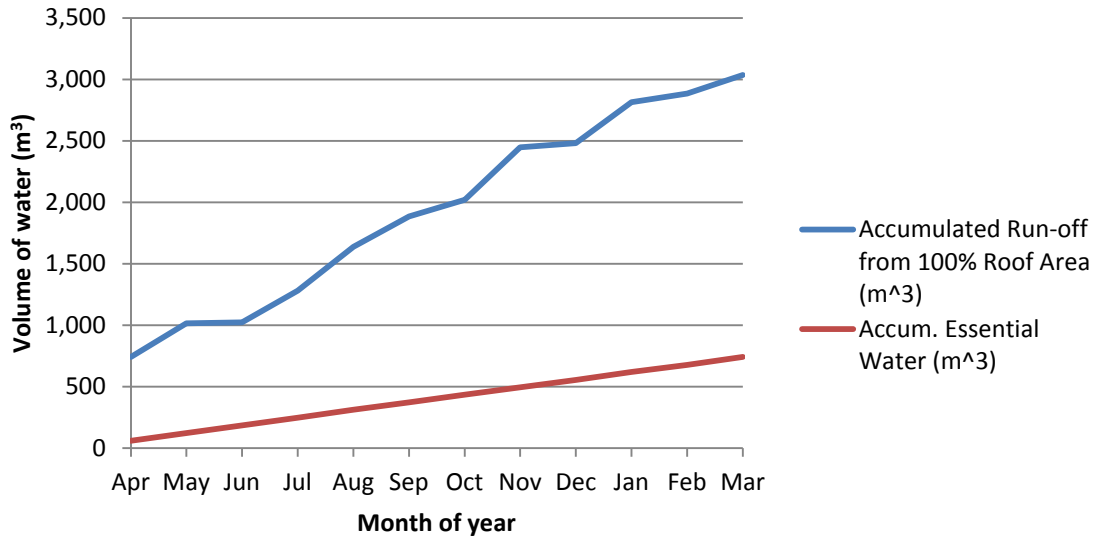


**Graph 18: Accumulated run-off ( $m^3$ ) and essential water required ( $m^3$ ) for 100% roof area and projected population in a high rainfall year**

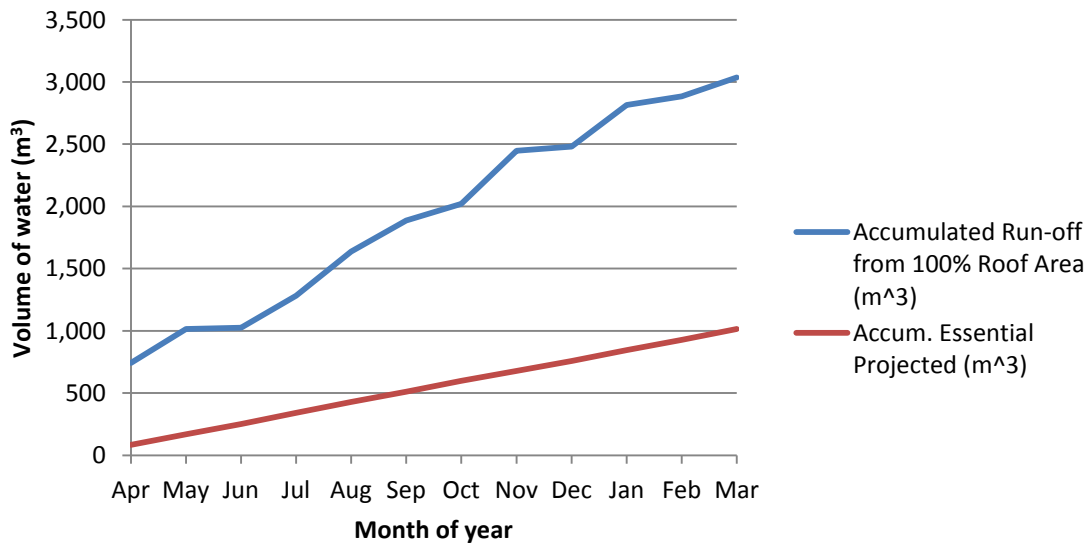


**Graph 19: Accumulated run-off ( $\text{m}^3$ ) and essential water required ( $\text{m}^3$ ) for 75% roof area and current population in a high rainfall year**

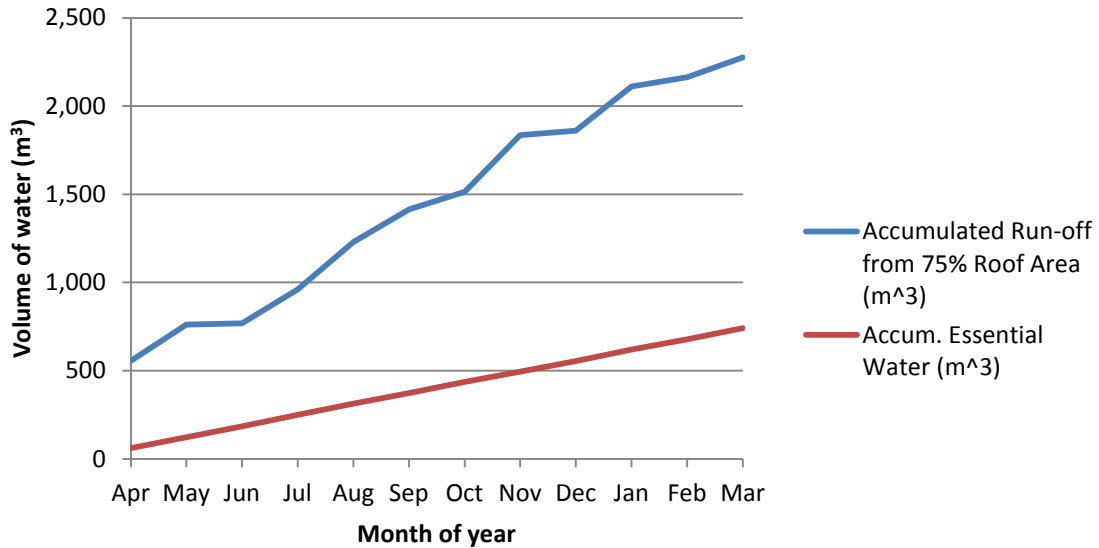


**Graph 20: Accumulated run-off ( $\text{m}^3$ ) and essential water required ( $\text{m}^3$ ) for 75% roof area and projected population in a high rainfall year**

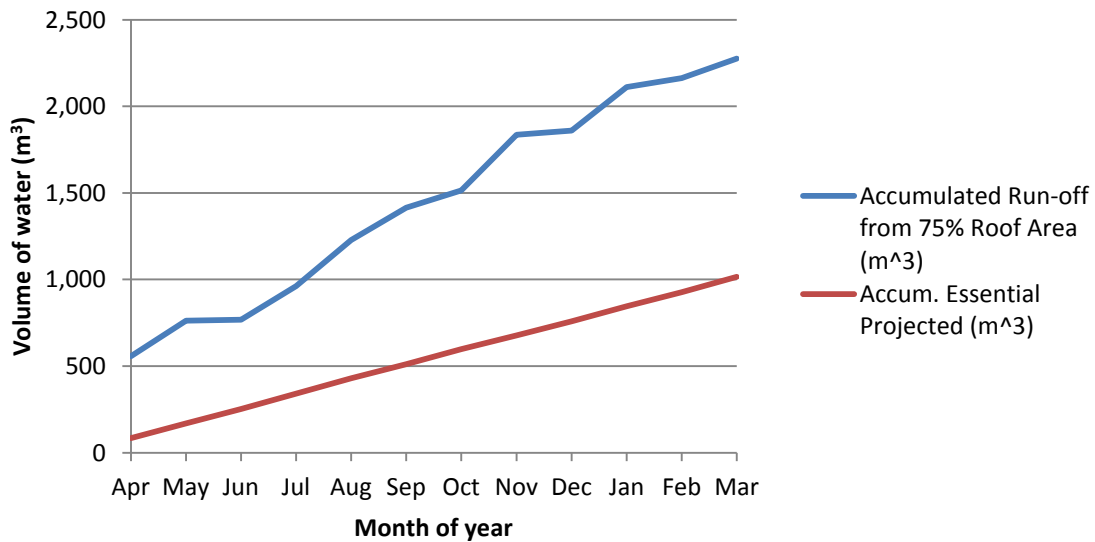


**Graph 21: Accumulated run-off ( $m^3$ ) and essential water required ( $m^3$ ) for 50% roof area and current population in a high rainfall year**

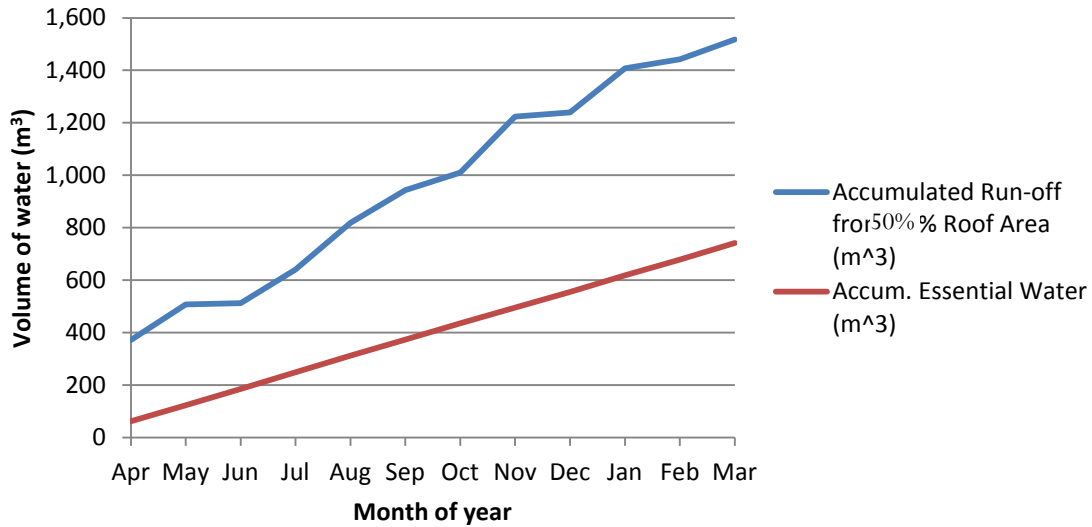

**Graph 22: Accumulated run-off ( $m^3$ ) and essential water required ( $m^3$ ) for 50% roof area and projected population in a high rainfall year**

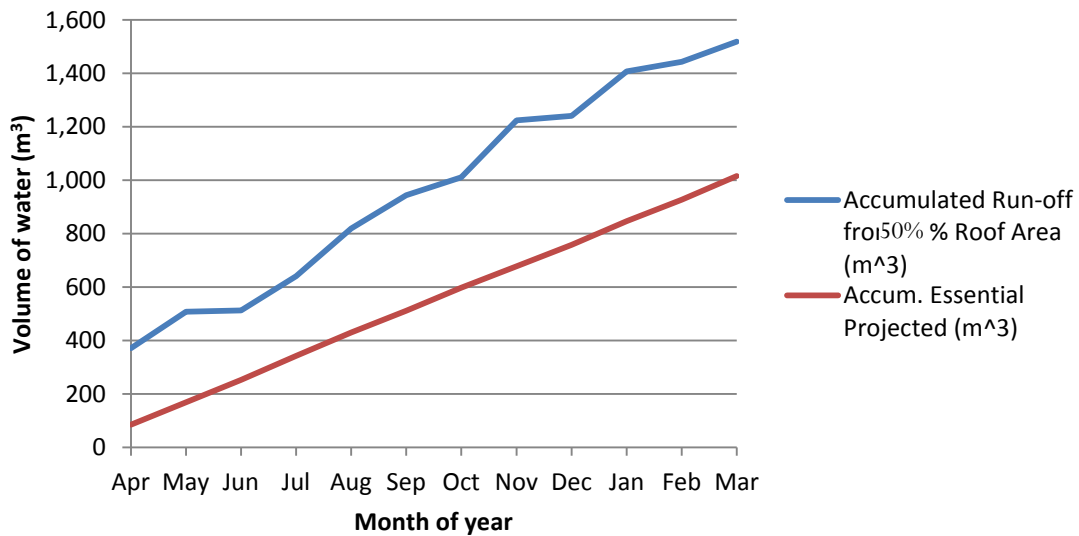

**Graph 23: Accumulated run-off ( $\text{m}^3$ ) and essential water required ( $\text{m}^3$ ) for current converted roof area (46.4%) and current population in a high rainfall year**

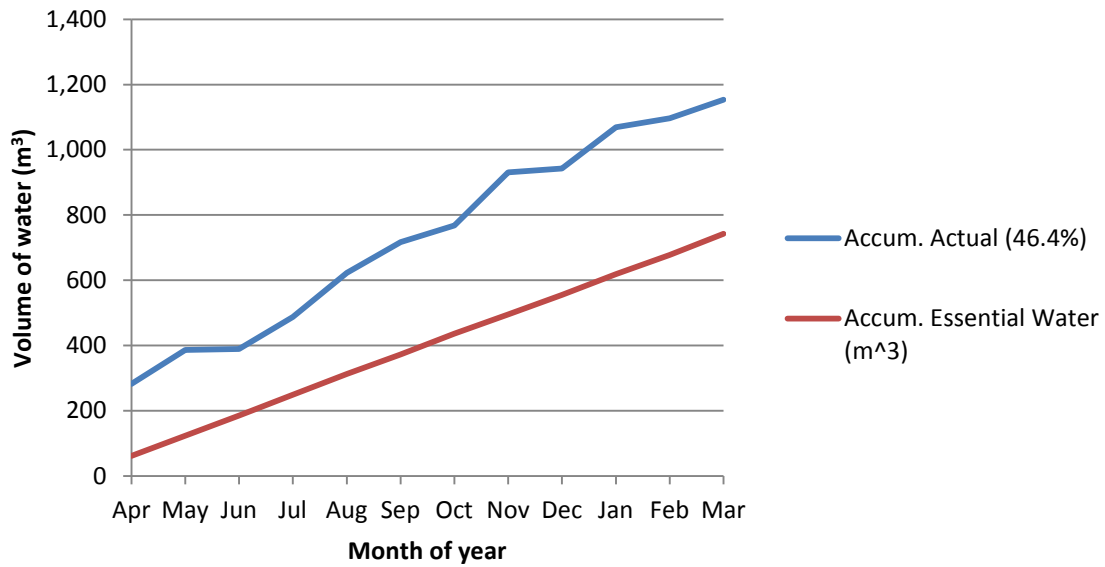

J2=IF(H2=0,\$L\$2,IF(H2-\$L\$2>0,0,\$L\$2-H2)) [Repeated for entire column]

*Summaries:*

M6=SUM(G2:G4019)

M7=MAX(SUM(G2:G366),SUM(G367:G732),SUM(G733:G1097),SUM(G1098:G1462),SUM(G1463:G1827),SUM(G1828:G2193),SUM(G2194:G2558),SUM(G2559:G2923),SUM(G2924:G3288),SUM(G3289:G3654),SUM(G3655:G4019))

M8=MIN(SUM(G2:G366),SUM(G367:G732),SUM(G733:G1097),SUM(G1098:G1462),SUM(G1463:G1827),SUM(G1828:G2193),SUM(G2194:G2558),SUM(G2559:G2923),SUM(G2924:G3288),SUM(G3289:G3654),SUM(G3655:G4019))

N6=SUM(I2:I4019)

N7=MAX(SUM(I2:I366),SUM(I367:I732),SUM(I733:I1097),SUM(I1098:I1462),SUM(I1463:I1827),SUM(I1828:I2193),SUM(I2194:I2558),SUM(I2559:I2923),SUM(I2924:I3288),SUM(I3289:I3654),SUM(I3655:I4019))

N8=MIN(SUM(I2:I366),SUM(I367:I732),SUM(I733:I1097),SUM(I1098:I1462),SUM(I1463:I1827),SUM(I1828:I2193),SUM(I2194:I2558),SUM(I2559:I2923),SUM(I2924:I3288),SUM(I3289:I3654),SUM(I3655:I4019))

O6=SUM(J2:J4019)


O7=MAX(SUM(J2:J366),SUM(J367:J732),SUM(J733:J1097),SUM(J1098:J1462),SUM(J1463:J1827),SUM(J1828:J2193),SUM(J2194:J2558),SUM(J2559:J2923),SUM(J2924:J3288),SUM(J3289:J3654),SUM(J3655:J4019))

O8=MIN(SUM(J2:J366),SUM(J367:J732),SUM(J733:J1097),SUM(J1098:J1462),SUM(J1463:J1827),SUM(J1828:J2193),SUM(J2194:J2558),SUM(J2559:J2923),SUM(J2924:J3288),SUM(J3289:J3654),SUM(J3655:J4019))

## Appendix W-4a. All MRC Village houses, only villagers drink

<b>Scenario 1: All MRC Village houses current, only villagers drink</b>		Empty Days	1,793
Tank Size	1000	Average/year	163
Number of Village Homes	45	Dry Year Empty Days	257
Total tank volume	45000	Wet Year Empty Days	87
One roof area	22	Volume Missed	1,058,338
Total Roof	990	Average/year	96,213
Number individuals	239	Wet Year Volume Missed	244,230
Personal daily use	8	Dry Year Volume Missed	0
Daily Use	1912	Shortfall	3,596,162
Run-off Coefficient	85%	Average/year	326,924
		Wet year shortfall	175,498
		Dry year shortfall	507,872
<b>Scenario 2: All MRC Village houses * 1.33 population</b>		Empty Days	2,277
Tank Size	1000	Average/year	207
Number of Village Homes	45	Dry Year Empty Days	279
Total tank volume	45000	Wet Year Empty Days	139
One roof area	22	Volume Missed	715,745
Total Roof	990	Average/year	65,068
Number individuals	318	Wet Year Volume Missed	197,594
Personal daily use	8	Dry Year Volume Missed	0
Daily Use	2543	Shortfall	6,073,440
Run-off Coefficient	85%	Average/year	552,131
		Wet year shortfall	366,656
		Dry year shortfall	730,147

**Comparison of 1000-liter tanks at every Village home serving current Village Population and Projected 33% increase in Village Population**

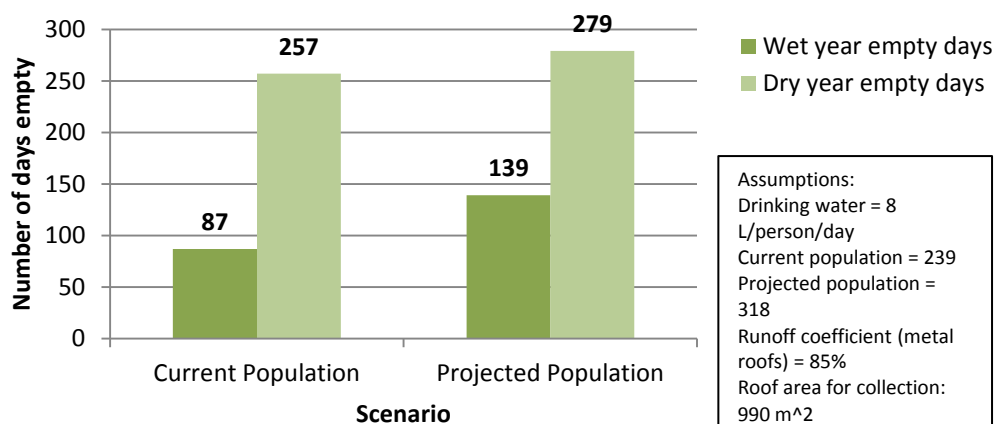


## Appendix W-4b. All MRC roofs, only visitors drink

<b>Scenario 3: All MRC roofs current, only visitors drink</b>			
		Empty Days	29
Current tank capacity	182700	Average/year	3
Total roof area	1973	Dry Year Empty Days	29
Average number visitors (MRC + campsite)	64	Wet Year Empty Days	0
Personal daily use	8	Volume Missed	8,877,058
Daily Use	512	Average/year	807,005
Run-off Coefficient	85%	Wet Year Volume Missed	1,230,349
		Dry Year Volume Missed	0
		Shortfall	15,206
		Average/year	1,382
		Wet year shortfall	0
		Dry year shortfall	15,206

<b>Scenario 4: All MRC roofs current * 2 population visitors</b>			
		Empty Days	45
Tank Size	182700	Average/year	4
Total roof area	1973	Dry Year Empty Days	45
Average number visitors (MRC + campsite)	128	Wet Year Empty Days	0
Personal daily use	8	Volume Missed	6,851,074
Daily Use	1024	Average/year	622,825
Run-off Coefficient	85%	Wet Year Volume Missed	1,043,981
		Dry Year Volume Missed	0
		Shortfall	46,950
		Average/year	4,268
		Wet year shortfall	0
		Dry year shortfall	46,950


**Comparison of Current Storage Capacity and Current Roof Catchment Serving Current and Projected 100% Increase of Visitor Population**

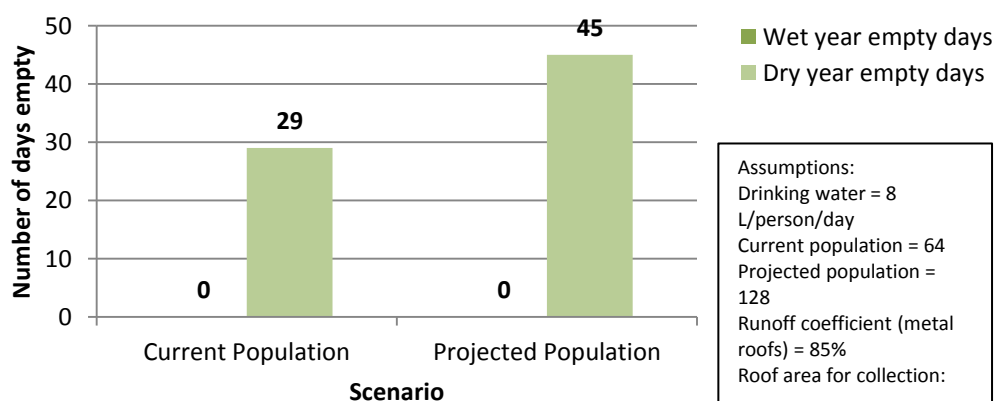

### Appendix W-4c. All MRC roofs, everyone drinks

<b>Scenario 5: All MRC roofs current, all drink current population</b>			
		Empty Days	562
Current tank capacity	182700	Average/year	51
Total roof area	1973	Dry Year Empty Days	179
Average number visitors (MRC+Campsite)	64	Wet Year Empty Days	0
Villagers	239	Volume Missed	2,501,345
Personal Daily Use	8	Average/year	227,395
Daily Use	2424	Wet Year Volume Missed	552,362
Run-off Coefficient	85%	Dry Year Volume Missed	0
		Shortfall	1,426,269
		Average/year	129,661
		Wet year shortfall	0
		Dry year shortfall	447,254
<b>Scenario 6: All MRC roofs, all drink 2 x visitors + 1.3 x villagers</b>			
		Empty Days	1,244
Current tank capacity	182700	Average/year	113
Total roof area	1973	Dry Year Empty Days	229
Average number visitors (MRC+Campsite)	128	Wet Year Empty Days	17
Villagers	317.87	Volume Missed	884,469
Personal Daily Use	8	Average/year	80,406
Daily Use	3566.96	Wet Year Volume Missed	289,400
Run-off Coefficient	85%	Dry Year Volume Missed	0
		Shortfall	4,645,680
		Average/year	422,335
		Wet year shortfall	61,946
		Dry year shortfall	844,626

**Comparison of Current Storage Capacity and Current Roof Catchment Serving Current and Projected Total MRC Population**

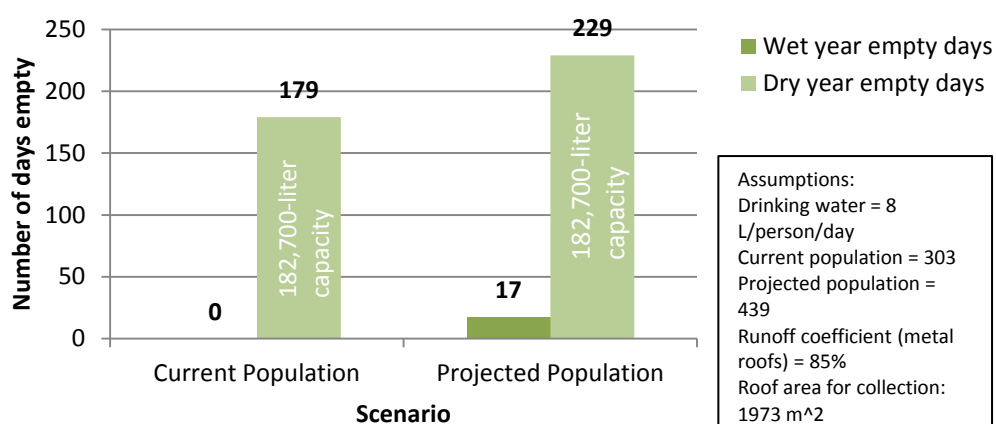


#### Appendix W-4d. All MRC roofs, everyone drinks, one additional tank

<b>Scenario 7: All MRC roofs, all drink current pop plus (1) add'l 13m<sup>3</sup> tank</b>		Empty Days	
Current tank capacity	195700	Average/year	47
Total roof area	1973	Dry Year Empty Days	173
Average number visitors (MRC+Campsite)	64	Wet Year Empty Days	0
Villagers	239	Volume Missed	2,405,277
Personal Daily Use	8	Average/year	218,662
Daily Use	2424	Wet Year Volume Missed	552,362
Run-off Coefficient	85%	Dry Year Volume Missed	0
		Shortfall	1,312,586
		Average/year	119,326
		Wet year shortfall	0
		Dry year shortfall	434,254

<b>Scenario 8: All MRC roofs, all drink 2x visitors + 1.3 villagers plus (1) add'l 13m<sup>3</sup> tank</b>		Empty Days	
Current tank capacity	195700	Average/year	111
Total roof area	1973	Dry Year Empty Days	226
Average number visitors (MRC+Campsite)	128	Wet Year Empty Days	13
Villagers	318	Volume Missed	787,852
Personal Daily Use	8	Average/year	71,623
Daily Use	3567	Wet Year Volume Missed	276,400
Run-off Coefficient	85%	Dry Year Volume Missed	0
		Shortfall	4,542,003
		Average/year	412,909
		Wet year shortfall	48,946
		Dry year shortfall	831,626


**Comparison of Current Roof Catchment and Current Storage plus (1) Additional 13 m<sup>3</sup> Tank Serving Current and Projected Total MRC Population**

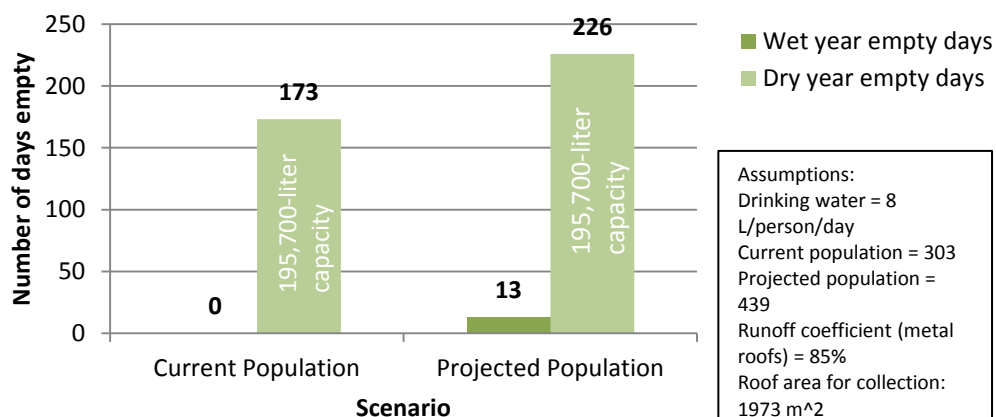

### Appendix W-4e. All MRC roofs, all drink, 2 additional tanks

<b>Scenario 9: All MRC roofs, all drink current pop plus (2) add'l 13m<sup>3</sup> tank</b>			
Current tank capacity	208700	Empty Days	480
Total roof area	1973	Average/year	44
Average number visitors (MRC+Campsite)	64	Dry Year Empty Days	168
Villagers	239	Wet Year Empty Days	0
Personal Daily Use	8	Volume Missed	2,316,222
Daily Use	2424	Average/year	210,566
Run-off Coefficient	85%	Wet Year Volume Missed	552,362
		Dry Year Volume Missed	0
		Shortfall	1,203,697
		Average/year	109,427
		Wet year shortfall	0
		Dry year shortfall	420,753
<b>Scenario 10: All MRC roofs, all drink 2x visitors + 1.3 villagers plus (2) add'l 13m<sup>3</sup> tank</b>			
Current tank capacity	208700	Empty Days	1,194
Total roof area	1973	Average/year	109
Average number visitors (MRC+Campsite)	128	Dry Year Empty Days	223
Villagers	318	Wet Year Empty Days	9
Personal Daily Use	8	Volume Missed	702,331
Daily Use	3566.96	Average/year	63,848
Run-off Coefficient	85%	Wet Year Volume Missed	263,400
		Dry Year Volume Missed	0
		Shortfall	4,453,976
		Average/year	404,907
		Wet year shortfall	33,441
		Dry year shortfall	819,443

**Comparison of Current Roof Catchment and Current Storage plus (2) Additional 13 m<sup>3</sup> Tanks Serving Current and Projected Total MRC Population**

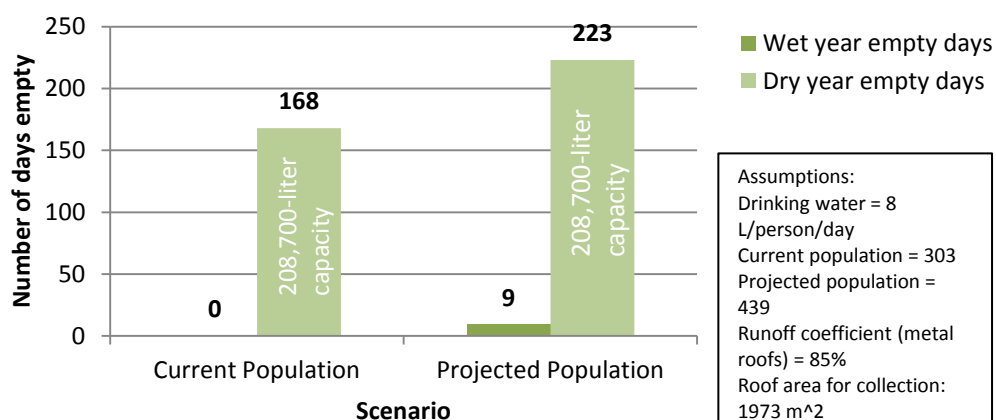


### Appendix W-4f. All MRC roofs, all drink, 3 add'l tanks

<b>Scenario 11: All MRC roofs, all drink current pop(3) add'l 13m<sup>3</sup> tank</b>			
		Empty Days	455
Current tank capacity	221700	Average/year	41
Total roof area	1973	Dry Year Empty Days	162
Average number visitors (MRC+Campsite)	64	Wet Year Empty Days	0
Villagers	239	Volume Missed	2,265,093
Personal Daily Use	8	Average/year	205,918
Daily Use	2424	Wet Year Volume Missed	552,362
Run-off Coefficient	85%	Dry Year Volume Missed	0
		Shortfall	1,144,817
		Average/year	104,074
		Wet year shortfall	0
		Dry year shortfall	407,753

<b>Scenario 12: All MRC roofs, all drink 2x visitors + 1.3 villagers plus (3) add'l 13m<sup>3</sup> tank</b>			
		Empty Days	1,171
Current tank capacity	221700	Average/year	106
Total roof area	1973	Dry Year Empty Days	223
Average number visitors (MRC+Campsite)	128	Wet Year Empty Days	4
Villagers	317.87	Volume Missed	629,098
Personal Daily Use	8	Average/year	57,191
Daily Use	3566.96	Wet Year Volume Missed	250,400
Run-off Coefficient	85%	Dry Year Volume Missed	0
		Shortfall	4,374,670
		Average/year	397,697
		Wet year shortfall	16,874
		Dry year shortfall	819,443

**Comparison of Current Roof Catchment and Current Storage plus (3) Additional 13 m<sup>3</sup> Tanks Serving Current and Projected Total MRC Population**

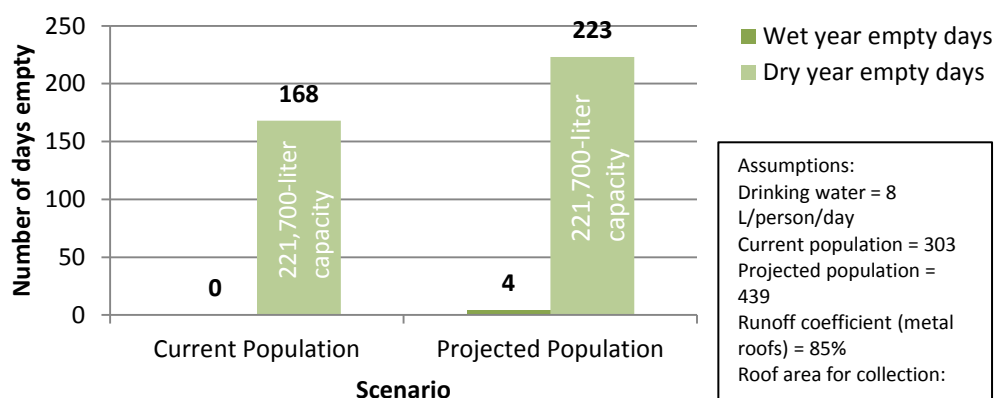


### Appendix W-4g. All MRC roofs, all drink, 4 extra tanks

Scenario 13: All MRC roofs, all drink current pop plus (4) add'l 13m^3 tank		Empty Days	439
Current tank capacity	234700	Average/year	40
Total roof area	1973	Dry Year Empty Days	157
Average number visitors (MRC+Campsite)	64	Wet Year Empty Days	0
Villagers	239	Volume Missed	2,226,093
Personal Daily Use	8	Average/year	202,372
Daily Use	2424	Wet Year Volume Missed	552,362
Run-off Coefficient	85%	Dry Year Volume Missed	0
		Shortfall	1,101,824
		Average/year	100,166
		Wet year shortfall	0
		Dry year shortfall	394,753

<u>Scenario 14: All MRC roofs, all drink 2x visitors + 1.3 villagers plus (4) add'l 13m^3 tank</u>		Empty Days	1,155
Current tank capacity	234700	Average/year	105
Total roof area	1973	Dry Year Empty Days	223
Average number visitors (MRC+Campsite)	128	Wet Year Empty Days	1
Villagers	317.87	Volume Missed	572,520
Personal Daily Use	8	Average/year	52,047
Daily Use	3566.96	Wet Year Volume Missed	237,400
Run-off Coefficient	85%	Dry Year Volume Missed	0
		Shortfall	4,305,888
		Average/year	391,444
		Wet year shortfall	3,874
		Dry year shortfall	819,443

**Comparison of Current Roof Catchment and Current Storage plus (4) Additional 13 m<sup>3</sup> Tanks Serving Current and Projected Total MRC Population**

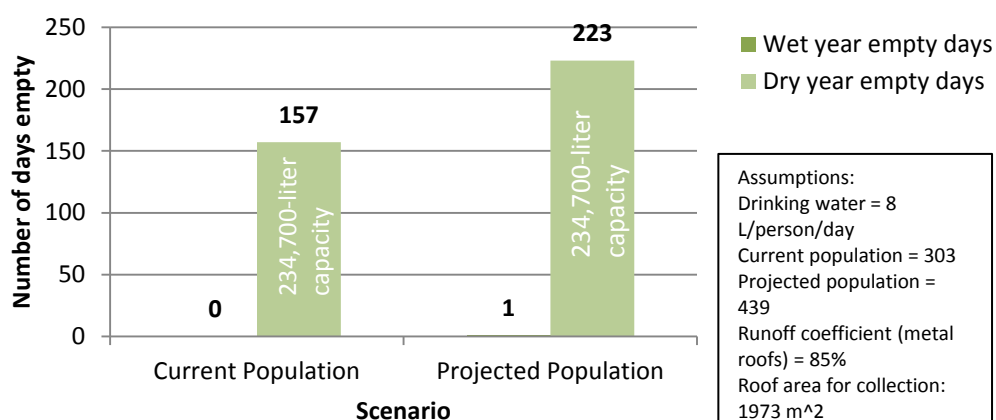


### Appendix W-4h. One Village house, only that family drinks

<b>Scenario 15: 1 MRC Village house, only family drinks</b>		Empty Days	1,689
Tank Size	1000	Average/year	154
Number of Village Homes	1	Dry Year Empty Days	251
Total tank volume	1000	Wet Year Empty Days	79
One roof area	22	Volume Missed	25,339
Total Roof	22	Average/year	2,304
Number individuals	5	Wet Year Volume Missed	5,621
Personal daily use	8	Dry Year Volume Missed	0
Daily Use	40	Shortfall	70,691
Run-off Coefficient	85%	Average/year	6,426
		Wet year shortfall	3,295
		Dry year shortfall	10,365

<b>Scenario 16: 1 MRC Village house * 1.33 population</b>		Empty Days	2,171
Tank Size	1000	Average/year	197
Number of Village Homes	1	Dry Year Empty Days	273
Total tank volume	1000	Wet Year Empty Days	128
One roof area	22	Volume Missed	17,421
Total Roof	22	Average/year	1,584
Number individuals	7	Wet Year Volume Missed	4,628
Personal daily use	8	Dry Year Volume Missed	0
Daily Use	53	Shortfall	120,753
Run-off Coefficient	85%	Average/year	10,978
		Wet year shortfall	7,020
		Dry year shortfall	14,979

**Comparison of 1 Village House Roof and 1000 liter tank serving 1 current village family or 1 village family plus projected population increase of 33%**

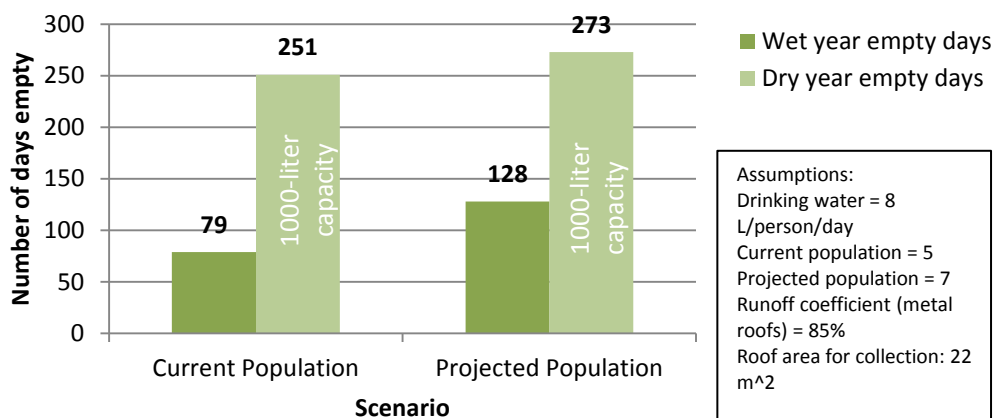


## Appendix W-4i. Library, everyone drinks

<b>Scenario 67: Library roof, current storage, all drink current pop</b>		Empty Days	1,024
Current tank capacity	26000	Average/year	93
Total roof area	199	Dry Year Empty Days	215
Population	303	Wet Year Empty Days	0
Personal daily use	8	Volume Missed	59,951
Daily Use	2424	Average/year	5,450
Run-off Coefficient	85%	Wet Year Volume Missed	23,749
Tank proportion of Total Storage	14%	Dry Year Volume Missed	0
Daily use as proportion	345	Shortfall	370,500
		Average/year	33,682
		Wet year shortfall	0
		Dry year shortfall	76,359

<b>Scenario 91: Library roof, current storage + 13000 L, all drink current pop</b>		Empty Days	1,844
Tank capacity	39000	Average/year	168
Total roof area	199	Dry Year Empty Days	265
Population	303	Wet Year Empty Days	75
Personal daily use	8	Volume Missed	4,997
Daily Use	2424	Average/year	454
Run-off Coefficient	85%	Wet Year Volume Missed	4,997
Tank proportion of Total Storage	20%	Dry Year Volume Missed	0
Daily use as proportion	483	Shortfall	932,650
		Average/year	84,786
		Wet year shortfall	37,958
		Dry year shortfall	133,024

**Volume Missed from Library Building Roof with Current Storage and Current Storage plus (1) 13000 Liter Tank (Serving Current Population)**

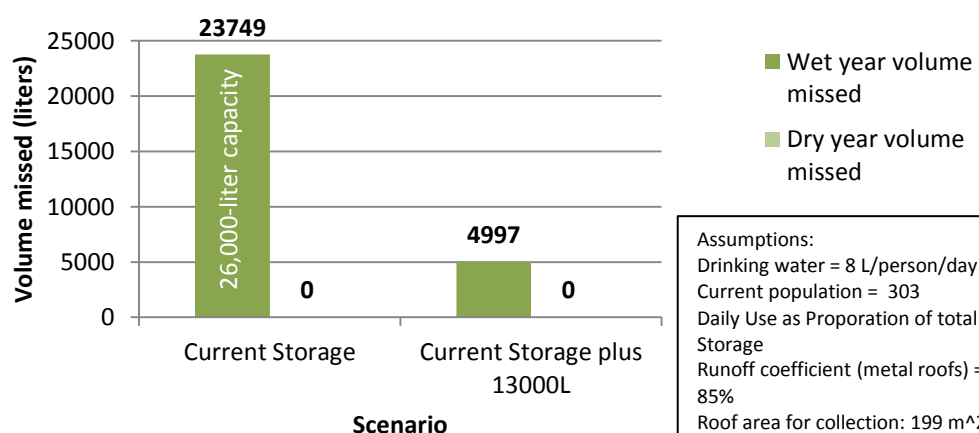


## Appendix W-4j. Library, projected population

<b>Scenario 68: Library roof, current storage, all drink 2 x visitors + 1.3 x villagers</b>			
		Empty Days	2,010
Current tank capacity	26000	Average/year	183
Total roof area	199	Dry Year Empty Days	275
Population	446	Wet Year Empty Days	99
Personal daily use	8	Volume Missed	20,906
Daily Use	3568	Average/year	1,901
Run-off Coefficient	85%	Wet Year Volume Missed	17,528
Tank proportion of Total Storage	0.14	Dry Year Volume Missed	0
Daily use as proportion	507.76	Shortfall	1,068,667
		Average/year	97,152
		Wet year shortfall	52,679
		Dry year shortfall	144,678

<b>Scenario 92: Library roof, current storage + 13000 L, only visitors drink, all drink 2 x visitors + 1.3 x villagers</b>			
		Empty Days	2,636
Tank capacity	39000	Average/year	240
Total roof area	199	Dry Year Empty Days	304
Population	446	Wet Year Empty Days	181
Personal daily use	8	Volume Missed	774
Daily Use	3568	Average/year	70
Run-off Coefficient	85%	Wet Year Volume Missed	774
Tank proportion of Total Storage	0.20	Dry Year Volume Missed	0
Daily use as proportion	711.05	Shortfall	1,957,202
		Average/year	177,927
		Wet year shortfall	134,124
		Dry year shortfall	223,263

**Volume Missed from Library Building Roof with Current Storage and Current Storage plus (1) 13000 Liter Tank (Serving Projected Population)**

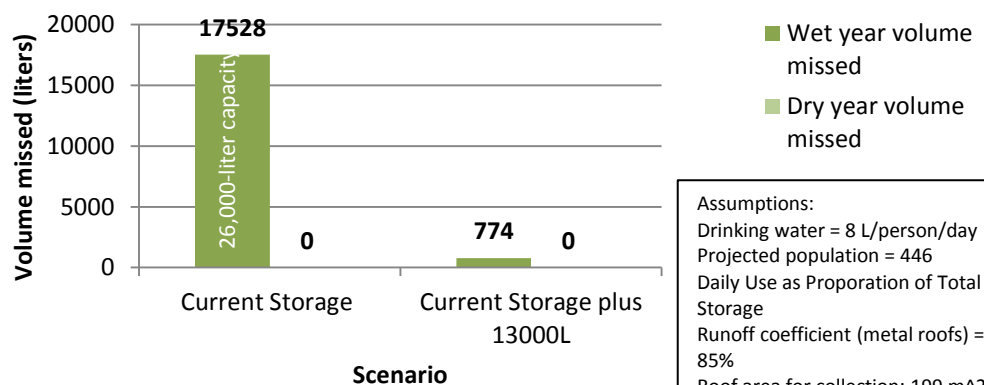


## Appendix W-4k. Admin block, current population

<b>Scenario 69: Admin block roof, current storage, all drink current pop</b>		Empty Days	
Current tank capacity	12000	Average/year	3
Total roof area	112	Dry Year Empty Days	34
Average number visitors (MRC+Campsite)	64	Wet Year Empty Days	0
Villagers	0	Volume Missed	484,228
Personal Daily Use	8	Average/year	44,021
Daily Use	512	Wet Year Volume Missed	68,181
Run-off Coefficient	85%	Dry Year Volume Missed	0
Tank proportion of Total Storage	7%	Shortfall	1,146
Daily use as proportion	33.63	Average/year	104
		Wet year shortfall	0
		Dry year shortfall	1,146

<b>Scenario 93: Admin block roof, current storage + 12000 L, all drink current pop</b>		Empty Days	
Tank capacity	24000	Average/year	4
Total roof area	112	Dry Year Empty Days	47
Average number visitors (MRC+Campsite)	64	Wet Year Empty Days	0
Villagers	0	Volume Missed	355,561
Personal Daily Use	8	Average/year	32,324
Daily Use	512	Wet Year Volume Missed	57,501
Run-off Coefficient	85%	Dry Year Volume Missed	0
Tank proportion of Total Storage	12%	Shortfall	2,974
Daily use as proportion	63.11	Average/year	270
		Wet year shortfall	0
		Dry year shortfall	2,974

### Volume Missed from Admin Block Building Roof with Current Storage and Current Storage plus (1) 12000 Liter Tank (Serving Current Population)

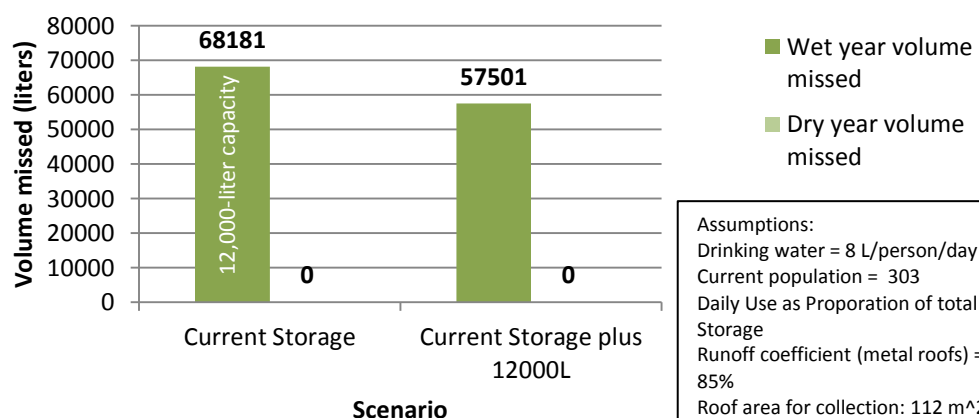


## Appendix W-4I. Admin block, projected population

<b>Scenario 70: Admin block roof, current storage, all drink 2 x visitors + 1.3 x villagers</b>		Empty Days	1,567
Current tank capacity	12000	Average/year	142
Total roof area	112	Dry Year Empty Days	250
Average number visitors (MRC+Campsite)	128	Wet Year Empty Days	45
Villagers	318	Volume Missed	29,614
Personal Daily Use	8	Average/year	2,692
Daily Use	3568	Wet Year Volume Missed	13,475
Run-off Coefficient	85%	Dry Year Volume Missed	0
Tank proportion of Total Storage	7%	Shortfall	385,710
Daily use as proportion	234.35	Average/year	35,065
		Wet year shortfall	11,416
		Dry year shortfall	60,297

<b>Scenario 94: Admin block roof, current storage + 12000 L, all drink 2 x visitors + 1.3 x villagers</b>		Empty Days	2,781
Tank capacity	24000	Average/year	253
Total roof area	112	Dry Year Empty Days	312
Average number visitors (MRC+Campsite)	128	Wet Year Empty Days	200
Villagers	318	Volume Missed	0
Personal Daily Use	8	Average/year	0
Daily Use	3568	Wet Year Volume Missed	0
Run-off Coefficient	85%	Dry Year Volume Missed	0
Tank proportion of Total Storage	12%	Shortfall	1,282,210
Daily use as proportion	439.82	Average/year	116,565
		Wet year shortfall	92,939
		Dry year shortfall	141,417

**Volume Missed from Admin Block Building Roof with Current Storage and Current Storage plus (1) 12000 Liter Tank (Serving Projected Population)**

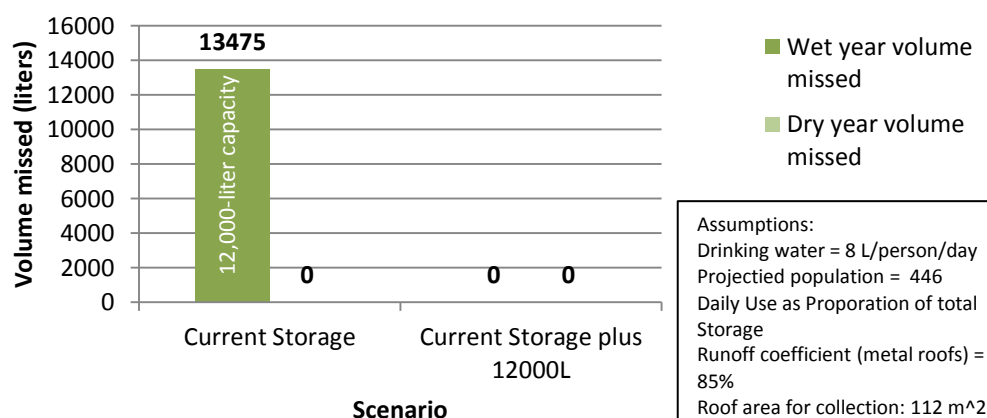


## Appendix W-4m. McCormack lab, current population

<b>Scenario 71: McCormack lab roof, current storage, all drink current pop</b>		Empty Days	2,285
Current tank capacity	39000	Average/year	208
Total roof area	175	Dry Year Empty Days	290
Average number visitors (MRC+Campsite)	64	Wet Year Empty Days	134
Villagers	239	Volume Missed	0
Personal Daily Use	8	Average/year	0
Daily Use	2424	Wet Year Volume Missed	0
Run-off Coefficient	85%	Dry Year Volume Missed	0
Tank proportion of Total Storage	21%	Shortfall	1,239,092
Daily use as proportion	517.44	Average/year	112,645
		Wet year shortfall	73,899
		Dry year shortfall	155,006

<b>Scenario 95: McCormack lab roof, current storage + 13000 L, all drink current pop</b>		Empty Days	2,672
Tank capacity	52000	Average/year	243
Total roof area	175	Dry Year Empty Days	305
Average number visitors (MRC+Campsite)	64	Wet Year Empty Days	185
Villagers	239	Volume Missed	0
Personal Daily Use	8	Average/year	0
Daily Use	2424	Wet Year Volume Missed	0
Run-off Coefficient	85%	Dry Year Volume Missed	0
Tank proportion of Total Storage	27%	Shortfall	1,806,516
Daily use as proportion	644.09	Average/year	164,229
		Wet year shortfall	125,909
		Dry year shortfall	203,765

**Volume Missed from McCormack Lab Roof with Current Storage and Current Storage plus (1) 13000 Liter Tank (Serving Current Population)**

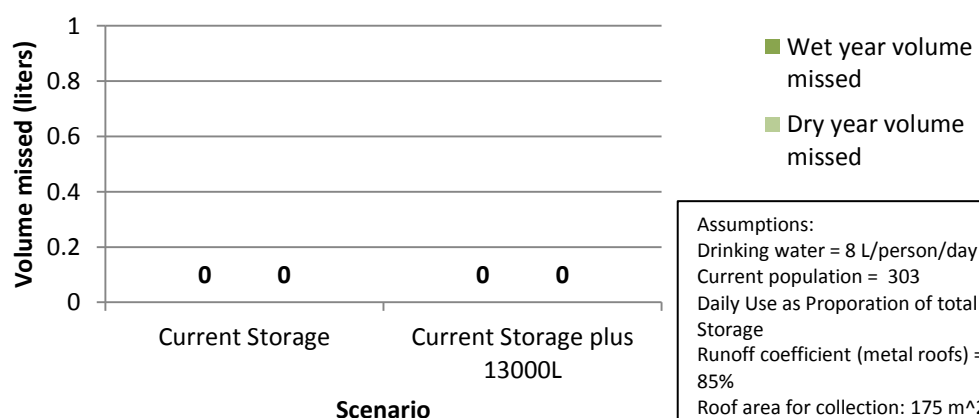


## Appendix W-4n. McCormack lab, projected population

<b>Scenario 72: McCormack lab roof, current storage, all drink 2 x visitors + 1.3 x villagers</b>		Empty Days	2,949
Current tank capacity	39000	Average/year	268
Total roof area	175	Dry Year Empty Days	320
Average number visitors (MRC+Campsite)	128	Wet Year Empty Days	221
Villagers	318	Volume Missed	0
Personal Daily Use	8	Average/year	0
Daily Use	3568	Wet Year Volume Missed	0
Run-off Coefficient	85%	Dry Year Volume Missed	0
Tank proportion of Total Storage	21%	Shortfall	2,337,544
Daily use as proportion	761.64	Average/year	212,504
		Wet year shortfall	175,626
		Dry year shortfall	250,044

<b>Scenario 96: McCormack lab roof, current storage + 13000 L, all drink 2 x visitors + 1.3 x villagers</b>		Empty Days	3,212
Tank capacity	52000	Average/year	292
Total roof area	175	Dry Year Empty Days	331
Average number visitors (MRC+Campsite)	128	Wet Year Empty Days	254
Villagers	318	Volume Missed	0
Personal Daily Use	8	Average/year	0
Daily Use	3568	Wet Year Volume Missed	0
Run-off Coefficient	85%	Dry Year Volume Missed	0
Tank proportion of Total Storage	27%	Shortfall	3,167,088
Daily use as proportion	948.06	Average/year	287,917
		Wet year shortfall	249,757
		Dry year shortfall	323,001

**Volume Missed from McCormack Lab Roof with Current Storage and Current Storage plus (1) 13000 Liter Tank (Serving Projected Population)**

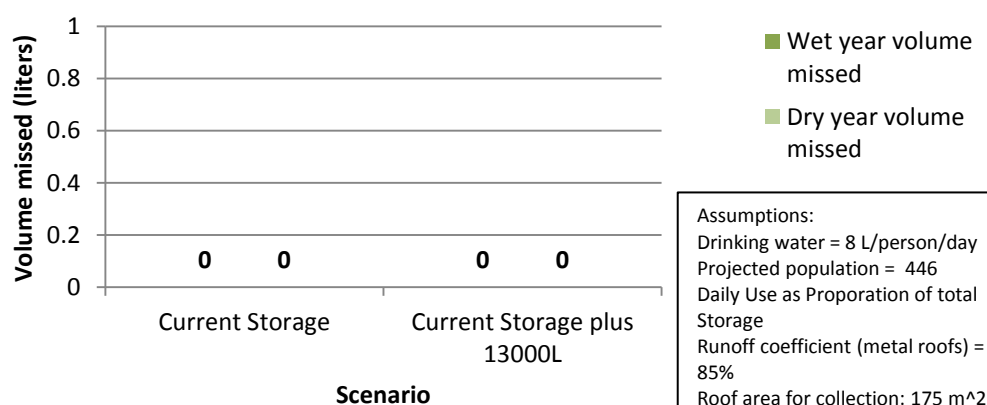


## Appendix W-4o. NSF lab, current population

<b>Scenario 73: NSF Lab roof, current storage, all drink current pop</b>		Empty Days	426
Current tank capacity	13000	Average/year	39
Total roof area	175	Dry Year Empty Days	162
Average number visitors (MRC+Campsite)	64	Wet Year Empty Days	0
Villagers	239	Volume Missed	349,155
Personal Daily Use	8	Average/year	31,741
Daily Use	2424	Wet Year Volume Missed	63,919
Run-off Coefficient	85%	Dry Year Volume Missed	0
Tank proportion of Total Storage	7%	Shortfall	75,514
Daily use as proportion	172.48	Average/year	6,865
		Wet year shortfall	0
		Dry year shortfall	28,434

<b>Scenario 97: NSF Lab roof, current storage + 13000 L, all drink current pop</b>		Empty Days	2,116
Tank capacity	26000	Average/year	192
Total roof area	175	Dry Year Empty Days	280
Average number visitors (MRC+Campsite)	64	Wet Year Empty Days	108
Villagers	239	Volume Missed	11,756
Personal Daily Use	8	Average/year	1,069
Daily Use	2424	Wet Year Volume Missed	11,756
Run-off Coefficient	85%	Dry Year Volume Missed	0
Tank proportion of Total Storage	13%	Shortfall	1,057,105
Daily use as proportion	322.04	Average/year	96,100
		Wet year shortfall	54,263
		Dry year shortfall	137,935

**Volume Missed from NSF Lab Roof with Current Storage and Current Storage plus (1) 13000 Liter Tank (Serving Current Population)**

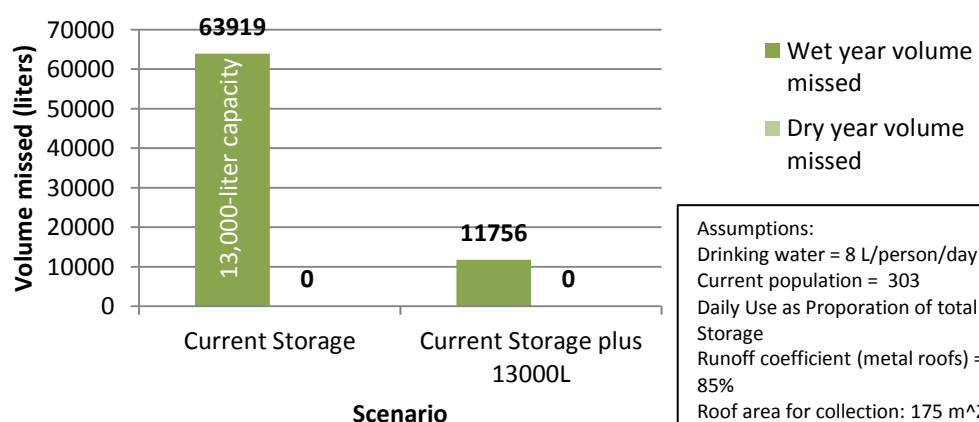


## Appendix W-4p. NSF lab, projected population

<b>Scenario 74: NSF Lab roof, current storage, only visitors drink, all drink 2 x visitors + 1.3 x villagers</b>		Empty Days	965
Current tank capacity	13000	Average/year	88
Total roof area	175	Dry Year Empty Days	218
Average number visitors (MRC+Campsite)	128	Wet Year Empty Days	14
Villagers	318	Volume Missed	185,312
Personal Daily Use	8	Average/year	16,847
Daily Use	3568	Wet Year Volume Missed	41,523
Run-off Coefficient	85%	Dry Year Volume Missed	0
Tank proportion of Total Storage	7%	Shortfall	254,968
Daily use as proportion	253.88	Average/year	23,179
		Wet year shortfall	3,825
		Dry year shortfall	254,968

<b>Scenario 98: NSF Lab roof, current storage + 13000 L, only visitors drink, all drink 2 x visitors + 1.3 x villagers</b>		Empty Days	2,116
Tank capacity	26000	Average/year	192
Total roof area	175	Dry Year Empty Days	280
Average number visitors (MRC+Campsite)	128	Wet Year Empty Days	108
Villagers	318	Volume Missed	11,756
Personal Daily Use	8	Average/year	1,069
Daily Use	3568	Wet Year Volume Missed	11,756
Run-off Coefficient	85%	Dry Year Volume Missed	0
Tank proportion of Total Storage	13%	Shortfall	1,057,105
Daily use as proportion	474.03	Average/year	96,100
		Wet year shortfall	54,263
		Dry year shortfall	137,935

**Volume Missed from NSF Lab Roof with Current Storage and Current Storage plus (1) 13000 Liter Tank (Serving Projected Population)**

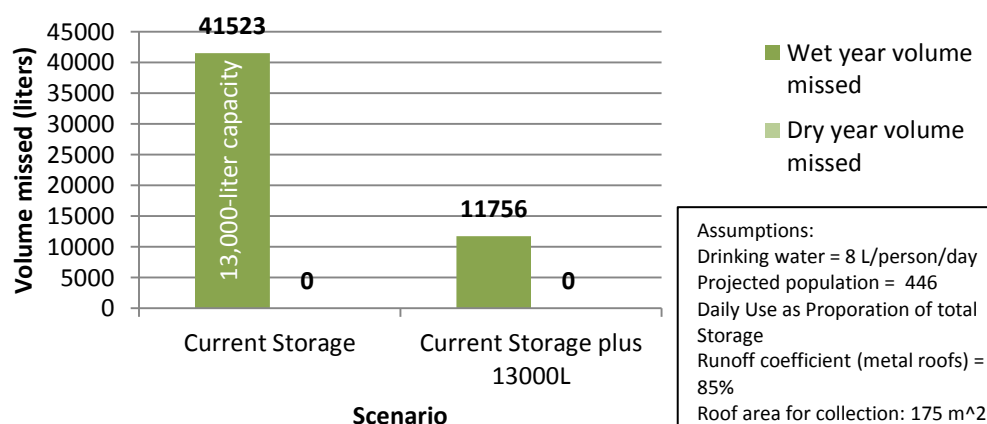


## Appendix W-4q. Mess hall, current population

<b>Scenario 75: Mess Hall roof, current storage, all drink current pop</b>		Empty Days	318
Current tank capacity	16900	Average/year	29
Total roof area	286	Dry Year Empty Days	136
Average number visitors (MRC+Campsite)	64	Wet Year Empty Days	0
Villagers	239	Volume Missed	760,337
Personal Daily Use	8	Average/year	69,122
Daily Use	2424	Wet Year Volume Missed	124,699
Run-off Coefficient	85%	Dry Year Volume Missed	0
Tank proportion of Total Storage	9%	Shortfall	72,954
Daily use as proportion	224.22	Average/year	6,632
		Wet year shortfall	0
		Dry year shortfall	31,319

<b>Scenario 99: Mess Hall roof, current storage + 7450, all drink current pop</b>		Empty Days	453
Tank capacity	24350	Average/year	41
Total roof area	286	Dry Year Empty Days	167
Average number visitors (MRC+Campsite)	64	Wet Year Empty Days	0
Villagers	239	Volume Missed	473,050
Personal Daily Use	8	Average/year	43,005
Daily Use	2424	Wet Year Volume Missed	94,448
Run-off Coefficient	85%	Dry Year Volume Missed	0
Tank proportion of Total Storage	13%	Shortfall	145,643
Daily use as proportion	310.41	Average/year	13,240
		Wet year shortfall	0
		Dry year shortfall	53,216

**Volume Missed from Mess Hall Roof with Current Storage and Current Storage plus (1) 7450 Liter Tank (Serving Current Population)**

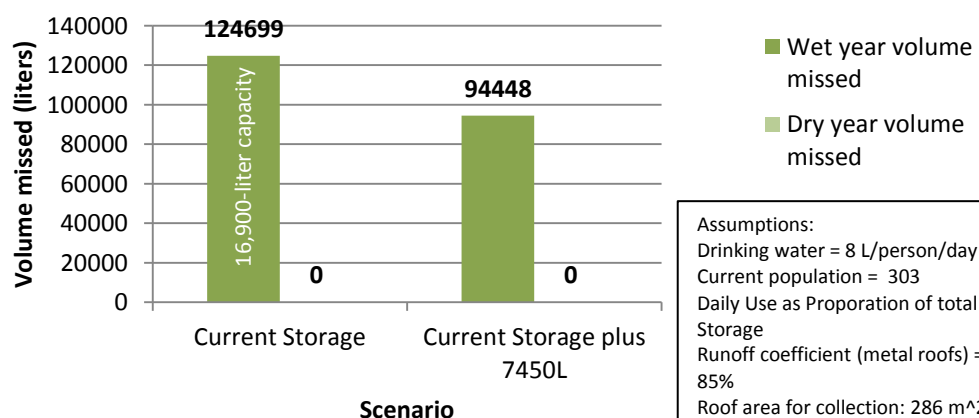


## Appendix W-4r. Mess hall, projected population

<b>Scenario 76: Mess Hall roof, current storage, all drink 2 x visitors + 1.3 x villagers</b>		Empty Days	780
Current tank capacity	16900	Average/year	71
Total roof area	286	Dry Year Empty Days	200
Average number visitors (MRC+Campsite)	128	Wet Year Empty Days	10
Villagers	318	Volume Missed	511,301
Personal Daily Use	8	Average/year	46,482
Daily Use	3568	Wet Year Volume Missed	92,405
Run-off Coefficient	85%	Dry Year Volume Missed	0
Tank proportion of Total Storage	9%	Shortfall	269,716
Daily use as proportion	330.04	Average/year	24,520
		Wet year shortfall	3,943
		Dry year shortfall	67,732

<b>Scenario 100: Mess Hall roof, current storage + 7450, all drink 2 x visitors + 1.3 x villagers</b>		Empty Days	1,043
Tank capacity	24350	Average/year	95
Total roof area	286	Dry Year Empty Days	220
Average number visitors (MRC+Campsite)	128	Wet Year Empty Days	0
Villagers	318	Volume Missed	208,282
Personal Daily Use	8	Average/year	18,935
Daily Use	3568	Wet Year Volume Missed	54,762
Run-off Coefficient	85%	Dry Year Volume Missed	0
Tank proportion of Total Storage	13%	Shortfall	496,194
Daily use as proportion	456.91	Average/year	45,109
		Wet year shortfall	6,422
		Dry year shortfall	103,311

**Volume Missed from Mess Hall Roof with Current Storage and Current Storage plus (1) 7450 Liter Tank (Serving Projected Population)**

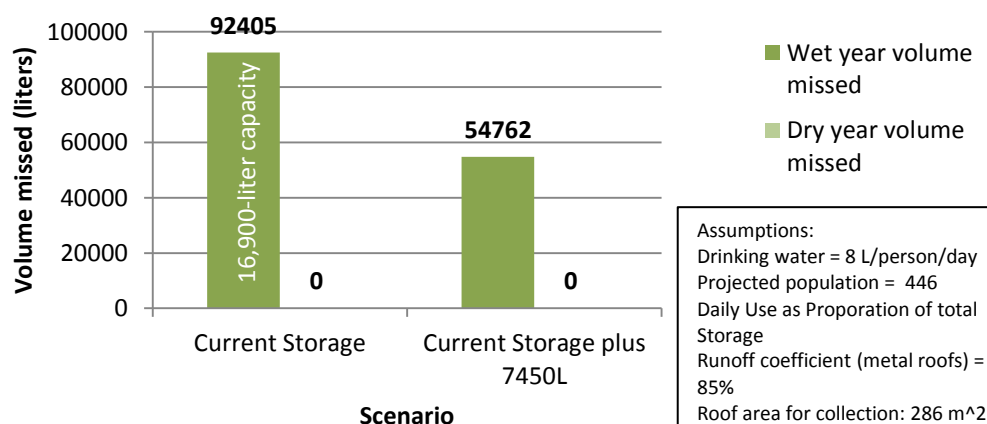


## Appendix W-4s. Small kitchen, current population

<b>Scenario 77: Small kitchen roof, current storage, all drink current pop</b>		Empty Days	130
Current tank capacity	2000	Average/year	12
Total roof area	66	Dry Year Empty Days	48
Average number visitors (MRC+Campsite)	64	Wet Year Empty Days	0
Villagers	239	Volume Missed	266,085
Personal Daily Use	8	Average/year	24,190
Daily Use	2424	Wet Year Volume Missed	37,733
Run-off Coefficient	85%	Dry Year Volume Missed	0
Tank proportion of Total Storage	1%	Shortfall	3,567
Daily use as proportion	26.54	Average/year	324
		Wet year shortfall	0
		Dry year shortfall	1,328

<b>Scenario 101: Small kitchen roof, current storage + 2000, all drink current pop</b>		Empty Days	318
Tank capacity	4000	Average/year	29
Total roof area	66	Dry Year Empty Days	137
Average number visitors (MRC+Campsite)	64	Wet Year Empty Days	0
Villagers	239	Volume Missed	172,635
Personal Daily Use	8	Average/year	15,694
Daily Use	2424	Wet Year Volume Missed	28,513
Run-off Coefficient	85%	Dry Year Volume Missed	0
Tank proportion of Total Storage	2%	Shortfall	17,147
Daily use as proportion	52.50	Average/year	1,559
		Wet year shortfall	0
		Dry year shortfall	7,377

**Volume Missed from Small Kitchen Roof with Current Storage and Current Storage plus (1) 2000 Liter Tank (Serving Current Population)**

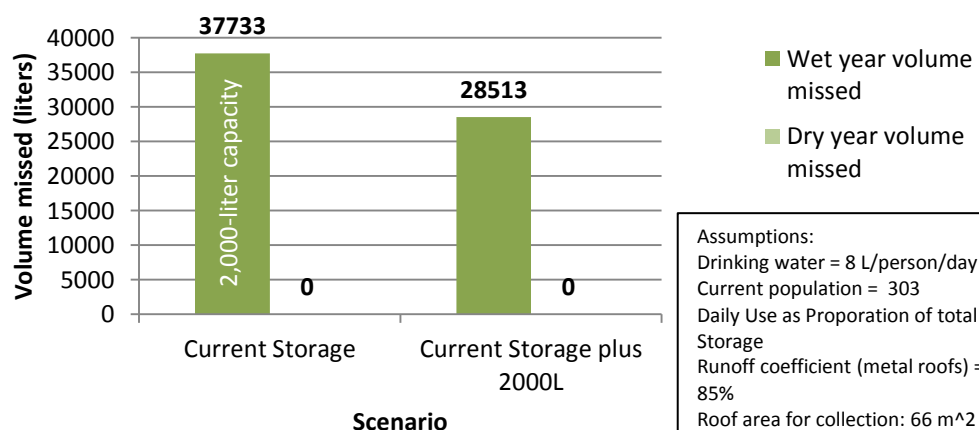


## Appendix W-4t. Small kitchen, projected population

<b>Scenario 78: Small kitchen roof, current storage, all drink 2 x visitors + 1.3 x villagers</b>		Empty Days	
Current tank capacity	2000	Average/year	34
Total roof area	66	Dry Year Empty Days	130
Average number visitors (MRC+Campsite)	128	Wet Year Empty Days	0
Villagers	318	Volume Missed	226,496
Personal Daily Use	8	Average/year	20,591
Daily Use	3568	Wet Year Volume Missed	33,366
Run-off Coefficient	85%	Dry Year Volume Missed	0
Tank proportion of Total Storage	1%	Shortfall	15,152
Daily use as proportion	39.06	Average/year	1,377
		Wet year shortfall	0
		Dry year shortfall	5,202

<b>Scenario 102: Small kitchen roof, current storage + 2000 L, all drink 2 x visitors + 1.3 x villagers</b>		Empty Days	
Tank capacity	4000	Average/year	71
Total roof area	66	Dry Year Empty Days	200
Average number visitors (MRC+Campsite)	128	Wet Year Empty Days	10
Villagers	318	Volume Missed	114,501
Personal Daily Use	8	Average/year	10,409
Daily Use	3568	Wet Year Volume Missed	20,961
Run-off Coefficient	85%	Dry Year Volume Missed	0
Tank proportion of Total Storage	2%	Shortfall	63,402
Daily use as proportion	77.27	Average/year	5,764
		Wet year shortfall	897
		Dry year shortfall	15,901

**Volume Missed from Small Kitchen Roof with Current Storage and Current Storage plus (1) 2000 Liter Tank (Serving Projected Population)**

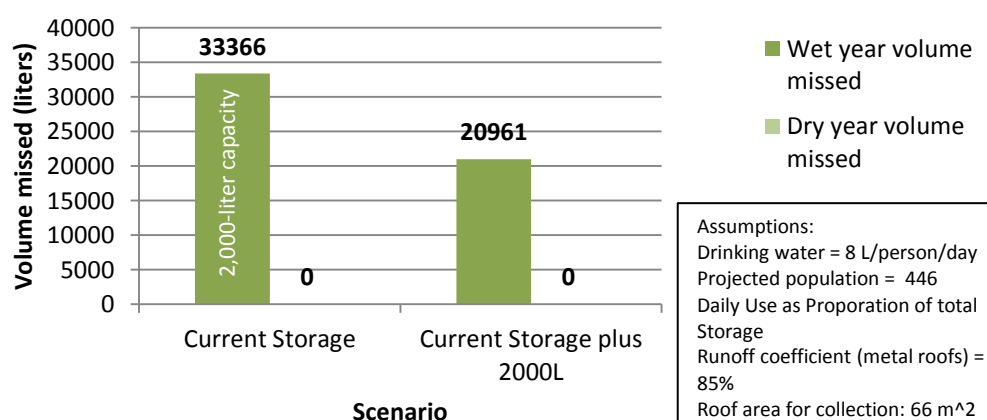


## Appendix W-4u. Director's house, current population

<b>Scenario 79: Director's house roof, current storage, all drink current pop</b>		Empty Days	289
Current tank capacity	7000	Average/year	26
Total roof area	130	Dry Year Empty Days	123
Population	303	Wet Year Empty Days	0
Personal daily use	8	Volume Missed	377,412
Daily Use	2424	Average/year	34,310
Run-off Coefficient	85%	Wet Year Volume Missed	59,857
Tank proportion	4%	Dry Year Volume Missed	0
Daily use as proportion	92.87	Shortfall	27,449
		Average/year	2,495
		Wet year shortfall	0
		Dry year shortfall	11,729

<b>Scenario 103: Director's house roof, current storage + 7000 L, all drink current pop</b>		Empty Days	661
Tank capacity	14000	Average/year	60
Total roof area	130	Dry Year Empty Days	185
Population	303	Wet Year Empty Days	0
Personal daily use	8	Volume Missed	115,926
Total daily Use	2424	Average/year	10,539
Run-off Coefficient	85%	Wet Year Volume Missed	29,664
Tank proportion of total storage	7%	Dry Year Volume Missed	0
Daily use as proportion of total storage	178.89	Shortfall	123,522
		Average/year	11,229
		Wet year shortfall	0
		Dry year shortfall	34,089

**Comparison of volume missed (L) from Director's house at current tank capacity and +7000 L capacity with current population**

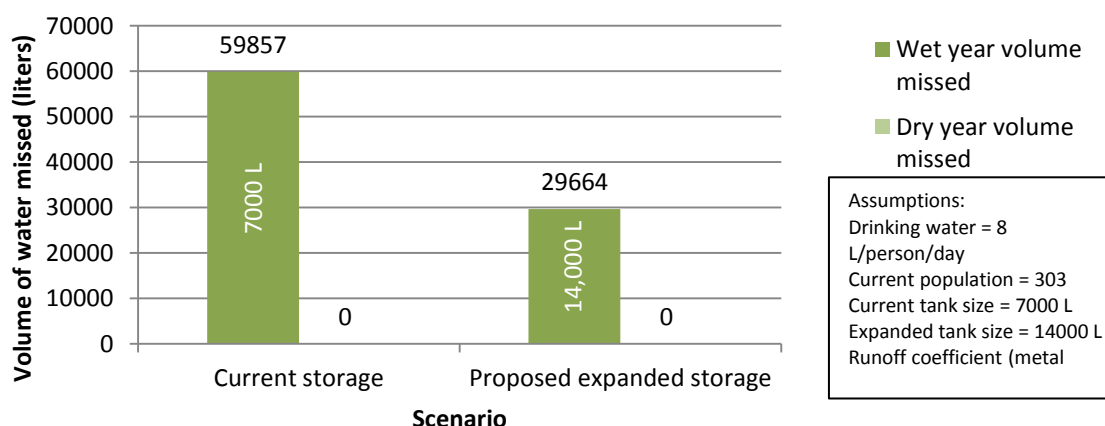


## Appendix W-4v. Director's house, projected population

<b>Scenario 80: Director's house roof, current storage, all drink 2 x visitors + 1.3 x villagers</b>			
		Empty Days	718
Current tank capacity	7000	Average/year	65
Total roof area	130	Dry Year Empty Days	192
Population	446	Wet Year Empty Days	8
Personal daily use	8	Volume Missed	268,231
Daily Use	3568	Average/year	24,385
Run-off Coefficient	85%	Wet Year Volume Missed	45,853
Tank proportion	4%	Dry Year Volume Missed	0
Daily use as proportion	136.70	Shortfall	102,271
		Average/year	9,297
		Wet year shortfall	1,422
		Dry year shortfall	26,985

<b>Scenario 104: Director's house roof, current storage + 7000 L, all drink 2 x visitors + 1.3 x villagers</b>			
		Empty Days	1,476
Tank capacity	14000	Average/year	134
Total roof area	130	Dry Year Empty Days	242
Average number visitors (MRC+Campsite)	128	Wet Year Empty Days	33
Villagers	318	Volume Missed	35,667
Personal Daily Use	8	Average/year	3,242
Daily Use	3568	Wet Year Volume Missed	15,735
Run-off Coefficient	85%	Dry Year Volume Missed	0
Tank proportion	7%	Shortfall	409,620
Daily use as proportion	263.32	Average/year	37,238
		Wet year shortfall	9,506
		Dry year shortfall	65,824

**Comparison of volume missed (L) from Director's house at current tank capacity and +7000 L capacity with projected population growth**

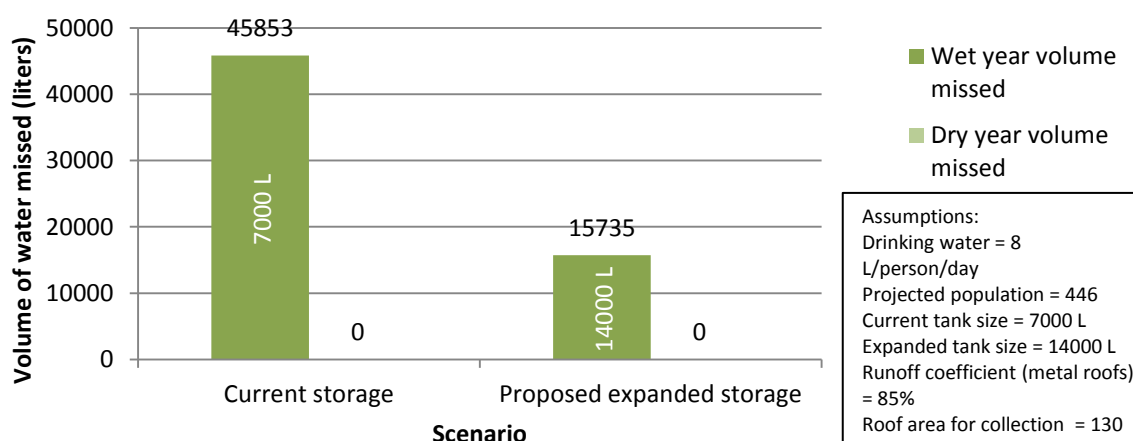


## Appendix W-4w. GIS house, current population

<b>Scenario 81: GIS House roof, current storage, all drink current pop</b>		Empty Days	490
Current tank capacity	13000	Average/year	45
Total roof area	155	Dry Year Empty Days	172
Average number visitors (MRC+Campsite)	64	Wet Year Empty Days	0
Villagers	239	Volume Missed	247,525
Personal Daily Use	8	Average/year	22,502
Daily Use	2424	Wet Year Volume Missed	49,695
Run-off Coefficient	85%	Dry Year Volume Missed	0
Tank proportion	7%	Shortfall	88,128
Daily use as proportion	172.48	Average/year	8,012
		Wet year shortfall	0
		Dry year shortfall	30,466

<b>Scenario 105: GIS House roof, current storage + 13000 L, all drink current pop</b>		Empty Days	1,439
Tank capacity	26000	Average/year	131
Total roof area	155	Dry Year Empty Days	243
Average number visitors (MRC+Campsite)	64	Wet Year Empty Days	2
Villagers	239	Volume Missed	9,299
Personal Daily Use	8	Average/year	845
Daily Use	2424	Wet Year Volume Missed	9,299
Run-off Coefficient	85%	Dry Year Volume Missed	0
Tank proportion	13%	Shortfall	487,038
Daily use as proportion	322.04	Average/year	44,276
		Wet year shortfall	839
		Dry year shortfall	80,757

**Comparison of volume missed (L) GIS house at current tank capacity and +13000 L capacity with current population**

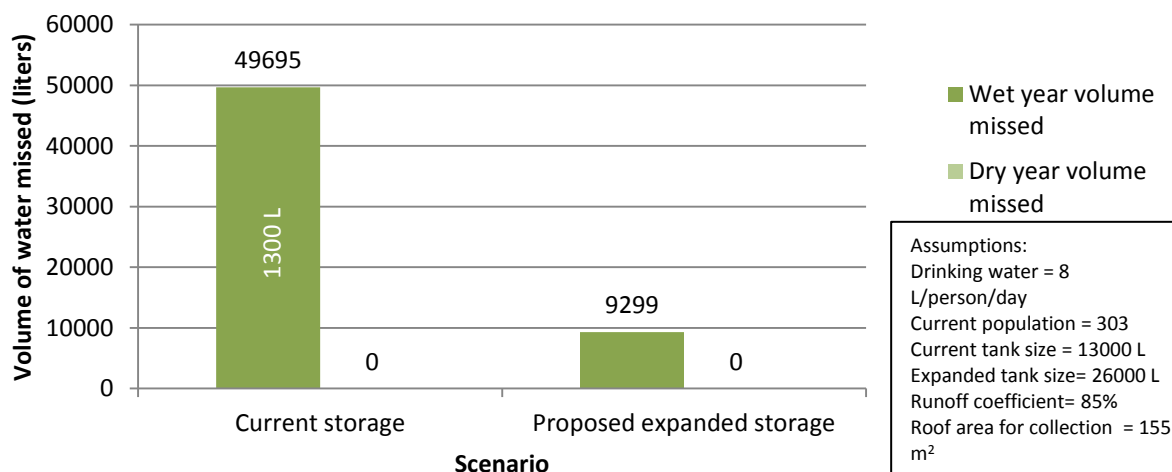


## Appendix W-4x. GIS house, projected population

<b>Scenario 82: GIS House roof, current storage, all drink 2 x visitors + 1.3 x villagers</b>		Empty Days	1,098
Current tank capacity	13000	Average/year	100
Total roof area	155	Dry Year Empty Days	225
Average number visitors (MRC+Campsite)	128	Wet Year Empty Days	15
Villagers	318	Volume Missed	107,551
Personal Daily Use	8	Average/year	9,777
Daily Use	3568	Wet Year Volume Missed	28,386
Run-off Coefficient	85%	Dry Year Volume Missed	0
Tank proportion	7%	Shortfall	290,701
Daily use as proportion	253.88	Average/year	26,427
		Wet year shortfall	4,165
		Dry year shortfall	58,289

<b>Scenario 106: GIS House roof, current storage + 13000 L, all drink 2 x visitors + 1.3 x villagers</b>		Empty Days	2,373
Tank capacity	26000	Average/year	216
Total roof area	155	Dry Year Empty Days	294
Average number visitors (MRC+Campsite)	128	Wet Year Empty Days	143
Villagers	318	Volume Missed	6,412
Personal Daily Use	8	Average/year	583
Daily Use	3568	Wet Year Volume Missed	6,412
Run-off Coefficient	85%	Dry Year Volume Missed	0
Tank proportion	13%	Shortfall	1,174,999
Daily use as proportion	474.03	Average/year	106,818
		Wet year shortfall	71,896
		Dry year shortfall	143,399

**Comparison of volume missed (L) from GIS house at current tank capacity and +13000 L capacity with projected population growth**

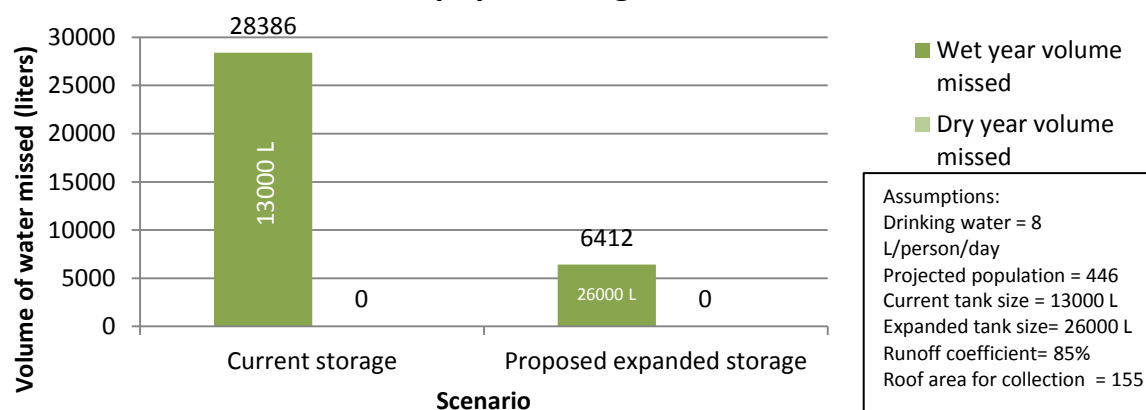


## Appendix W-4y. Klee house, current population

<b>Scenario 83: KLEE House roof, current storage, all drink current pop</b>			
		Empty Days	490
Current tank capacity	13000	Average/year	45
Total roof area	155	Dry Year Empty Days	172
Average number visitors (MRC+Campsite)	64	Wet Year Empty Days	0
Villagers	239	Volume Missed	247,525
Personal Daily Use	8	Average/year	22,502
Daily Use	2424	Wet Year Volume Missed	49,695
Run-off Coefficient	85%	Dry Year Volume Missed	0
Tank proportion	7%	Shortfall	88,128
Daily use as proportion	172.48	Average/year	8,012
		Wet year shortfall	0
		Dry year shortfall	30,466

<b>Scenario 107: KLEE House roof, current storage + 13000 L, all drink current pop</b>			
		Empty Days	1,439
Tank capacity	26000	Average/year	131
Total roof area	155	Dry Year Empty Days	243
Average number visitors (MRC+Campsite)	64	Wet Year Empty Days	2
Villagers	239	Volume Missed	9,299
Personal Daily Use	8	Average/year	845
Daily Use	2424	Wet Year Volume Missed	9,299
Run-off Coefficient	85%	Dry Year Volume Missed	0
Tank proportion	13%	Shortfall	487,038
Daily use as proportion	322.04	Average/year	44,276
		Wet year shortfall	839
		Dry year shortfall	80,757

**Comparison of volume missed (L) from KLEE house at current tank capacity and +13000 L capacity with current population**

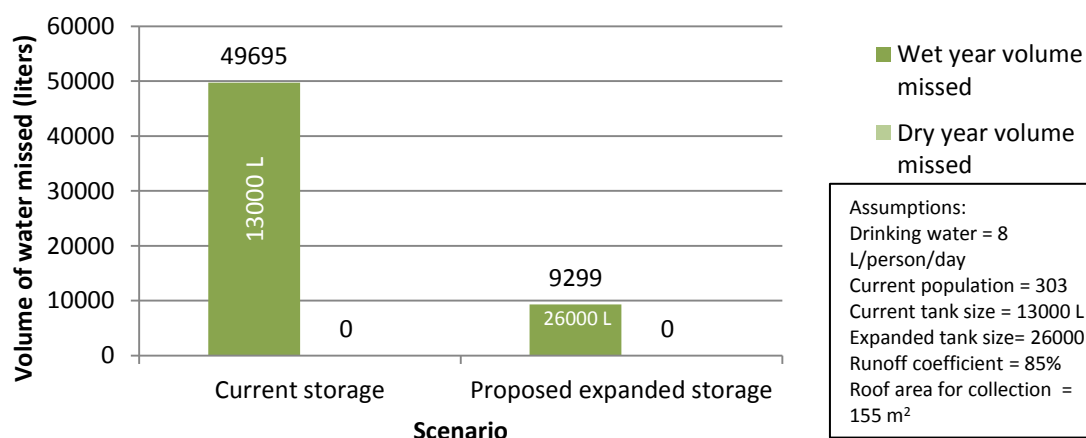


## Appendix W-4z. Klee house, projected population

<b>Scenario 84: KLEE House roof, current storage, all drink 2 x visitors + 1.3 x villagers</b>			
		Empty Days	1,523
Current tank capacity	13000	Average/year	138
Total roof area	155	Dry Year Empty Days	241
Average number visitors (MRC+Campsite)	128	Wet Year Empty Days	65
Villagers	318	Volume Missed	207,911
Personal Daily Use	8	Average/year	18,901
Daily Use	3568	Wet Year Volume Missed	43,029
Run-off Coefficient	85%	Dry Year Volume Missed	0
Tank proportion	7%	Shortfall	403,587
Daily use as proportion	253.88	Average/year	36,690
		Wet year shortfall	17,107
		Dry year shortfall	63,173

<b>Scenario 108: KLEE House roof, current storage + 13000 L, all drink 2 x visitors + 1.3 x villagers</b>			
		Empty Days	2,373
Tank capacity	26000	Average/year	216
Total roof area	155	Dry Year Empty Days	294
Average number visitors (MRC+Campsite)	128	Wet Year Empty Days	143
Villagers	318	Volume Missed	6,412
Personal Daily Use	8	Average/year	583
Daily Use	3568	Wet Year Volume Missed	6,412
Run-off Coefficient	85%	Dry Year Volume Missed	0
Tank proportion	13%	Shortfall	1,174,999
Daily use as proportion	474.03	Average/year	106,818
		Wet year shortfall	71,896
		Dry year shortfall	143,399

**Comparison of volume missed (L) from KLEE house at current tank capacity and +13000 L capacity with projected population growth**

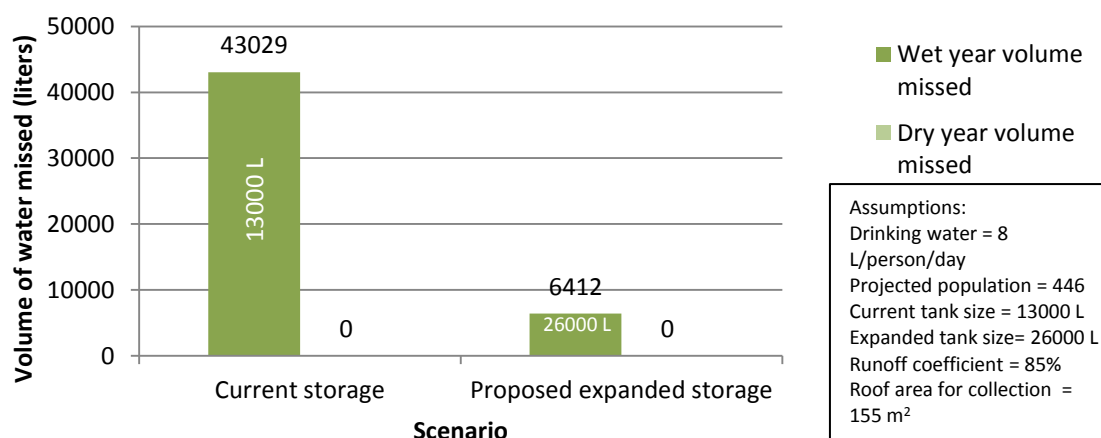


## Appendix W-4aa. Admin house, current population

<b>Scenario 85: Admin House roof, current storage, all drink current pop</b>		Empty Days	443
Current tank capacity	6900	Average/year	40
Total roof area	90	Dry Year Empty Days	164
Average number visitors (MRC+Campsite)	64	Wet Year Empty Days	0
Villagers	239	Volume Missed	170,506
Personal Daily Use	8	Average/year	15,501
Daily Use	2424	Wet Year Volume Missed	31,875
Run-off Coefficient	85%	Dry Year Volume Missed	0
Tank proportion	4%	Shortfall	41,623
Daily use as proportion	91.55	Average/year	3,784
		Wet year shortfall	0
		Dry year shortfall	15,384

<b>Scenario 109: Admin House roof, current storage + 6900 L, all drink current pop</b>		Empty Days	1,301
Tank capacity	13800	Average/year	118
Total roof area	90	Dry Year Empty Days	235
Average number visitors (MRC+Campsite)	64	Wet Year Empty Days	0
Villagers	239	Volume Missed	10,348
Personal Daily Use	8	Average/year	941
Daily Use	2424	Wet Year Volume Missed	6,897
Run-off Coefficient	85%	Dry Year Volume Missed	0
Tank proportion	7%	Shortfall	240,699
Daily use as proportion	176.43	Average/year	21,882
		Wet year shortfall	0
		Dry year shortfall	42,799

**Comparison of volume missed (L) from Admin house at current tank capacity and +6900 L capacity with current population**

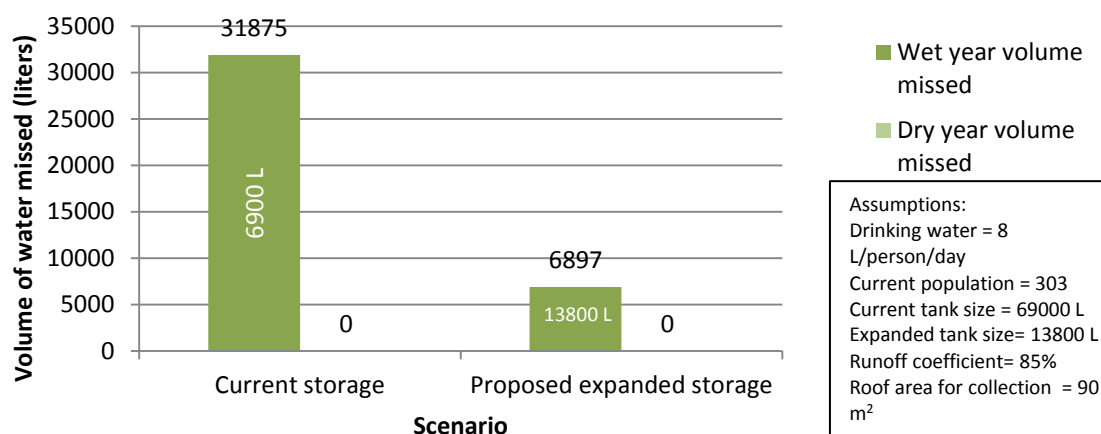


## Appendix W-4bb. Admin house, projected population

<b>Scenario 86: Admin House roof, current storage, all drink 2 x visitors + 1.3 x villagers</b>			
		Empty Days	992
Current tank capacity	6900	Average/year	90
Total roof area	90	Dry Year Empty Days	219
Average number visitors (MRC+Campsite)	128	Wet Year Empty Days	14
Villagers	318	Volume Missed	86,807
Personal Daily Use	8	Average/year	7,892
Daily Use	3568	Wet Year Volume Missed	20,144
Run-off Coefficient	85%	Dry Year Volume Missed	0
Tank proportion	4%	Shortfall	139,865
Daily use as proportion	134.75	Average/year	12,715
		Wet year shortfall	2,079
		Dry year shortfall	30,236

<b>Scenario 110: Admin House roof, current storage + 6900 L, all drink 2 x visitors + 1.3 x villagers</b>			
		Empty Days	2,254
Tank capacity	13800	Average/year	205
Total roof area	90	Dry Year Empty Days	288
Average number visitors (MRC+Campsite)	128	Wet Year Empty Days	126
Villagers	318	Volume Missed	5,315
Personal Daily Use	8	Average/year	483
Daily Use	3568	Wet Year Volume Missed	5,315
Run-off Coefficient	85%	Dry Year Volume Missed	0
Tank proportion	7%	Shortfall	614,126
Daily use as proportion	259.70	Average/year	55,830
		Wet year shortfall	34,728
		Dry year shortfall	77,190

**Comparison of volume missed (L) from Admin house at current tank capacity and +6900 L capacity with projected population growth**

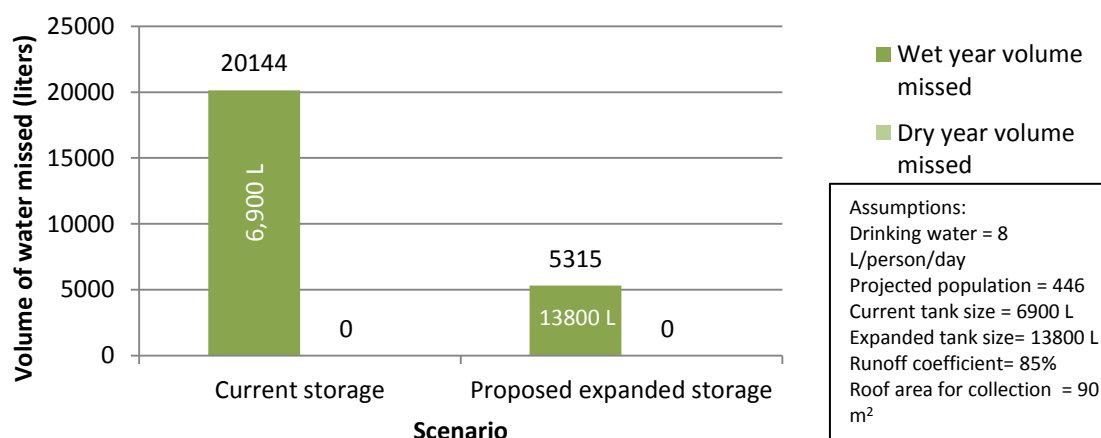


## Appendix W-4cc. Jenga house, current population

<b>Scenario 87: Jenga House roof, current storage, all drink current pop</b>		Empty Days	200
Current tank capacity	6900	Average/year	18
Total roof area	175	Dry Year Empty Days	77
Average number visitors (MRC+Campsite)	64	Wet Year Empty Days	0
Villagers	239	Volume Missed	627,368
Personal Daily Use	8	Average/year	57,033
Daily Use	2424	Wet Year Volume Missed	92,336
Run-off Coefficient	85%	Dry Year Volume Missed	0
Tank proportion	4%	Shortfall	18,628
Daily use as proportion	91.55	Average/year	1,693
		Wet year shortfall	0
		Dry year shortfall	7,160

<b>Scenario 111: Jenga House roof, current storage + 6900 L, all drink current pop</b>		Empty Days	417
Tank capacity	13800	Average/year	38
Total roof area	175	Dry Year Empty Days	161
Average number visitors (MRC+Campsite)	64	Wet Year Empty Days	0
Villagers	239	Volume Missed	333,049
Personal Daily Use	8	Average/year	30,277
Daily Use	2424	Wet Year Volume Missed	62,532
Run-off Coefficient	85%	Dry Year Volume Missed	0
Tank proportion	7%	Shortfall	75,896
Daily use as proportion	176.43	Average/year	6,900
		Wet year shortfall	0
		Dry year shortfall	28,950

**Comparison of volume missed (L) from Jenga house at current tank capacity and +6900 L capacity with current population**

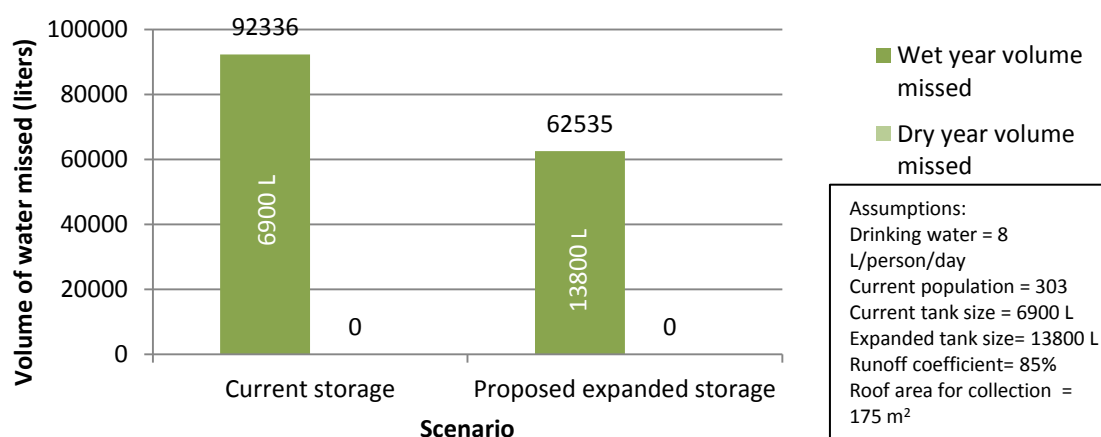


## Appendix W-4dd. Jenga house, projected population

<b>Scenario 88: Jenga House roof, current storage, all drink 2 x visitors + 1.3 x villagers</b>		Empty Days	511
Current tank capacity	6900	Average/year	46
Total roof area	175	Dry Year Empty Days	159
Average number visitors (MRC+Campsite)	128	Wet Year Empty Days	6
Villagers	318	Volume Missed	502,218
Personal Daily Use	8	Average/year	45,656
Daily Use	3568	Wet Year Volume Missed	77,860
Run-off Coefficient	85%	Dry Year Volume Missed	0
Tank proportion	4%	Shortfall	71,440
Daily use as proportion	134.75	Average/year	6,495
		Wet year shortfall	968
		Dry year shortfall	21,973

<b>Scenario 112: Jenga House roof, current storage + 6900 L, all drink 2 x visitors + 1.3 x villagers</b>		Empty Days	963
Tank capacity	13800	Average/year	88
Total roof area	175	Dry Year Empty Days	216
Average number visitors (MRC+Campsite)	128	Wet Year Empty Days	12
Villagers	318	Volume Missed	167,980
Personal Daily Use	8	Average/year	15,271
Daily Use	3568	Wet Year Volume Missed	39,339
Run-off Coefficient	85%	Dry Year Volume Missed	0
Tank proportion	7%	Shortfall	261,739
Daily use as proportion	259.70	Average/year	23,794
		Wet year shortfall	3,478
		Dry year shortfall	57,627

**Comparison of volume missed (L) from Jenga house at current tank capacity and +6900 L capacity with projected population growth**

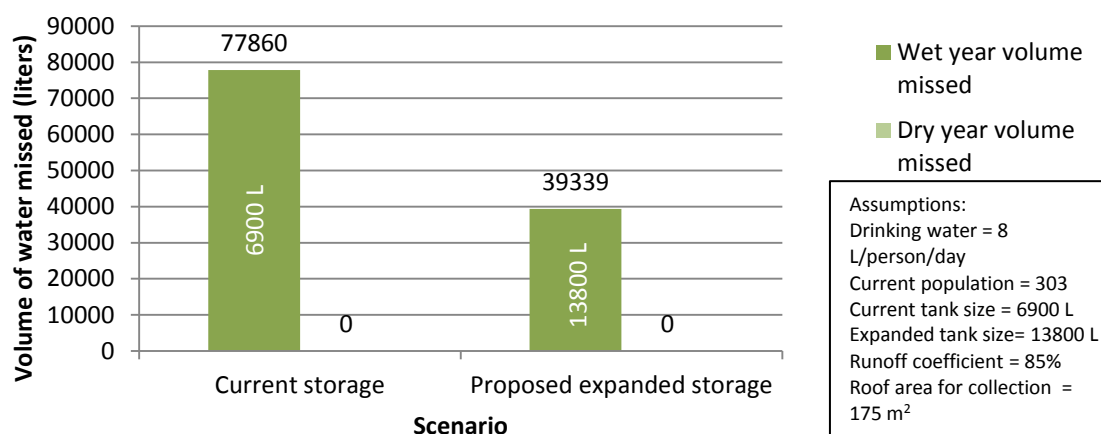


## Appendix W-4ee. Store 15, current population

<b>Scenario 89: Store 15 roof, current storage, all drink current pop</b>		Empty Days	2,209
Current tank capacity	14000	Average/year	201
Total roof area	65	Dry Year Empty Days	288
Average number visitors (MRC+Campsite)	64	Wet Year Empty Days	125
Villagers	239	Volume Missed	0
Personal Daily Use	8	Average/year	0
Daily Use	2424	Wet Year Volume Missed	0
Run-off Coefficient	85%	Dry Year Volume Missed	0
Tank proportion	8%	Shortfall	430,780
Daily use as proportion	185.75	Average/year	39,162
		Wet year shortfall	24,111
		Dry year shortfall	55,037

<b>Scenario 113: Store 15 roof, current storage +14000 L, all drink current pop</b>		Empty Days	3,187
Tank capacity	28000	Average/year	290
Total roof area	65	Dry Year Empty Days	329
Average number visitors (MRC+Campsite)	64	Wet Year Empty Days	252
Villagers	239	Volume Missed	0
Personal Daily Use	8	Average/year	0
Daily Use	2424	Wet Year Volume Missed	0
Run-off Coefficient	85%	Dry Year Volume Missed	0
Tank proportion	14%	Shortfall	1,143,969
Daily use as proportion	345.05	Average/year	103,997
		Wet year shortfall	89,943
		Dry year shortfall	117,234

**Comparison of volume missed (L) from Store 15 at current tank capacity and +14000 L capacity with current population**

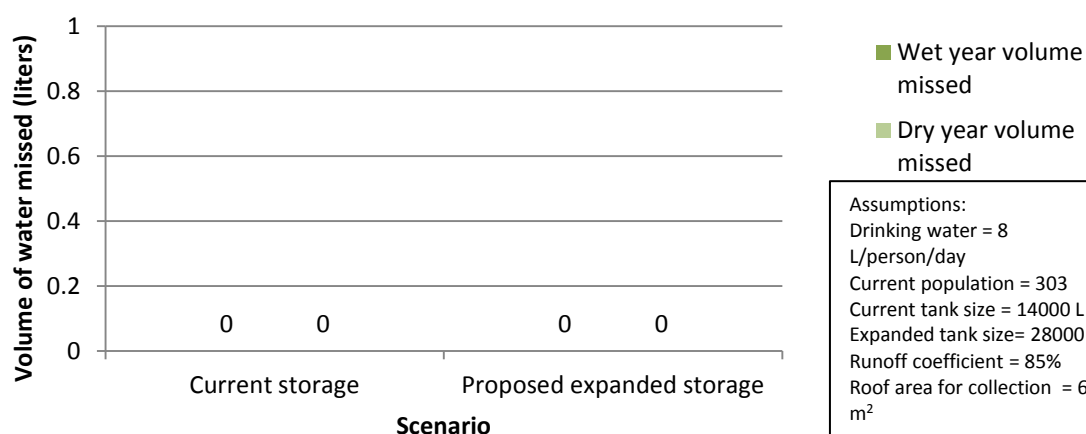

### Appendix W-4ff. Store 15, projected population

<b>Scenario 90: Store 15 roof, current storage, all drink 2 x visitors + 1.3 x villagers</b>		Empty Days	2,880
Current tank capacity	14000	Average/year	262
Total roof area	65	Dry Year Empty Days	316
Average number visitors (MRC+Campsite)	128	Wet Year Empty Days	212
Villagers	318	Volume Missed	0
Personal Daily Use	8	Average/year	0
Daily Use	3568	Wet Year Volume Missed	0
Run-off Coefficient	85%	Dry Year Volume Missed	0
Tank proportion	8%	Shortfall	826,089
Daily use as proportion	273.41	Average/year	75,099
		Wet year shortfall	61,427
		Dry year shortfall	89,179

<b>Scenario 114: Store 15 roof, current storage + 14000 L, all drink 2 x visitors + 1.3 x villagers</b>		Empty Days	3,541
Tank capacity	28000	Average/year	322
Total roof area	65	Dry Year Empty Days	346
Average number visitors (MRC+Campsite)	128	Wet Year Empty Days	296
Villagers	318	Volume Missed	0
Personal Daily Use	8	Average/year	0
Daily Use	3568	Wet Year Volume Missed	0
Run-off Coefficient	85%	Dry Year Volume Missed	0
Tank proportion	14%	Shortfall	1,860,775
Daily use as proportion	507.90	Average/year	169,161
		Wet year shortfall	156,439
		Dry year shortfall	179,572

## Appendix W-5: Hot water needs and solar thermal hot water sizing and costs


### HOT WATER SYSTEM SIZES

Total Shower Allowance/person/day		14 Gallons		Direct Solar	
Building	Beds	Hot Water/Day/Bu	BTUneeded	Btu/m2/day/panel	needed (m2)
Dorms/Bandas	36	504	231184.8	34366.20992	7
Jenga	4	56	25687.2	34366.20992	1
Grevy	4	56	25687.2	34366.20992	1
Klee	4	56	25687.2	34366.20992	1
Wild Dog	4	56	25687.2	34366.20992	1
Heathrow	4	56	25687.2	34366.20992	1
Smithsonian	4	56	25687.2	34366.20992	1
Gym	5	70	32109	34366.20992	1
Margaret's House	4	56	25687.2	34366.20992	1
Daily showers	69	966	443104.2	34366.20992	13
Needed Daily HW	966				


Location	Panels	Unit Cost	Notes
Dorms	3	113,000	220LT WITH 1X2.3SQ MT PANEL
Remainder	8	113,000	220LT WITH 1X2.3SQ MT PANEL
Total	11	1243000	Cost Ksh
		15288.9	Cost US\$

## Appendix W-6: Rainfall data


### W-6a. 2001 rainfall at MRC

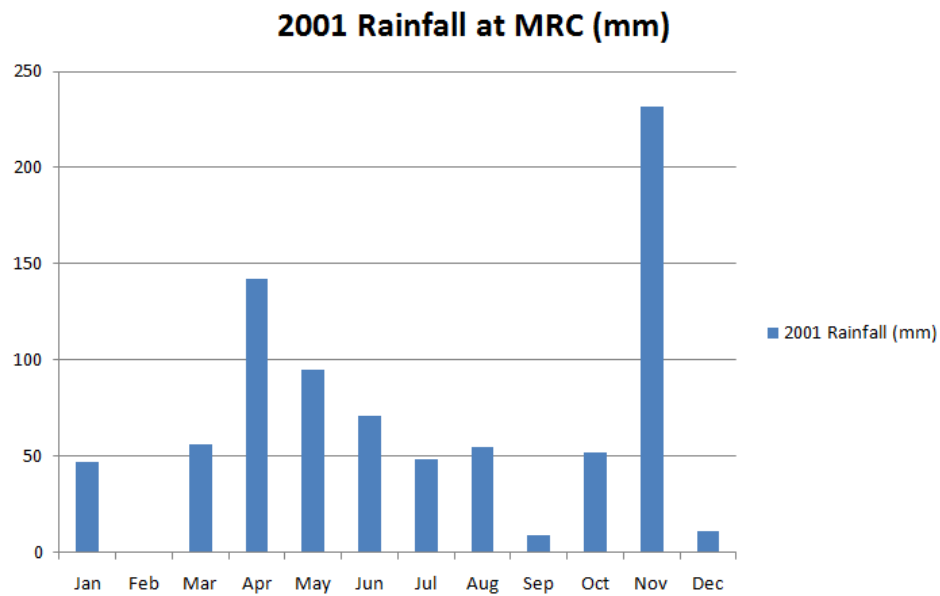

### W-6b. 2009-2010 MRC rainfall vs. long-term average

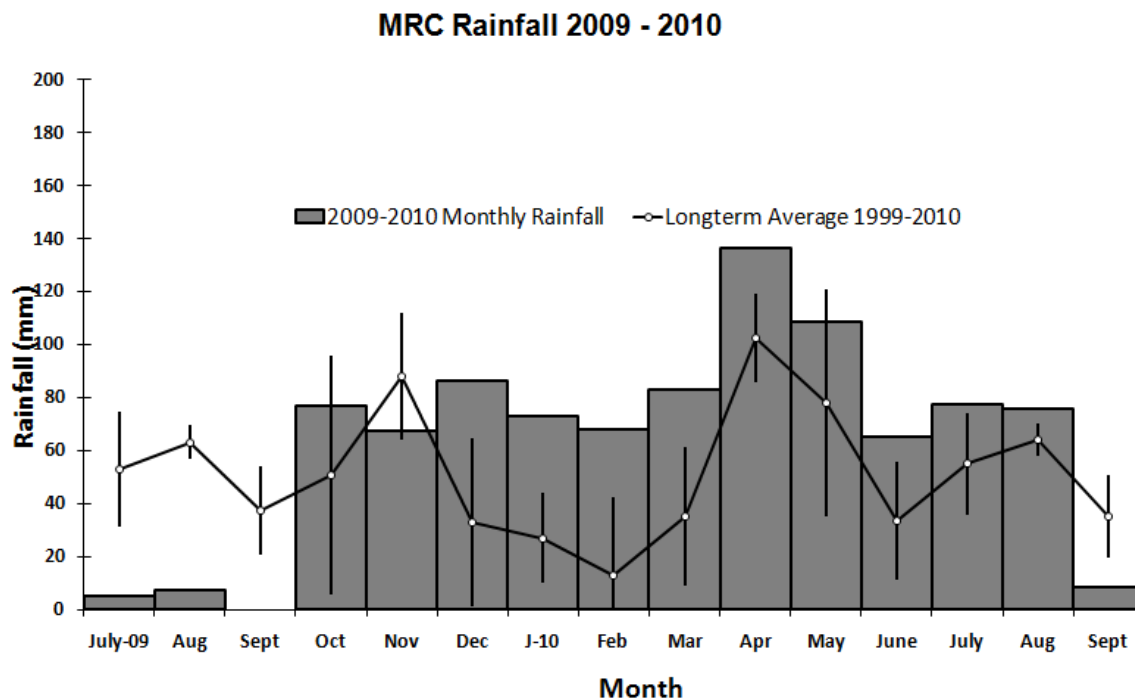

### W-6c. Total rainfall at MRC by year

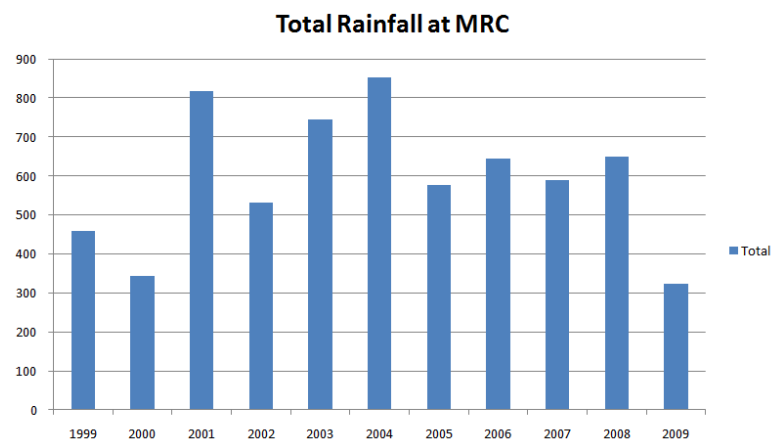

## Appendix W-7: Costs for building water tanks (above and belowground)

### Above ground tank

Item	Item Description	Unit Cost	Quantity	Total Cost	Notes
Mosquito Dunks	Larvicide	16,752	1	16752	
Gutter screens	Plastic screen	14,239	1	14239	
Flash tape	Bird deterrent	251	1	251	
Labor - Masonry	1 Mason Day plus 1 Labor day	900	10	9000	
Gutters	Plastic	251	50	12564	
First flush device		3,350	1	3350	
Piping	PVC	2,513	1	2513	
Floating suction filter		3,350	1	3350	
UV water purifier		46,487	1	46487	

### TOTAL COST

108,506.88 Ksh

\$ 1,302.08 US

### Common Underground Tank by Library

Item	Item Description	Unit Cost	Quantity	Total Cost	Notes
Piping	PVC per linear meter	250	755	188750	
Labor for Digging Piping Trenches	1 laborer day	20	300	6000	
Labor -Digging for Storage Tank	1 laborer day	300	60	18000	4 men digging for 15 days
Labor - Masonry	1 Mason Day plus 1 laborer day	900	440	396000	2 Masons for 220 days, 2 laborers for 220 days or add more laborers
Cement	50 kg bag	800	252	201600	Surface area of 240m <sup>2</sup> , 10cm thick
Floating Suctions Filter		12,500	1	12500	
Above Ground Draw Tank	Similar to single building tank	4250	1	4250	Where treatment occurs, costs from above
Ozone Generator with Solar Kit	Sized for Local Above Ground	57143	1	57143	

### TOTAL COST

695,492.86 Ksh

\$ 8,345.91 US